

MOUNTING AND OPERATING INSTRUCTIONS



EB 5578-E EN

Translation of original instructions



TROVIS 5578-E Heating and District Heating Controller With graphics display

Firmware version 2.68



Edition July 2023

Note on these mounting and operating instructions

These mounting and operating instructions assist you in mounting and operating the device safely. The instructions are binding for handling SAMSON devices. The images shown in these instructions are for illustration purposes only. The actual product may vary.

- For the safe and proper use of these instructions, read them carefully and keep them for later reference.
- If you have any questions about these instructions, contact SAMSON's After-sales Service (aftersaleservice@samsongroup.com).



Documents relating to the device, such as the mounting and operating instructions, are available on our website at www.samsongroup.com > **Downloads > Documentation.**

Definition of signal words

DANGER

Hazardous situations which, if not avoided, will result in death or serious injury

WARNING

Hazardous situations which, if not avoided, could result in death or serious injury

NOTICE

Property damage message or malfunction

Note

Additional information

Tip

Recommended action

| | | |
|----------|---|------------|
| 1 | Safety instructions and measures | 1-1 |
| 1.1 | Notes on possible severe personal injury | 1-3 |
| 1.2 | Notes on possible property damage | 1-3 |
| 2 | Markings on the device | 2-1 |
| 2.1 | Nameplate | 2-1 |
| 2.2 | Device version | 2-1 |
| 2.3 | Firmware versions | 2-2 |
| 3 | Design and principle of operation | 3-1 |
| 3.1 | Configuration using TROVIS-VIEW | 3-1 |
| 3.2 | Connection to SAM DISTRICT ENERGY | 3-2 |
| 3.3 | Technical data | 3-3 |
| 3.4 | Dimensions | 3-4 |
| 3.5 | Values for resistance thermometers | 3-5 |
| 4 | Shipment and on-site transport | 4-1 |
| 4.1 | Accepting the delivered goods | 4-1 |
| 4.2 | Removing the packaging from the heating controller | 4-1 |
| 4.3 | Transporting the heating controller | 4-1 |
| 4.4 | Storing the heating controller | 4-1 |
| 5 | Installation | 5-1 |
| 5.1 | Installation conditions | 5-1 |
| 5.2 | Preparation for installation | 5-1 |
| 5.3 | Mounting the heating controller | 5-1 |
| 5.4 | Electrical connection | 5-3 |
| 6 | Operation | 6-1 |
| 6.1 | Operating controls | 6-1 |
| 6.2 | Interfaces | 6-2 |
| 6.2.1 | RS-485 interfaces for Modbus-RTU and device bus communication | 6-2 |
| 6.2.2 | Ethernet interface for Modbus-TCP/IP communication | 6-2 |
| 6.2.3 | M-bus interface | 6-2 |
| 6.3 | Accessories | 6-3 |
| 7 | Start-up and configuration | 7-1 |
| 7.1 | Altering the display contrast | 7-3 |
| 7.2 | Changing the display language | 7-3 |
| 7.3 | Setting the system code number | 7-4 |
| 7.4 | Activating and deactivating functions | 7-5 |
| 7.5 | Changing parameters | 7-7 |

Contents

| | | |
|-----------|---|-------------|
| 7.6 | Calibrating sensors | 7-8 |
| 7.6.1 | Special values..... | 7-10 |
| 7.7 | Entering customized key number | 7-11 |
| 8 | Setup | 8-1 |
| 8.1 | Selecting the operating mode..... | 8-1 |
| 8.2 | Schedules..... | 8-3 |
| 8.2.1 | Setting the time and date..... | 8-3 |
| 8.2.2 | Setting the times-of-use..... | 8-5 |
| 8.2.3 | Setting the party timer (special time-of-use)..... | 8-7 |
| 8.2.4 | Programming public holidays (special times-of-use) | 8-8 |
| 8.2.5 | Programming vacation periods (special times-of-use)..... | 8-9 |
| 8.3 | Entering day and night set points | 8-11 |
| 8.4 | Reset to default settings..... | 8-14 |
| 8.5 | Reading information | 8-14 |
| 8.5.1 | Adapting the Trend-Viewer | 8-20 |
| 8.6 | Operating the heating controller in manual mode..... | 8-21 |
| 9 | Malfunctions | 9-1 |
| 9.1 | Error list | 9-2 |
| 9.2 | Sensor failure | 9-2 |
| 9.3 | Temperature monitoring..... | 9-3 |
| 9.4 | Error status register | 9-4 |
| 10 | Servicing..... | 10-1 |
| 11 | Decommissioning | 11-1 |
| 12 | Removal | 12-1 |
| 13 | Repairs | 13-1 |
| 13.1 | Returning devices to SAMSON | 13-1 |
| 14 | Disposal..... | 14-1 |
| 15 | Certificates..... | 15-1 |
| 16 | Annex A (configuration instructions)..... | 16-1 |
| 16.1 | Systems..... | 16-1 |
| 16.2 | Functions of the heating circuit | 16-180 |
| 16.2.1 | Outdoor-temperature-compensated control | 16-180 |
| 16.2.1.1 | Outdoor temperature received or sent as 0 to 10 V signal..... | 16-181 |
| 16.2.1.2 | Outdoor temperature received or sent over the device bus..... | 16-182 |
| 16.2.1.3 | Gradient characteristic | 16-183 |
| 16.2.1.4 | Four-point characteristic | 16-185 |

| | | |
|-----------|--|--------|
| 16.2.2 | Fixed set point control..... | 16-186 |
| 16.2.3 | Underfloor heating/drying of jointless floors..... | 16-187 |
| 16.2.4 | Night set-back..... | 16-189 |
| 16.2.4.1 | Outdoor temperature for continuous day mode..... | 16-189 |
| 16.2.4.2 | Variable night set-back..... | 16-189 |
| 16.2.5 | Buffer tank systems..... | 16-190 |
| 16.2.6 | Summer mode..... | 16-194 |
| 16.2.7 | Delayed outdoor temperature adaptation..... | 16-195 |
| 16.2.8 | Remote operation..... | 16-195 |
| 16.2.9 | Optimization..... | 16-196 |
| 16.2.10 | Flash adaptation..... | 16-197 |
| 16.2.10.1 | Flash adaptation without outdoor sensor (based on room temperature)..... | 16-198 |
| 16.2.11 | Adaptation..... | 16-199 |
| 16.2.12 | Cooling control..... | 16-199 |
| 16.2.13 | Differential temperature control..... | 16-201 |
| 16.3 | Functions of the DHW circuit..... | 16-202 |
| 16.3.1 | DHW heating in the storage tank system..... | 16-202 |
| 16.3.1.1 | DHW circuit additionally controlled by a globe valve..... | 16-204 |
| 16.3.2 | DHW heating in the storage tank charging system..... | 16-205 |
| 16.3.2.1 | Cold charging protection..... | 16-207 |
| 16.3.3 | DHW heating in instantaneous heating system..... | 16-208 |
| 16.3.4 | Domestic hot water heating with solar system..... | 16-209 |
| 16.3.5 | Intermediate heating..... | 16-210 |
| 16.3.6 | Parallel pump operation..... | 16-210 |
| 16.3.7 | Circulation pump during storage tank charging..... | 16-211 |
| 16.3.8 | Priority circuit..... | 16-211 |
| 16.3.8.1 | Reverse control..... | 16-211 |
| 16.3.8.2 | Set-back operation..... | 16-212 |
| 16.3.9 | Forced charging of DHW storage tank..... | 16-212 |
| 16.3.10 | Thermal disinfection of DHW storage tank..... | 16-213 |
| 16.4 | System-wide functions..... | 16-215 |
| 16.4.1 | Automatic summer/standard time switchover..... | 16-215 |
| 16.4.2 | Frost protection..... | 16-215 |
| 16.4.3 | Forced pump operation..... | 16-216 |
| 16.4.4 | Return flow temperature limitation..... | 16-216 |
| 16.4.5 | Condensate accumulation control..... | 16-218 |
| 16.4.6 | Three-step control..... | 16-218 |
| 16.4.7 | On/off control..... | 16-219 |

Contents

| | | |
|-----------|--|-------------|
| 16.4.8 | Continuous control | 16-219 |
| 16.4.9 | Releasing a control circuit/heating controller with binary input | 16-220 |
| 16.4.10 | Speed control of the charging pump | 16-220 |
| 16.4.11 | Processing an external demand | 16-221 |
| 16.4.12 | External demand using a 0 to 10 V signal | 16-223 |
| 16.4.13 | Capacity limitation in RK1 | 16-224 |
| 16.4.14 | Creep feed rate limitation with a binary input | 16-225 |
| 16.4.15 | Device bus | 16-226 |
| 16.4.15.1 | Requesting and processing an external demand | 16-226 |
| 16.4.15.2 | Sending and receiving outdoor temperatures | 16-228 |
| 16.4.15.3 | Synchronizing the clock | 16-229 |
| 16.4.15.4 | Priority over all controllers and return flow limitation | 16-229 |
| 16.4.15.5 | Display error messages issued by the device bus | 16-230 |
| 16.4.16 | Activating TROVIS I/O expansion modules | 16-230 |
| 16.4.17 | Connecting potentiometers for valve position input | 16-231 |
| 16.4.18 | Locking manual level | 16-232 |
| 16.4.19 | Locking the rotary switch | 16-232 |
| 16.4.20 | Feeder pump operation | 16-232 |
| 16.4.21 | Speed control of the circulation pump (DHW) | 16-232 |
| 16.4.22 | External demand for heat due to insufficient heat supply | 16-233 |
| 16.5 | Communication | 16-234 |
| 16.5.1 | Ethernet interface | 16-234 |
| 16.5.2 | RS-485 interface for Modbus RTU communication | 16-234 |
| 16.5.3 | RS-485 interface for forwarding Modbus-TCP/IP communication | 16-236 |
| 16.5.4 | Meter bus | 16-236 |
| 16.5.4.1 | Activating the meter bus | 16-236 |
| 16.5.4.2 | Flow rate and/or capacity limitation with meter bus | 16-238 |
| 16.5.5 | Return flow temperature limitation based on capacity | 16-241 |
| 16.5.6 | Bluetooth® interface | 16-242 |
| 16.6 | Function block lists | 16-244 |
| 16.7 | Parameter lists | 16-273 |
| 16.8 | Customer-specific data | 16-284 |
| 17 | Annex B | 17-1 |
| 17.1 | Accessories | 17-1 |
| 17.2 | After-sales service | 17-2 |

1 Safety instructions and measures

Intended use

The TROVIS 5578-E Heating and District Heating Controller is used to control up to three control circuits:

- Control of a primary heat exchanger or boiler with up to two mixing heating circuit and one non-mixing heating circuit (both outdoor-temperature-compensated) and control of DHW heating in the secondary circuit
- Outdoor-temperature-compensated buffer storage tank control with up to two mixing heating circuits and continuous-flow hot water module
- Control of two outdoor-temperature-compensated heating circuits and a DHW heating with three valves in the primary circuit
- Control of three outdoor-temperature-compensated heating circuits with three valves in the primary circuit
- Applications with up to six control circuits are possible using optional TROVIS I/O expansion modules (linked by device bus).
- To control systems with larger numbers of control circuits, several controllers can be linked using a device bus.

The controller is designed to operate under exactly defined conditions. Therefore, operators must ensure that the controller is only used in operating conditions that meet the specifications used at the ordering stage. In case operators intend to use the heating and district heating controller in applications or conditions other than those specified, contact SAMSON.

SAMSON does not assume any liability for damage resulting from the failure to use the device for its intended purpose or for damage caused by external forces or any other external factors.

➔ Refer to the technical data for limits and fields of application as well as possible uses.

Reasonably foreseeable misuse

The controller is not suitable for the following applications:

- Use outside the limits defined during sizing and by the technical data

Furthermore, the following activities do not comply with the intended use:

- Use of non-original spare parts
- Performing service and repair work not described

Safety instructions and measures

Qualifications of operating personnel

The controller must be mounted, started up, serviced and repaired by fully trained and qualified personnel only; the accepted industry codes and practices must be observed. According to these mounting and operating instructions, trained personnel refers to individuals who are able to judge the work they are assigned to and recognize possible hazards due to their specialized training, their knowledge and experience as well as their knowledge of the applicable standards.

Personal protective equipment

No personal protective equipment is required for the direct handling of the controller.

Revisions and other modifications

Revisions, conversions or other modifications of the product are not authorized by SAMSON. They are performed at the user's own risk and may lead to safety hazards, for example. Furthermore, the product may no longer meet the requirements for its intended use.

Warning against residual hazards

The controller has direct influence on controlled components of the heating system (e.g. control valves and pumps). To avoid personal injury or property damage, plant operators and operating personnel must prevent hazards that could be caused in the plant components by the process medium, the operating pressure, the signal pressure or by moving parts by taking appropriate precautions. Plant operators and operating personnel must observe all hazard statements, warnings and caution notes in the referenced documents.

Responsibilities of the operator

Operators are responsible for proper use and compliance with the safety regulations. Operators are obliged to provide these mounting and operating instructions as well as the referenced documents to the operating personnel and to instruct them in proper operation. Furthermore, operators must ensure that operating personnel or third parties are not exposed to any danger.

Responsibilities of operating personnel

Operating personnel must read and understand these mounting and operating instructions as well as the referenced documents and observe the specified hazard statements, warnings and caution notes. Furthermore, operating personnel must be familiar with the applicable health, safety and accident prevention regulations and comply with them.

Referenced standards, directives and regulations

The TROVIS 5578-E Heating and District Heating Controller fulfills the requirements of the Directives 2014/30/EU, 2014/35/EU and 2011/65/EU. The declaration of conformity includes information about the applied conformity assessment procedure.

The controller is designed for use in low voltage installations.

→ For wiring, maintenance and repair, observe the relevant safety regulations.

1.1 Notes on possible severe personal injury

DANGER

Risk of fatal injury due to electric shock.

- Before connecting wiring, performing any work on the controller or opening the controller, disconnect the supply voltage and protect it against unintentional reconnection.
- Only use power interruption devices that can be protected against unintentional reconnection of the power supply.
- Do not remove any covers to perform adjustment work on live parts.

1.2 Notes on possible property damage

NOTICE

Risk of damage to the controller due to the supply voltage exceeding the permissible tolerances.

The controller is designed for use in low voltage installations.

→ Observe the permissible tolerances of the supply voltage.

Malfunction due to a configuration that does not meet the requirements of the application.

The controller is configured for specific applications by setting functions and parameters. Function and parameter settings have a direct effect on final control elements.

→ Perform the configuration for the specific application.

Safety instructions and measures

Manipulation of the configuration due to unauthorized access.

The controller can be protected against unauthorized access through entering a key number. The key number for first start-up can be found at the back of these mounting and operating instructions.

- Do not pass the key number on to unauthorized persons. Keep it in a safe place inaccessible to unauthorized persons.

Risk of controller damage due to large differences in temperature.

- Before start-up, wait until the controller has reached the ambient temperature.

System damage caused by frost.


Frost protection is deactivated in the manual mode.

- Do not run the heating during cold weather in the manual mode for long periods of time.

2 Markings on the device

2.1 Nameplate

The nameplate shown was up to date at the time of publication of this document. The nameplate on the device may differ from the one shown.

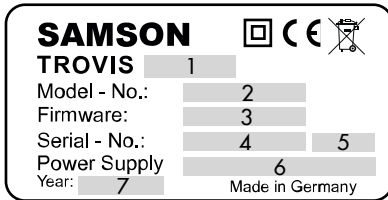

- 1 Type designation
- 2 Model number
- 3 Firmware version
- 4 Serial number
- 5 Fuse protection
- 6 Supply voltage
- 7 Date of manufacture

2.2 Device version

The TROVIS 5578-E Heating and District Heating Controller is available in various versions. The type designation on the nameplate indicates the controller version:

| Type designation (nameplate) | Version |
|------------------------------|---|
| TROVIS 5578-1113 | Heating and district heating controller with an RS-485 interface for Modbus RTU and device bus communication |
| TROVIS 5578-1114 | Heating and district heating controller with two RS-485 interfaces for separate Modbus RTU and device bus communication |

These mounting and operating instructions are valid for both controller versions.

2.3 Firmware versions

The firmware depends on the controller version.

| | | | | | | | |
|----------|------------------|------|------|------------------|------|------|-----|
| Firmware | 2.50 | 2.51 | 2.61 | 2.62 | 2.63 | 2.64 | ... |
| Version | TROVIS 5578-1113 | | | | | - | - |
| | - | - | - | TROVIS 5578-1114 | | | |

| Firmware revisions | |
|--|---|
| Old | New |
| 2.50 | 2.51 |
| | Discharging protection for DHW tank and buffer tank |
| | Output of pump for continuous-flow hot water module (buffer tank systems Anl 3.9, 5.9, 17.x and 18.x) moved from AA2 to AA4. |
| | Operating status reading of the DHW heating |
| 2.51 | 2.61 |
| | New function Variable night set-back can be configured separately for each heating circuit (setting: CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 1) |
| | Function blocks CO1 -> F27 and CO4 -> F27 introduced to activate the discharging protection |
| | Storage tank bottom sensor RÜF2 can be configured as sensor to switch off the thermal disinfection (setting: CO4 -> F24 - 1) |
| | Free analog output assignment: configure CO5 -> F34, F35, F36, F37 to determine which output signals are to be issued at AA1, AA2, AA3 and AA4. |
| | The values of analog outputs AA1, AA2, AA3 and AA4 are saved with 0 to 100 % in the overall scheme diagram. |
| | All the analog outputs AA1 to AA4 are available in manual mode. |
| | Additional buffer tank bottom sensor SF3 can be configured in CO1 -> F25 - 1 setting. It can be changed to be based on the outdoor temperature. |
| | Another sensor can be configured as SF2 for speed control of the SLP (storage tank charging pump). |
| | New function: speed-controlled DHW circulation pump for control the circulation return flow temperature using sensor RÜF4/AF2 |
| Device bus addresses in the range between 11 and 19 are available for addressing the TROVIS I/O expansion modules. | |

| Firmware revisions | |
|--------------------|--|
| Old | New |
| 2.61 | 2.62 |
| | Internal revisions |
| 2.62 | 2.63 |
| | New option configurable: 3 V supply for analog outputs |
| | Valid range of the internal time corrected |
| 2.63 | 2.64 |
| | Internal revisions |
| 2.64 | 2.66 |
| | Optimized relay holding voltage |
| | Improved communication with SAM DISTRICT ENERGY web portal |
| | Internal revisions |
| 2.66 | 2.68 |
| | Release version with all pre-versions (V 2.66A to V 2.66G) |

3 Design and principle of operation

The TROVIS 5578-E Heating and District Heating Controller is used to control up to three control circuits.

- Control of a primary heat exchanger or boiler with up to two mixing heating circuit and one non-mixing heating circuit (both outdoor-temperature-compensated) and control of DHW heating in the secondary circuit
- Outdoor-temperature-compensated buffer storage tank control with up to two mixing heating circuits and continuous-flow hot water module
- Control of two outdoor-temperature-compensated heating circuits and a DHW heating with three valves in the primary circuit
- Control of three outdoor-temperature-compensated heating circuits with three valves in the primary circuit
- Applications with up to six control circuits are possible using optional TROVIS I/O expansion modules (linked by device bus).
- To control systems with larger numbers of control circuits, several controllers can be linked using a device bus.

The TROVIS 5578-E Heating and District Heating Controller is adapted to the specific system by setting the appropriate system code number. Additional sensors and/or functions which are not part of the system's basic configuration may be selected over

function blocks. The switch positions and entry of the key number allow access to the corresponding levels. For trained staff, the configuration levels used to set function blocks are indicated by "CO" and the parameter levels are indicated by "PA". Data is retrieved and entered at the controller using a rotary pushbutton. This process is facilitated by icons and plain text displayed on the LCD. The rotary switch is used to set the operating mode and the parameters required for each circuit.

M-bus interface

A maximum of three meters conforming to EN 1434-3 can be connected for data transfer. In addition, heat meters for each control circuit are available for flow rate and/or capacity limitation. Various limits can be adjusted for the different operating modes "Heating control only", "Heating control with DHW heating" and "DHW heating only" in control circuit RK1. Outdoor-temperature-compensated flow rate or capacity limitation can also be implemented.

3.1 Configuration using TROVIS-VIEW

The controller can be configured with the TROVIS-VIEW software.

In this case, the TROVIS 5578-E Heating and District Heating Controller is connected to the computer over Ethernet.

The TROVIS-VIEW software enables the user to easily configure the controller as well as view process parameters online.

i Note

TROVIS-VIEW provides a uniform user interface that allows users to configure and parameterize various SAMSON devices using device-specific database modules. The device module 5578-E can be downloaded free of charge from our website at

▶ www.samsongroup.com > SERVICE & SUPPORT > Downloads > TROVIS-VIEW. Further information on TROVIS-VIEW (e.g. system requirements) is available on our website and in the Data Sheet ▶ T 6661.

i Note

SAM DISTRICT ENERGY is a web-based solution for managing, controlling and optimizing heating systems in the local heat supply and district heating networks.

You can find more information and test SAM DISTRICT ENERGY using a demo account on our website at ▶ www.samsongroup.com > Products & Applications > Digital solutions > SAM DISTRICT ENERGY.

3.2 Connection to SAM DISTRICT ENERGY

The controller can be configured and operated on a computer, smartphone or tablet computer using the SAM DISTRICT ENERGY industry-specific application.

The controller is connected to SAM DISTRICT ENERGY either over the Ethernet or Modbus interface using a communication gateway.

SAM DISTRICT ENERGY allows remote start-up and set-up of the controllers. Key information of the controller and entire heating system is clearly visualized at one central location.

3.3 Technical data

| | |
|---------------------------------------|---|
| Inputs | 14x Pt 1000, PTC or Ni 1000 sensor inputs, alternatively configurable for binary alarms 3x 0 to 10 V inputs Input 17 for a pulse signal (3 to 800 pulses/h) of a heat meter for capacity limitation in RK1 |
| Outputs | 3x three-step signal, alternatively 3x on/off signal 5578-1113: relay outputs, rating max. 250 V AC, 2 A 5578-1114: RK1, RK2: relay outputs, rating max. 250 V AC, 2 A; RK3: TRIAC output, rating max. 250 V AC, 0.12 A 5x pump output: relay outputs, rating max. 250 V AC, 2 A All relay outputs with varistor suppression 4x 0 to 10 V or PWM signal, configurable, to issue a control signal or for pump speed control, load >5 k Ω |
| Interfaces | Ethernet interface for Modbus-TCP/IP communication and connection to SAM DISTRICT ENERGY using an Internet router. Alternative access using optional external gateways M-bus interface for up to three M-bus units, protocol acc. to EN 1434-3 |
| TROVIS 5578-1113 | Galvanically isolated RS-485 interface for Modbus-RTU and device bus communication. Data format Modbus RTU: 8N1 Bluetooth [®] interface 4.1 |
| TROVIS 5578-1114 | 2x galvanically isolated RS-485 interface for Modbus-RTU and device bus communication. Data format Modbus RTU: 8N1 Bluetooth [®] interface 5.0 |
| Supply voltage | 165 to 250 V, 48 to 62 Hz, max. 10 VA |
| Permissible ambient temperature range | 0 to 40 °C (operation), -10 to +60 °C (storage and transport) |
| Degree of protection | IP 40 according to EN 60529 |
| Class of protection | II according to EN 61140 |
| Degree of contamination | 2 according to EN 61010-1 |
| Overvoltage category | II according to EN 60664 |
| Noise immunity | According to EN 61000-6-1 |
| Noise emission | According to EN 61000-6-3 |
| Conformity | CE |
| Weight | Approx. 0.5 kg |

3.4 Dimensions

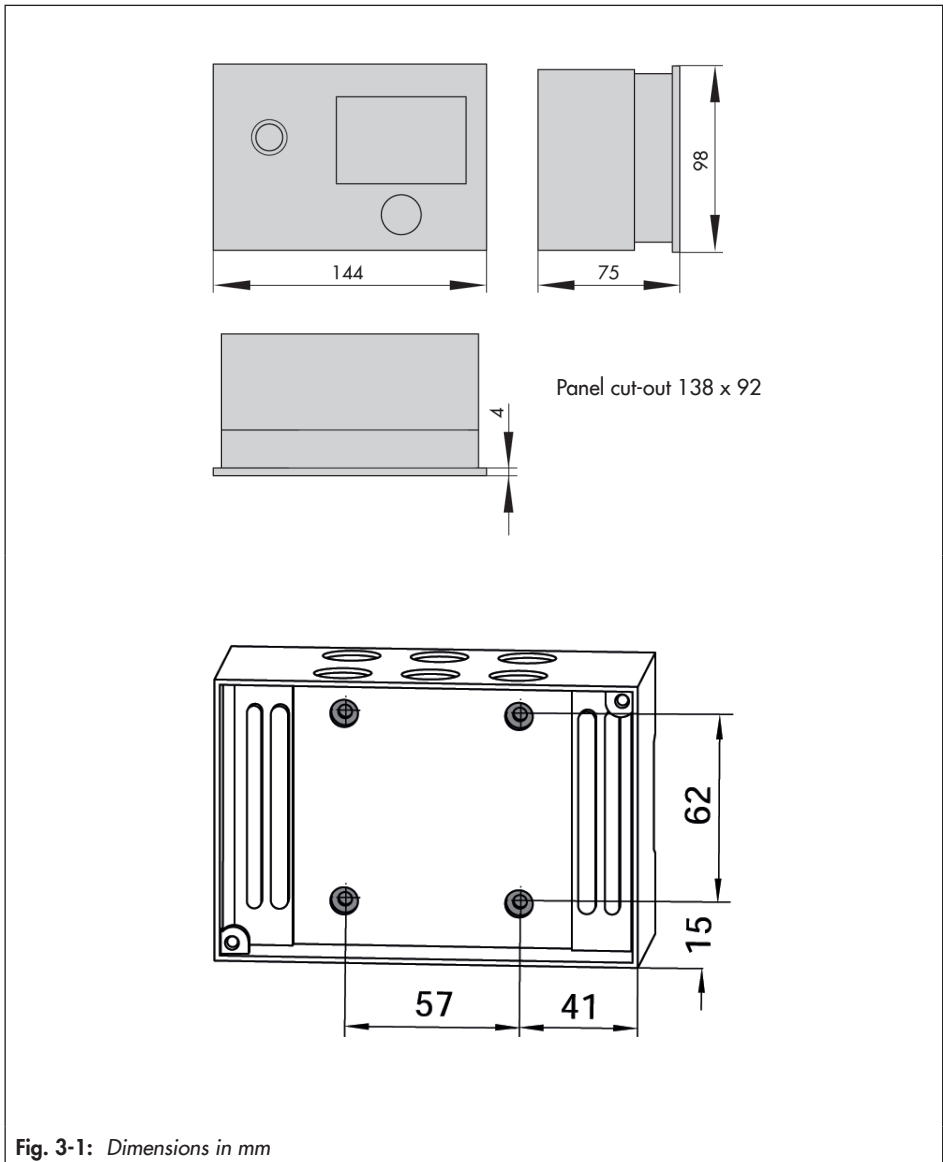


Fig. 3-1: Dimensions in mm

3.5 Values for resistance thermometers

Pt 1000 sensors

| | | | | | | | | | | | | |
|----------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Temperature °C | -35 | -30 | -25 | -20 | -15 | -10 | -5 | 0 | +5 | +10 | +15 | +20 |
| Resistance Ω | 862.5 | 882.2 | 901.9 | 921.6 | 941.2 | 960.9 | 980.4 | 1000.0 | 1019.5 | 1039.0 | 1058.5 | 1077.9 |
| Temperature °C | +25 | +30 | +35 | +40 | +45 | +50 | +55 | +60 | +65 | +70 | +75 | +80 |
| Resistance Ω | 1097.3 | 1116.7 | 1136.1 | 1155.4 | 1174.7 | 1194.0 | 1213.2 | 1232.4 | 1251.6 | 1270.8 | 1289.9 | 1309.0 |
| Temperature °C | +85 | +90 | +95 | +100 | +105 | +110 | +115 | +120 | +125 | +130 | +135 | +140 |
| Resistance Ω | 1328.1 | 1347.1 | 1366.1 | 1385.1 | 1404.0 | 1422.9 | 1441.8 | 1460.7 | 1479.5 | 1498.3 | 1517.1 | 1535.8 |
| Temperature °C | +145 | +150 | +155 | +160 | +165 | +170 | +175 | +180 | +185 | +190 | +195 | +200 |
| Resistance Ω | 1554.6 | 1573.3 | 1591.9 | 1610.5 | 1629.1 | 1647.7 | 1666.3 | 1684.8 | 1703.3 | 1721.7 | 1740.2 | 1758.6 |

PTC sensor

| | | | | | | | | |
|----------------|------|------|------|------|------|------|------|------|
| Temperature °C | -20 | -10 | 0 | +10 | +20 | +30 | +40 | +50 |
| Resistance Ω | 693 | 756 | 824 | 896 | 971 | 1050 | 1133 | 1220 |
| Temperature °C | +60 | +70 | +80 | +90 | +100 | +110 | +120 | |
| Resistance Ω | 1311 | 1406 | 1505 | 1606 | 1713 | 1819 | 1925 | |

Type 5244 (remote control unit)

Switch position ⊖, terminals 1 and 2

| | | | | | |
|----------------|-----|-----|-----|-----|-----|
| Temperature °C | 10 | 15 | 20 | 25 | 30 |
| Resistance Ω | 679 | 699 | 720 | 741 | 762 |

Ni 1000 sensors

| | | | | | | | | | | | |
|----------------|------|------|------|------|------|------|------|------|------|------|------|
| Temperature °C | -60 | -50 | -40 | -30 | -20 | -10 | 0 | +10 | +20 | +30 | +40 |
| Resistance Ω | 695 | 743 | 791 | 841 | 893 | 946 | 1000 | 1056 | 1112 | 1171 | 1230 |
| Temperature °C | +50 | +60 | +70 | +80 | +90 | +100 | +110 | +120 | +130 | +140 | +150 |
| Resistance Ω | 1291 | 1353 | 1417 | 1483 | 1549 | 1618 | 1688 | 1760 | 1833 | 1909 | 1986 |
| Temperature °C | +160 | +170 | +180 | +190 | +200 | +210 | +220 | +230 | +240 | +250 | |
| Resistance Ω | 2066 | 2148 | 2232 | 2318 | 2407 | 2498 | 2592 | 2689 | 2789 | 2892 | |

4 Shipment and on-site transport

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

4.1 Accepting the delivered goods

After receiving the shipment, proceed as follows:

1. Compare the shipment received with the delivery note.
2. Check the shipment for transportation damage. Report any damage to SAMSON and the forwarding agent (refer to delivery note).

4.2 Removing the packaging from the heating controller

i Note

Do not remove the packaging until immediately before mounting and start-up.

1. Remove the packaging from the heating controller.
2. Check scope of delivery (see Fig. 4-1).
3. Dispose and recycle the packaging in accordance with the local regulations.

- | | |
|----|---|
| 1x | TROVIS 5578-E Heating and District Heating Controller |
| 1x | Document IP 5578-E (Important Product Information) |

Fig. 4-1: *Scope of delivery*

4.3 Transporting the heating controller

Transport instructions

- Protect the heating controller against external influences (e.g. impact).
- Protect the heating controller against moisture and dirt.
- Observe transport temperature depending on the permissible ambient temperature (see the 'Design and principle of operation' section).

4.4 Storing the heating controller

! NOTICE

Risk of heating controller damage due to improper storage.

- ➔ *Observe the storage instructions.*
- ➔ *Avoid long storage times.*
- ➔ *Contact SAMSON in case of different storage conditions.*

i Note

We recommend to regularly check the prevailing storage conditions during long storage periods.

Storage instructions

- Protect the heating controller against external influences (e.g. impact).
- Protect the heating controller against moisture and dirt. Store it at a relative humidity of less than 75 %. In damp spaces, prevent condensation. If necessary, use a drying agent or heating.
- Make sure that the ambient air is free of acids or other corrosive media.
- Observe transport temperature depending on the permissible ambient temperature (see the 'Design and principle of operation' section).
- Do not place any objects on the heating controller.

5 Installation

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

5.1 Installation conditions

Work position

The work position is the front view onto the operating controls on the heating controller seen from the position of operating personnel.

Operators must ensure that, after installation of the heating controller, the operating personnel can perform all necessary work safely and easily access the heating controller from the work position.

5.2 Preparation for installation

Before installation, make sure the following conditions are met:

- The heating controller is not damaged.

Proceed as follows:

- ➔ Lay out the necessary material and tools to have them ready during installation work.

5.3 Mounting the heating controller

The controller consists of the housing with the electronics and the base with the terminals. It is suitable for panel, wall and rail mounting (see Fig. 5-1).

Panel mounting

1. Undo the two screws (1).
2. Pull apart the controller housing and the base.
3. Make panel cut-out with the dimensions 138 x 92 mm (W x H).
4. Push the controller housing through the panel cut-out.
5. Tighten the two screws (2) to clamp the controller housing against the control panel.
6. Perform electric wiring on the base as described in section 5.4.
7. Remount the controller housing.
8. Tighten the two screws (1).

Wall mounting

1. Undo the two screws (1).
2. Pull apart the controller housing and the base.
3. If necessary, drill holes with the specified dimensions in the appropriate places. Fasten the base with four screws.
4. Perform electric wiring on the base as described in section 5.4.
5. Remount the controller housing.
6. Tighten the two screws (1).

Rail mounting

1. Fasten the spring-loaded hook (4) at the bottom of the top hat rail (3).
2. Slightly push the controller upwards and pull the top hook (5) over the top hat rail. Undo the two screws (1).

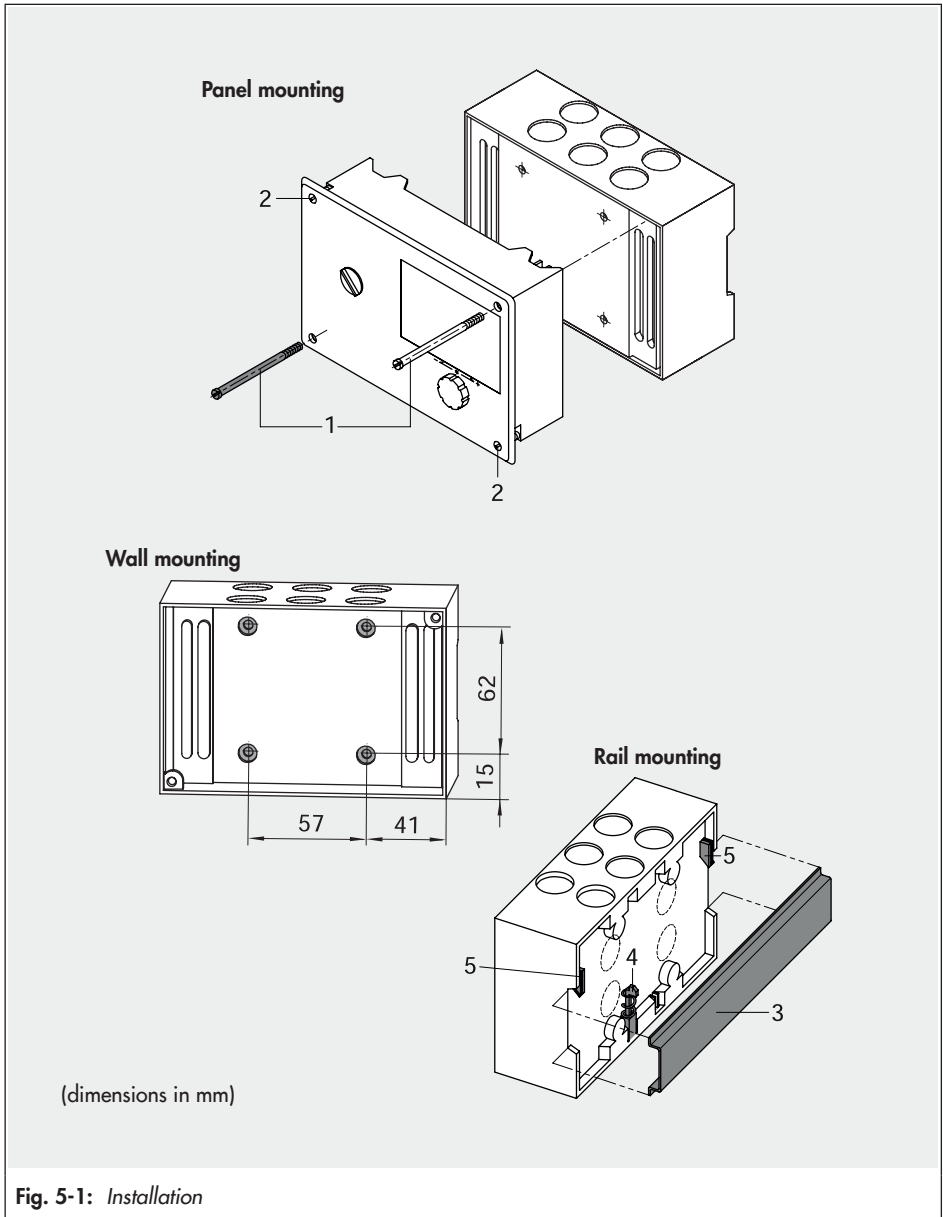


Fig. 5-1: Installation

3. Pull apart the controller housing and the base.
4. Perform electric wiring on the base as described in section 5.4.
5. Remount the controller housing.
6. Tighten the two screws (1).

5.4 Electrical connection

⚠ DANGER

Risk of fatal injury due to electric shock.

- For wiring and connecting the controller, observe the relevant electrotechnical regulations of the country of use as well as the regulations of the local power suppliers. Therefore, such work must be performed by trained and experienced personnel.
- The terminals 33, 39, 42 and 45 allow the integration of safety equipment which have a direct influence on individual electric actuators and pumps. If this is not the case, connect a jumper from terminal 31 to terminals 33, 39, 42 and 45.
- Do not connect ELV cables (according to VDE 0100) to these terminals.
- Before performing any work on the terminals, disconnect the voltage supply from the controller.

Notes on electric wiring

- Install the 230 V power supply lines and the signal lines separately and away from each other.
- To increase immunity, keep a minimum distance of 10 cm between the lines. Make sure the minimum distance is also kept when the lines are installed in a cabinet.
- Install the lines for digital signals (bus lines) and analog signals (sensor lines, analog outputs) separately and away from each other.
- In plants with a high electromagnetic noise level, we recommend using shielded cables for the analog signals.
- Ground the shield at one side, either at the control cabinet inlet or outlet, using the largest possible cross-section. Connect the central grounding point and the PE grounding conductor with a cable with at least 10 mm² wire cross-section using the shortest route.
- Inductances in the control cabinet, e.g. contactor coils, must be equipped with suitable interference suppressors (RC elements).
- Shield control cabinet elements with high field strength, e.g. transformers or frequency converters, with separators providing a good connection to the PE grounding conductor.
- Use wires with wire cross-sections as listed in Table 5-1 for terminals.

Installation

Overvoltage protection

- If signal lines are installed outside buildings or over large distances, make sure appropriate surge or overvoltage protection measures are taken. Such measures are indispensable for bus lines.
- The shield of signal lines installed outside buildings must have current conducting capacity and must be grounded on both sides.
- Surge diverters must be installed at the control cabinet inlet.

Connecting the controller

- If the controller housing and the base have not yet been separated: unscrew the screws on the bottom left and top right of the housing to open it to connect the wiring.
- To feed through cables, make holes in the marked locations at the top, bottom or back of the base of the housing and fit suitable grommets or cable glands.
- For wall mounting: ensure that the lines are not subject to torsion or bending by taking suitable precautions, e.g. a cable duct, before inserting them into the base.
- Connect the wiring as shown in Fig. 5-2 (TROVIS 5578-1113) or Fig. 5-3 (TROVIS 5578-1114).

Connecting sensors

The wire cross-section of the sensor cables must not be smaller than 0.5 mm².

Wiring of a room panel

- Connect as shown in Fig. 5-4.

Connecting the water flow sensor

- Connect as shown in Fig. 5-5.

Connecting actuators

- 0 to 10 V control output: use cables with a minimum wire cross-section of 0.5 mm².
- Three-step or on/off outputs: connect cables with a minimum wire cross-section of 1.5 mm² suitable for damp locations to the terminals of the controller output. We recommend checking the operating direction on start-up.

Connecting pumps

Connect all cables with at least a 1.5 mm² wire cross-section to the terminals of the controller as illustrated in the wiring diagram.

i Note

The electric actuators and pumps are not automatically supplied with a voltage by the controller. They can be connected over terminals 33, 39, 42 and 45 to an external voltage supply. For an internal power supply, place a jumper from terminal 31 to terminals 33, 39, 42 and 45.

⚠ DANGER

Risk of fatal injury as a result of failing to observe the permissible touch voltage.

Separation of the circuits is absolutely essential when SELV equipment is connected to terminals 33, 39, 42 and 45 as this equipment has a different intended use of the supply voltage than specified in the technical data (230 V AC).

The creepage and clearance present in the base and controller do not guarantee the required dielectric strength and the safe separation of the 230 V supply voltage and the other circuits.

- Take appropriate safety precautions (e.g. by using coupling relays for the control of electric actuators operated with 24 V or for ELV fault signaling contacts).*
 - Only connect 230 V equipment.*
-

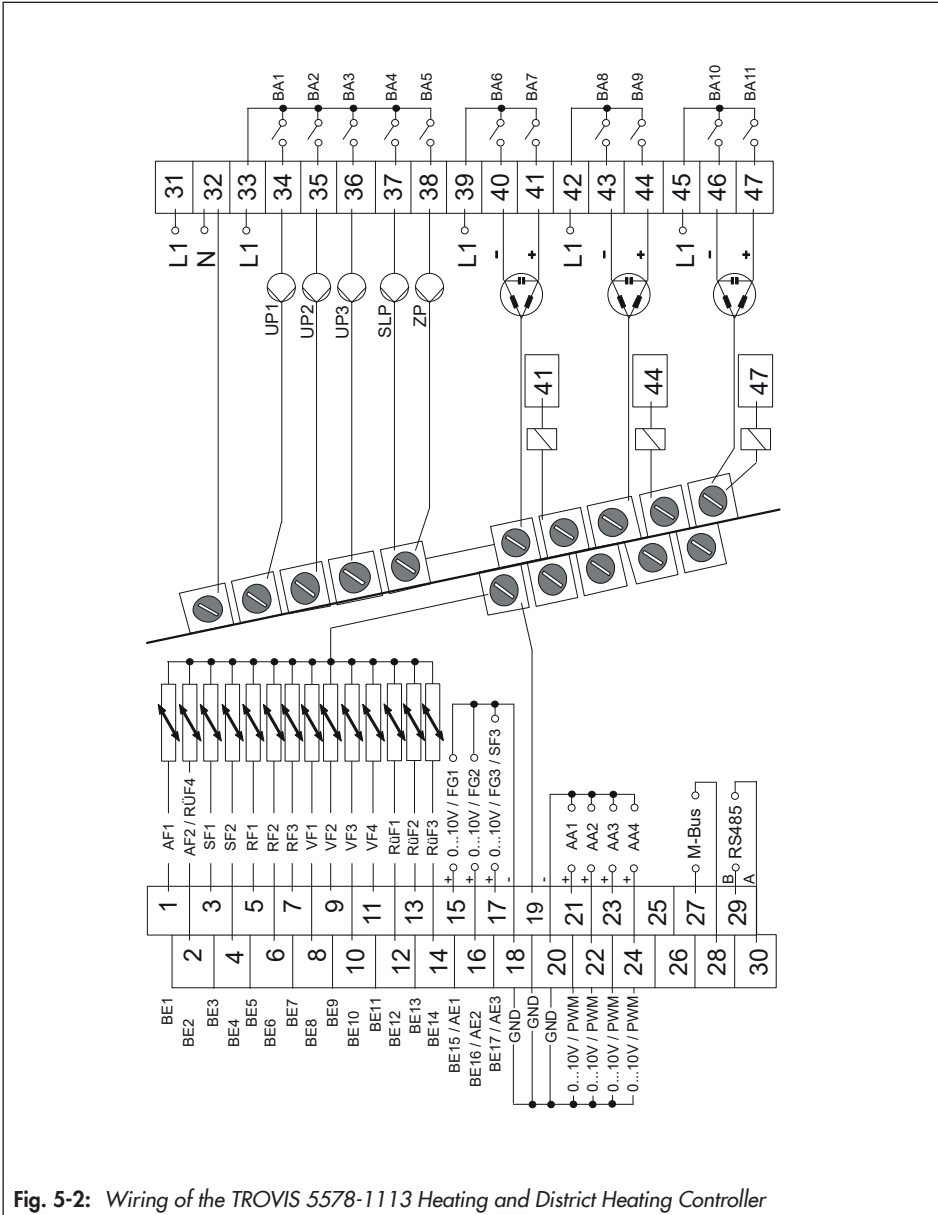


Fig. 5-2: Wiring of the TROVIS 5578-1113 Heating and District Heating Controller

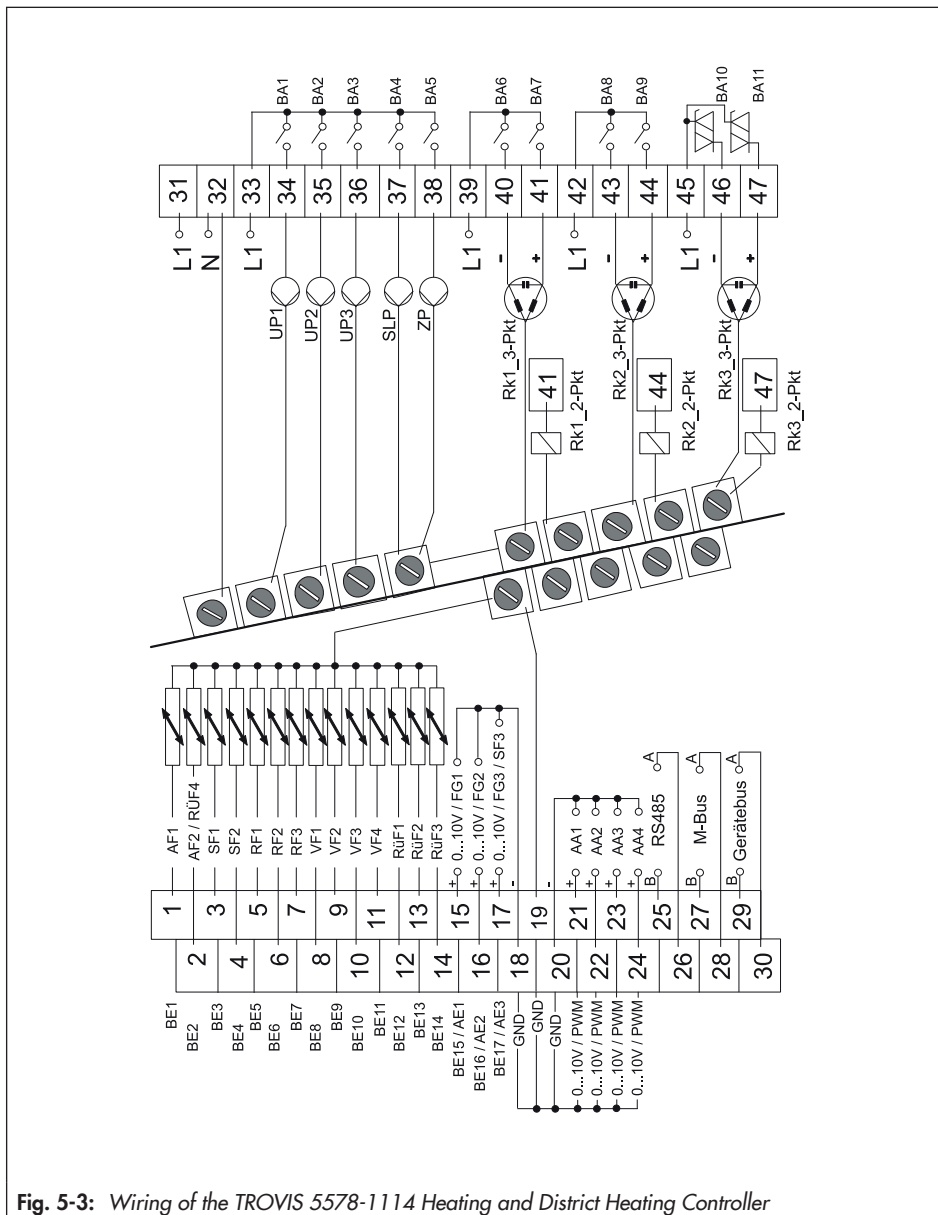
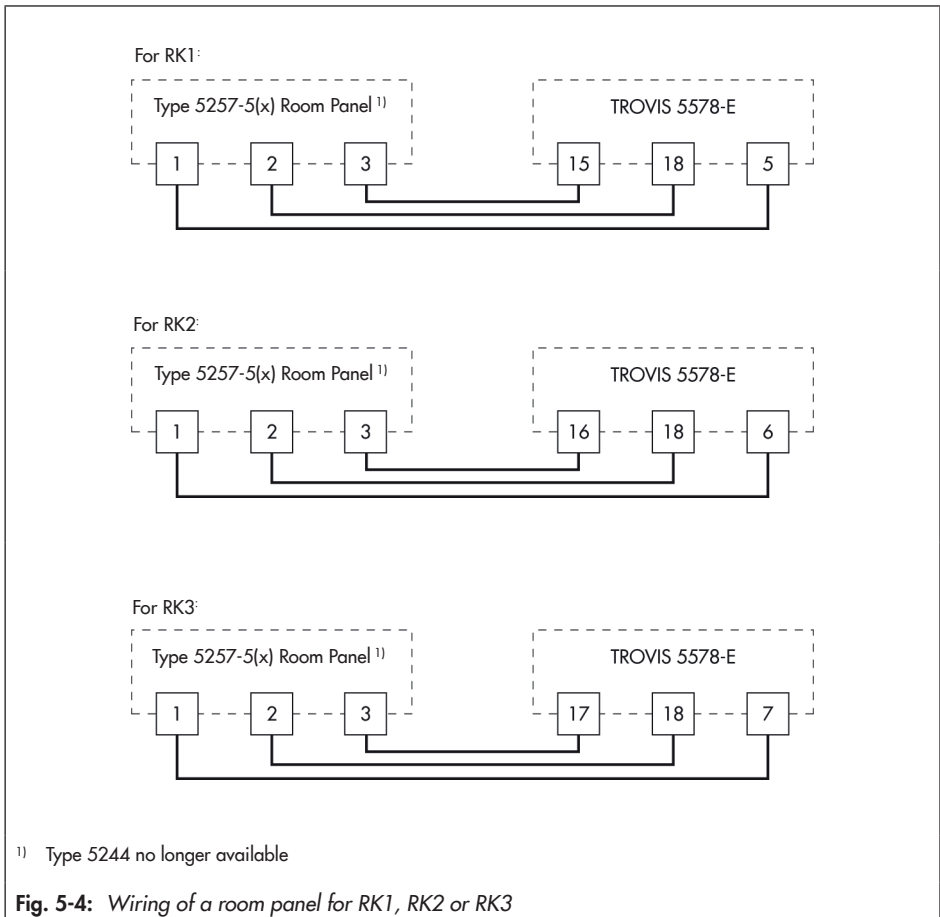


Fig. 5-3: Wiring of the TROVIS 5578-1114 Heating and District Heating Controller

Installation

Legend for Fig. 5-2:

| | | | | | |
|----|----------------|-----|------------------------|-----|----------------------------|
| AA | Analog output | PWM | Pulse width modulation | SLP | Storage tank charging pump |
| AE | Analog input | RF | Room sensor | UP | Circulation pump (heating) |
| AF | Outdoor sensor | RK | Control circuit | VF | Flow sensor |
| BA | Binary output | RüF | Return flow sensor | ZP | Circulation pump (DHW) |
| BE | Binary input | SF | Storage tank sensor | | |
| FG | Potentiometer | | | | |



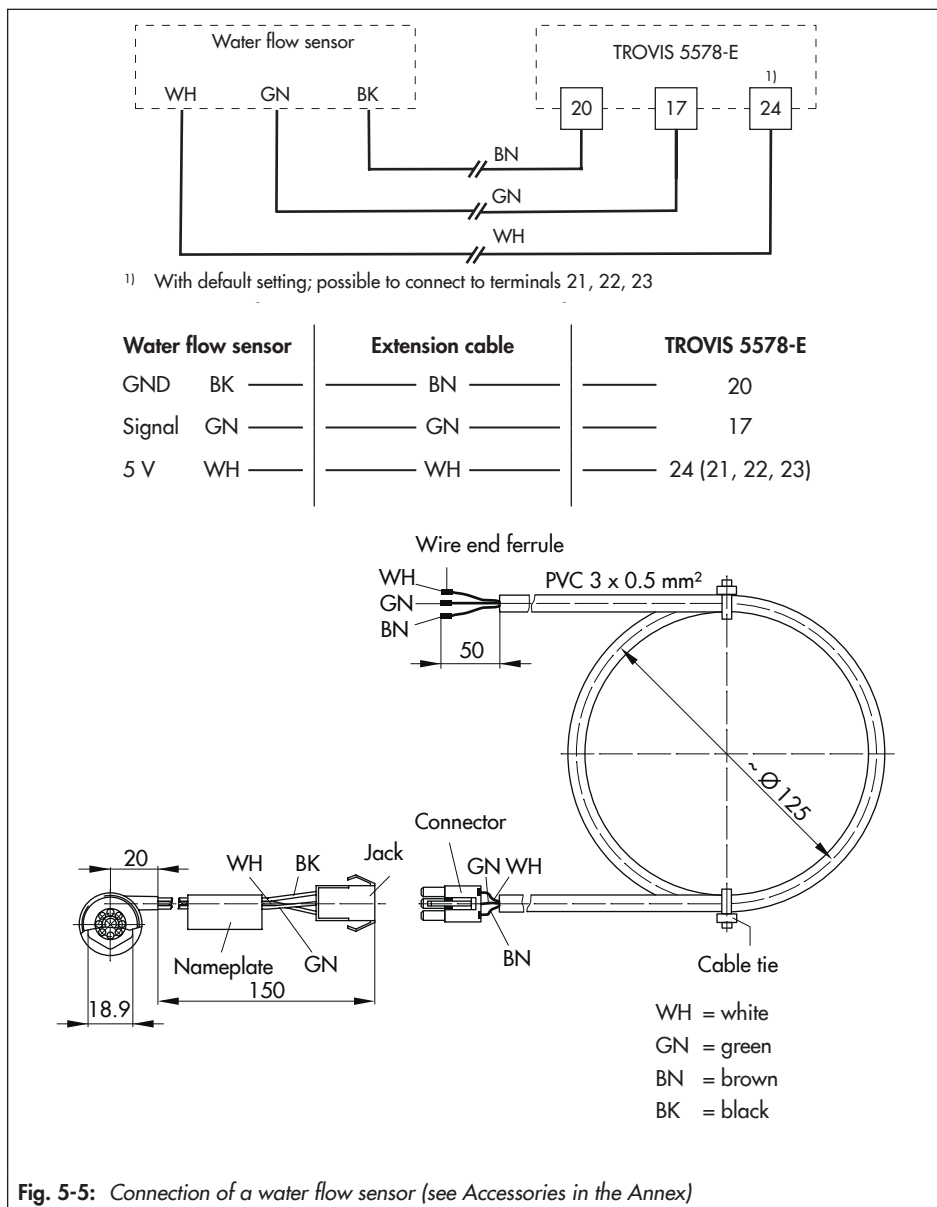


Fig. 5-5: Connection of a water flow sensor (see Accessories in the Annex)

NOTICE

A flow rate measurement is not performed when the wrong model of the water flow sensor is used.

→ Only use the sensor model specified in the Annex.

Table 5-1: *Permissible wire cross-section for terminals*

| Cable | Wire cross-section |
|-------------|---------------------------|
| Single-wire | 0.33 to 2 mm ² |
| Multi-wire | 0.33 to 2 mm ² |

Length of insulation to be stripped off wire ends: 6 mm


6 Operation

The controller is operated on site using the operating controls on the front.

6.1 Operating controls

The operating controls are located in the front panel of the heating controller.


Rotary pushbutton




- Turn [↻]:
Select readings, parameters and function blocks
- Press [*]:
Confirm adjusted selection or settings

Rotary switch

The rotary switch is used to set the operating mode and the relevant parameters for each control circuit.



- Operating level
- Operating modes
- Manual level



- Day set point (rated room temperature)
- Night set point (reduced room temperature)
- Times-of-use for heating/DHW
- Special time-of-use
- Time/date
- Settings

6.2 Interfaces

6.2.1 RS-485 interfaces for Modbus-RTU and device bus communication

TROVIS 5578-1113 is fitted with a galvanically isolated RS-485 interface that is suitable for the following connection options:

- Device bus communication for connection of up to 32 bus devices
- Modbus RTU communication with a control system
- Modbus RTU communication for connection of a SAM MOBILE Gateway to access the SAM DISTRICT ENERGY web application
- Multiplex mode (Modbus TCP/IP access to the bus devices connected to the RS-485 interface that can also be operate using device bus communication)

TROVIS 5578-1114 is fitted with two galvanically isolated RS-485 interfaces for separate Modbus RTU and device bus communication.

6.2.2 Ethernet interface for Modbus-TCP/IP communication

- Modbus-TCP/IP communication with a control system
- Communication the SAM DISTRICT ENERGY web application without the use of a communication gateway: the MAC address of the heating controller is used to register it (specified on the controller housing, starting with **00:E0:99:Fx:xx:xx**). For reasons of data security, the heating controller must be registered in the web portal within six hours after the controller has been started. Restarting the heating controller resets this time and allows the controller to be registered after a timeout.

6.2.3 M-bus interface

Data transmission of up to three meters according to EN 1434-3. See Annex A (configuration instructions).

6.3 Accessories

| | |
|---|--|
| TROVIS I/O (expansion module) | Order no. 100062999 |
| TROVIS-VIEW software (free of charge) | ▶ www.samsunggroup.com > SERVICE & SUPPORT > Downloads > TROVIS-VIEW |
| Surge arrester SA 5000 | Order no. 1400-9868 |
| ▶ SAM MOBILE Gateway for communication using unlicensed radio frequency bands | Type 5655 |

7 Start-up and configuration

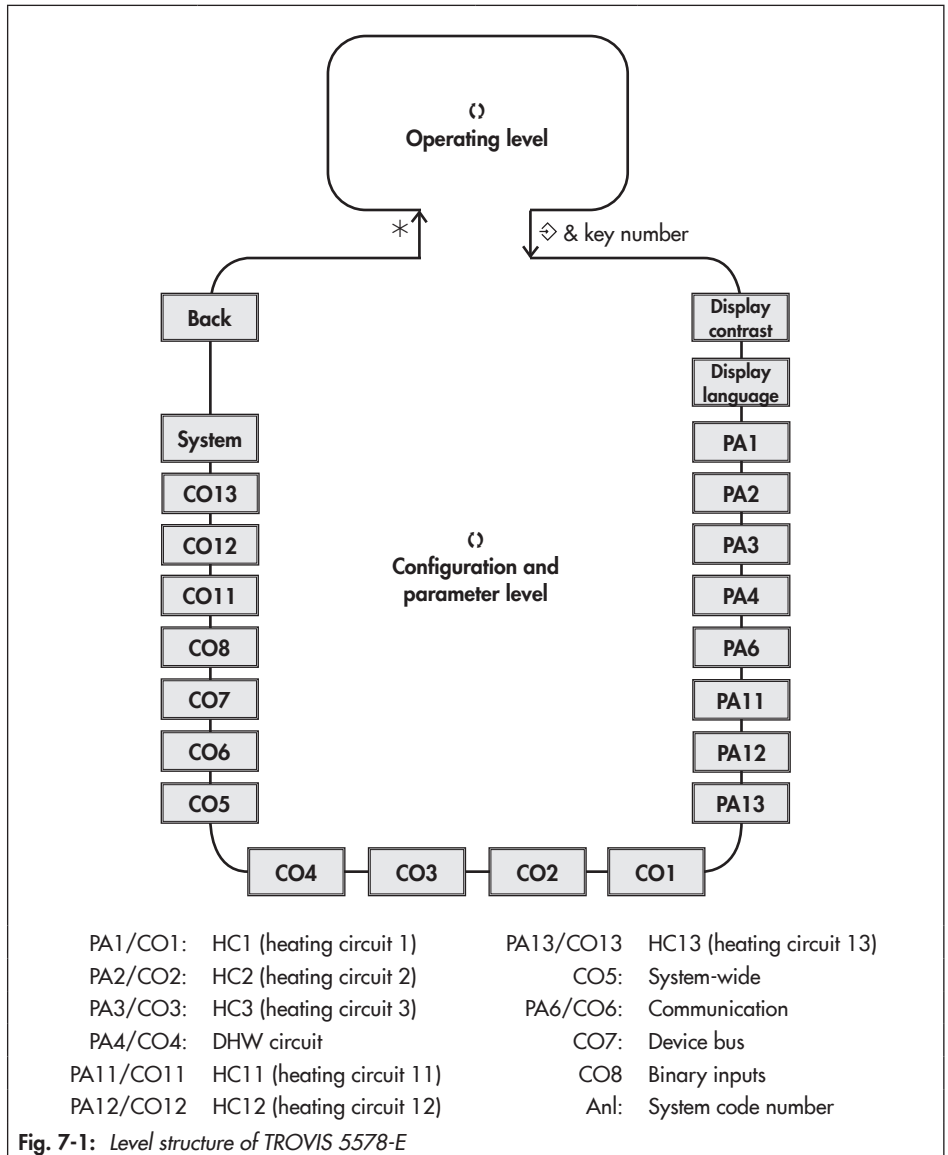


Fig. 7-1: Level structure of TROVIS 5578-E

Start-up and configuration

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

Before start-up, make sure the following conditions are met:

- The heating controller is properly mounted according to the instructions.
- The electrical connection is properly performed.

The heating controller is adapted to its control task by performing start-up. Start-up usually involves performing several steps:

1. Change the contrast of the display to adapt it to the installation conditions (see section 7.1).
2. Change the display language as required for the operating personnel (see section 7.2).
3. Select the hydraulic system (see section 7.3).
4. Change functions and parameters to adapt the system (see sections 7.4 and 7.5).
5. Calibrate the sensors (see section 7.6).

The settings during start-up can only be performed after the valid key number has been entered.

The valid key number for first start-up can be found at the back of these mounting and operating instructions. To avoid unauthorized use of the service key number, remove the page or make the key number unreadable. In addition, it is possible to enter a new, customized key number (see section 7.7).

7.1 Altering the display contrast

The contrast of the display can be changed to adapt it to the installation conditions.

| Settings | |
|-----------------------------|---------|
| Display contrast | 50 |
| Display language | English |
| PA1 | |
| PA4 | |
| Contrast setting of display | |

Turn the rotary switch to \diamond (settings).

↵ Enter the currently valid key number.

* Confirm key number.

↵ Select 'Display contrast'.

* Activate editing mode for the display contrast.

The current setting is shown inverted on the display.

↵ Set the display contrast

* Confirm setting.

Turn the rotary switch back to \square (operating level).

7.2 Changing the display language

The default display language is German. After additional language files have been downloaded onto the controller, the display language can be changed as follows:

| Settings | |
|----------------------------|---------|
| Display contrast | 50 |
| Display language | English |
| PA1 | |
| PA4 | |
| Open display language menu | |

Turn the rotary switch to \diamond (settings).

↵ Enter the currently valid key number.

* Confirm key number.

↵ Select 'Display language'.

* Activate editing mode for the language setting.

The currently valid language is selected.


↵ Change the language setting accordingly.

* Confirm setting.

Turn the rotary switch back to \square (operating level).


7.3 Setting the system code number

Different hydraulic schematics are available. Each hydraulic schematic is represented by a system code number. The systems together with their ready-configured functions are shown in Annex A (configuration instructions). A system is adapted to individual requirements by setting the functions and parameters. Changing the system code number resets previously adjusted function blocks to their default settings (WE). Function block parameters and parameter level settings remain unchanged. The system code number is set in the configuration and parameter level.




Turn the rotary switch to \diamond (settings).

- ⌂ Enter the currently valid key number.
- * Confirm key number.



- ⌂ Select 'System'.
- * Open 'System'.



- ⌂ Select the required system (see Annex A).

| Settings | |
|-------------------------|--------------|
| CO7 | □□□□□□□□□□□□ |
| CO8 | □□□□□□□□□□□□ |
| System | 2.1 |
| Back | |
| Select hydraulic scheme | |

- * Confirm the system selected.
 - ↻ Select 'Back'.
 - * Exit menu.
- Turn the rotary switch to ↻ (settings).

7.4 Activating and deactivating functions

A function is activated or deactivated in the associated function block. Annex A (configuration instructions) contains a detailed description of all functions.

| Key number |
|------------|
| 0000 |

- Turn the rotary switch to ↻ (settings).
- ↻ Enter the currently valid key number.
 - * Confirm key number.

| Settings | |
|----------------------------|------------|
| Display language | English |
| PA1 | |
| PA6 | |
| CO1 | □□■□□□□□□□ |
| | ■□□□□□□□□□ |
| Configuration of first hea | |

- ↻ Select the required configuration level:
 - CO1: Heating circuit HC1
 - CO2: Heating circuit HC2
 - CO3: Heating circuit HC3
 - CO11: Heating circuit HC11
 - CO12: Heating circuit HC12
 - CO13: Heating circuit HC13
 - CO4: DHW heating
 - CO5: System-wide functions
 - CO6: Modbus communication

Active function blocks are indicated by the black squares.

- ➔ Only those configuration levels are available for selection which can be controlled by the selected system.

| | |
|------------------------|------------------|
| CO1 | ▣▣▣▣▣▣▣▣▣▣▣▣▣▣▣▣ |
| F01 Room sensor | 0 |
| F02 Outdoor sensor | 1 |
| F03 Return flow sensor | 1 |
| F04 Cooling control | 0 |
| Room sensor RF1 | |

| | |
|---------------------------|------------------|
| CO1 | ▣▣▣▣▣▣▣▣▣▣▣▣▣▣▣▣ |
| F05 Underfloor heating | |
| F05 | 1 |
| Start temperature | 25.0°C |
| Hold (days) | 0 |
| Underfloor heating/drying | |

| | |
|-----------------------|------------------|
| CO1 | ▣▣▣▣▣▣▣▣▣▣▣▣▣▣▣▣ |
| F17 Binary demand | 0 |
| F18 Requesting demand | 0 |
| F20 Ext. heat demand | 0 |
| Back | |
| Exit menu | |

- * Open configuration level.
The first function block is selected (marked gray).

⌚ Select the required function.

Functions without function block parameters:

- * Activate editing mode for the function.
The currently active configuration '0' or '1' is shown inverted on the display.
- ⌚ Activate function (1) or deactivate function (0).
- * Confirm configuration.

Functions with function block parameters:

- * Open function.
- ⌚ Select configuration.
- * Activate editing mode for configuration.
The currently active configuration '0' or '1' is shown inverted on the display.
- ⌚ Activate function (1) or deactivate function (0).
- * Confirm configuration.
- ⌚ Select function block parameter.
- * Activate editing mode for function block parameter.
The current setting is shown inverted on the display.
- ⌚ Set function block parameter.

Proceed in the same manner to set further function blocks.

Exit configuration level:

- ⌚ Select 'Back'.
- ⌚ Exit configuration level.

To adjust further function blocks in other configuration levels, repeat steps with gray background.

Turn the rotary switch back to  (operating level).

i Note

All function block settings are saved in a non-volatile memory in the heating controller.

7.5 Changing parameters

Depending on the system code number selected and the activated functions, not all parameters might be available. Annex A (configuration instructions) contains a detailed description of all parameters.

| Key number |
|------------|
| 0000 |

Turn the rotary switch to \diamond (settings).





- ⌂ Enter the currently valid key number.
- * Confirm key number.

| Settings |
|---------------------------|
| Display contrast 50 |
| Display language English |
| PA1 |
| PA6 |
| Parameterization of first |

⌂ Select the required parameter level.

- PA1: Heating circuit HC1
- PA2: Heating circuit HC2
- PA3: Heating circuit HC3
- PA11: Heating circuit HC11
- PA12: Heating circuit HC12
- PA13: Heating circuit HC13
- PA4: Domestic hot water heating (DHW)
- PA5: Boiler circuit of buffer tank systems
- PA6: Modbus communication




➔ Only those parameter levels are available for selection which can be controlled by the selected system.

| PA1 | |
|---|--------|
| P01  | 1.0 |
| P02  | 0.0°C |
| P06  | 20.0°C |
| P07  | 50.0°C |
| Flow gradient | |

- * Open parameter level.
The first parameter is selected (marked gray).

- ⌚ Select parameter.
- * Activate editing mode for the parameter.
The current setting is shown inverted on the display.

- ⌚ Set the parameter.
- * Confirm setting.
- * Proceed in the same manner to change further parameters.

| PA1 | |
|---|--------|
| P12  | 0.0°C |
| P13  | 65.0°C |
| P14  | 65.0°C |
| Back | |
| Exit menu | |

Exit parameter level.

- ⌚ Select 'Back'.
- ⌚ Exit configuration level.

To adjust further function blocks in other configuration levels, repeat steps with gray background.

Turn the rotary switch back to  (operating level).

Note

All parameter settings are saved in a non-volatile memory in the heating controller.

7.6 Calibrating sensors

Various temperatures are measured by temperature sensors which are connected to the heating controller. The controller is designed for connection of Pt1000, PTC and Ni1000 sensors.


- CO5 -> F01 - 1, F02 - 0: Pt 1000
- CO5 -> F01 - 0, F02 - 0: PTC
- CO5 -> F01 - 1, F02 - 1: Ni 1000

See Annex A (configuration instructions) for resistance values.

If the temperature values displayed at the heating controller differ from the actual temperatures, the measured values of all connected sensors can be recalibrated. To calibrate a sensor, the currently displayed sensor value must be changed such that it matches the temperature (reference temperature) measured directly at the point of measurement. Sensor calibra-


tion is activated in CO5 in F20 function block.

An incorrect sensor calibration can be deleted by setting F20 - 0.




Turn the rotary switch to \diamond (settings).


- ⌂ Enter the currently valid key number.
- * Confirm key number.



- * Select CO5 configuration level.
- * Open CO5 configuration level.
- * Select function block F20.
- * Activate editing mode for F20 function block.




- ⌂ Select F20 configuration.
- * Activate editing mode for configuration.
The currently active configuration '0' or '1' is shown inverted on the display.
- ⌂ Activate function block ('1').
- * Confirm activation.





- * Select the temperature that you want to calibrate.
- * Open calibration.
The temperature is shown inverted on the display.
- * Correct measured value.
Read the actual temperature directly from the thermometer at the point of measurement and enter this value as the reference temperature.
- * Confirm corrected measured value.
- * Proceed in the same manner to calibrate further sensors.


7.7 Entering customized key number

To prevent the function and parameter settings being changed by unauthorized users, a customized key number can be added to the fixed service key number. You can set the customized key number to be between 0100 and 1900.



Turn the rotary switch to  (settings).

-  Enter key number 1995.
- * Confirm key number.
-  Enter valid key number.
- * Confirm key number.

-  Enter customized key number.
- * Confirm customized key number.

This number is the new key number.

Turn the rotary switch back to  (operating level).

8 Setup

8.1 Selecting the operating mode

The heating controller can be operated in the following modes:

Day mode (rated operation): regardless of the programmed times-of-use and summer mode, the set points relevant for rated operation are used by the controller. Icon: ※※


Night mode (reduced operation): regardless of the programmed times-of-use, the set points relevant for reduced operation are used by the controller. Icon:))

Control operation deactivated: regardless of the programmed times-of-use, control operation of the heating circuits and DHW heating remains deactivated. The frost protection is activated, if need be. Icon: ☽☽

Icons when the frost protection is activated: HC ☽) , DHW ☽ ※

Automatic mode: During the programmed times-of-use, the controller works in day mode. Outside these times-of-use, the controller is in night mode, unless control operation is deactivated depending on the outdoor temperature. The heating controller switches automatically between both operating modes. Icon within the times-of-use: ☽※, icon outside the times-of-use: ☽)

Manual mode: valves and pumps can be controlled manually. For further details, see section 8.6.




Turn the rotary switch to ☽☽ (operating modes). The operating states of all system control circuits are displayed:

- Heating circuit HC1
- Heating circuit HC2
- Heating circuit HC3
- Heating circuit HC11
- Heating circuit HC12
- Heating circuit HC13
- DHW heating

➔ Only those control circuits are available for selection which can be controlled by the selected system.





☽ Select the control circuit.


Setup



* Activate editing mode for the control circuit. The operating mode is shown inverted on the display.

② Select the operating mode:

-  Automatic mode
-  Day mode
-  Night mode
-  System deactivated



* Confirm the operating mode.

The heating controller is usually in automatic mode.

8.2 Schedules

The controller operates according to the schedules in automatic mode.

8.2.1 Setting the time and date

The current time and date need to be set immediately after start-up and after a power failure lasting more than 24 hours. This is the case when the time blinks on the display.

| Time/date | |
|-----------------|--------|
| Time | 08:23 |
| Date (dd.mm.) | 21.01. |
| Year | 2015 |
| Auto summertime | ON |

Turn the rotary switch to \odot (time/date). The current time is selected (gray background).

| Time/date | |
|-----------------|--------|
| Time | 08:23 |
| Date (dd.mm.) | 21.01. |
| Year | 2015 |
| Auto summertime | ON |

* Activate editing mode for the time. The time reading is inverted.

\odot Change the time.

* Confirm the time setting.

| Time/date | |
|-----------------|--------|
| Time | 08:44 |
| Date (dd.mm.) | 21.01. |
| Year | 2015 |
| Auto summertime | ON |

\odot Select 'Date' (dd.mm) [\odot].

| Time/date | |
|-----------------|--------|
| Time | 08:44 |
| Date (dd.mm.) | 21.01. |
| Year | 2015 |
| Auto summertime | ON |

* Activate editing mode for the date. The date reading is inverted.

\odot Change date (day.month).

* Confirm the date setting.

| Time/date | |
|-----------------|--------|
| Time | 08:45 |
| Date (dd.mm.) | 05.02. |
| Year | 2010 |
| Auto summertime | ON |

⌚ Select 'Year'.

| Time/date | |
|-----------------|--------|
| Time | 08:45 |
| Date (dd.mm.) | 05.02. |
| Year | 2010 |
| Auto summertime | ON |

- * Activate editing mode for the year. The year reading is inverted.
- ⌚ Change the year.
- * Confirm the year setting.

Deactivate or activate the automatic summer/standard time switchover as required.

| Time/date | |
|-----------------|--------|
| Time | 08:45 |
| Date (dd.mm.) | 05.02. |
| Year | 2015 |
| Auto summertime | ON |

⌚ Select 'Auto summertime'.

| Time/date | |
|-----------------|--------|
| Time | 08:45 |
| Date (dd.mm.) | 05.02. |
| Year | 2015 |
| Auto summertime | ON |

- * Activate the editing mode for automatic summer/standard time switchover. The current setting is shown inverted on the display:
ON = Summer/standard time switchover active
OFF = Summer/standard time switchover not active
- ⌚ Deactivate or activate the automatic summer/standard time switchover.
- * Confirm deactivation/activation.

Turn the rotary switch back to  (operating level).


i Note


The correct time is guaranteed after a power failure of 24 hours. Normally, the correct time is still retained at least 48 hours after a power failure.

8.2.2 Setting the times-of-use

Three times-of-use can be set for each day of the week.

| Parameters | WE | Value range |
|--------------------------|------------------------------------|-------------|
| | HC1, HC2, HC3, HC11, HC12, HC13 | DHW, CP |
| Start first time-of-use | 06:00 | 00:00 |
| Stop first time-of-use | 22:00 | 24:00 |
| Start second time-of-use | --:-- | --:-- |
| Stop second time-of-use | --:-- | --:-- |
| Start third time-of-use | --:-- | --:-- |
| Stop third time-of-use | --:-- | --:-- |




Turn the rotary switch to  (times-of-use). The first control circuit is displayed together with its programmed times-of-use.

ⓘ Program the times-of-use of another control circuit, if required:


- Heating circuit HC2
- Heating circuit HC3
- Heating circuit HC11
- Heating circuit HC12
- Heating circuit HC13
- DHW heating
- Circulation pump ZP

➔ Only those control circuits are available for selection which can be controlled by the selected system.


* Activate editing mode for the control circuit. The times-of-use for Monday are displayed.



Setup



- ⌂ Select period/day for which the times-of-use are to be valid. The times-of-use can be programmed for individual days or for a block of days, e.g. Monday to Friday, Saturday and Sunday or Monday to Sunday. The selected days are shown inverted on the display.




- * Activate editing mode for the period/day.
The start time of the first time-of-use period can now be edited (inverted reading).

- ⌂ Change start time.
(in steps of 15 minutes)

- * Confirm the start time.
The stop time of the first time-of-use period can now be edited.

- ⌂ End stop time.
(in steps of 15 minutes)

- * Confirm the stop time.
The start time of the second time-of-use period can now be edited.




To set the second and third times-of-use periods, repeat steps with gray background. If no further times-of-use are to be programmed for the selected time period/day, exit the menu by confirming the indicated start time twice (2x *).

Proceed in the same manner to program further periods/days.

After setting all times-of-use:

- ⌂ Select 'Back'.
- * Exit the times-of-use setting.

Turn the rotary switch back to (operating level).



8.2.3 Setting the party timer (special time-of-use)

Rated operation in the corresponding control circuit (HC1, HC2, HC3 or DHW) is started or continued for the time period set in the party mode. When the party timer has elapsed, the party timer returns to --:--.

| Parameters | WE | Value range |
|-----------------|---------|-----------------------------------|
| HC1 party timer | --:-- h | 0 to 48 h; in steps of 15 minutes |
| HC2 party timer | --:-- h | 0 to 48 h; in steps of 15 minutes |
| HC3 party timer | --:-- h | 0 to 48 h; in steps of 15 minutes |
| DHW party timer | --:-- h | 0 to 48 h; in steps of 15 minutes |

| Special use | |
|-----------------|--------------------|
| HC1 Party timer | --:-- h |
| DHW Party timer | --:-- h |
| Public holidays | ---- |
| Vacations | --:-- . - - - : -- |

Turn the rotary switch to **⌘** (special times-of-use). The party timer for the first control circuit is now selected.

- ⊗ Set time for party mode of another control circuit, if required:
 - Heating circuit HC2
 - Heating circuit HC3
 - DHW heating

➔ Only those control circuits are available for selection which can be controlled by the selected system.

- * Activate editing mode for the party timer. The party timer is now in the editing mode (inverted display).
- ⊗ Extend day operation as required. (in steps of 15 minutes)

| Special use | |
|-----------------|--------------------|
| HC1 Party timer | --:-- h |
| DHW Party timer | --:-- h |
| Public holidays | ---- |
| Vacations | --:-- . - - - : -- |

- * Confirm setting.

| Special use | |
|-----------------|--------------------|
| HC1 Party timer | 02:00 h |
| DHW Party timer | --:-- h |
| Public holidays | ---- |
| Vacations | --:-- . - - - : -- |

After setting the party timer:

Turn the rotary switch back to **⊞** (operating level).

i Note

Party timer runs down in steps of 15 minutes.

8.2.4 Programming public holidays (special times-of-use)

On public holidays, the times-of-use specified for Sunday apply.

A maximum of 20 public holidays may be entered.

| Parameters | WE | Value range |
|-----------------|-------|----------------|
| Public holidays | --:-- | 01.01 to 31.12 |

| Special use | |
|-----------------|-----------------|
| HC1 Party timer | --:-- h |
| DHW Party timer | --:-- h |
| Public holidays | ---- |
| Vacations | ---.---.---.--- |

Turn the rotary switch to **#** (special times-of-use). The party timer for the first control circuit is now selected.

- ⌚ Select 'Public holidays'.

| Public holidays | |
|-----------------|---------|
| | ---.--- |
| Back | |

- * Start the public holiday setting. The first public holiday setting is now selected. --:-- is displayed if no public holidays (default setting) have been programmed.

- ⌚ Select --:--, if applicable.

| Public holidays | |
|-----------------|---------|
| | ---.--- |
| Back | |

- * Activate editing mode for public holidays.

- ⌚ Set the date of the public holiday.

- * Confirm the date.

Proceed in the same manner to program further public holidays.

Deleting a public holiday:

- ⌚ Select the holiday you wish to delete.

- * Confirm the date.

- ⌚ Select '---:--' setting

- * Confirm setting.

The public holiday is deleted.

| Public holidays | |
|-----------------|---------|
| | 01.01. |
| | ---.--- |
| Back | |

After programming all public holidays:

↶ Select 'Back'.

* Exit the public holiday setting.

Turn the rotary switch back to  (operating level).

i Note

Public holidays that are not assigned to a specific date should be deleted by the end of the year so that they are not carried on into the following year.

8.2.5 Programming vacation periods (special times-of-use)


The system runs constantly in reduced mode during vacation periods. A maximum of ten vacation periods can be entered. Each vacation period can be separately assigned to the heating circuits HC1, HC2, HC3 and DHW circuit or to all control circuits.

i Note


If a vacation period is programmed to apply to all control circuits, it also applies to control circuits HC11, HC12 and HC13.

| Parameters | WE | Value range |
|-----------------|-----------|----------------|
| Vacation period | --- - --- | 01.01 to 31.12 |

| Special use | |
|-----------------|-----------------|
| HC1 Party timer | ---:-- h |
| DHW Party timer | ---:-- h |
| Public holidays | ---- |
| Vacations | ---.---.---.--- |


Turn the rotary switch to  (special times-of-use). The party timer for the first control circuit is now selected.

↶ Select 'Vacations'.



* Start the vacations setting. The first vacations setting is now selected. --.-- --.-- is displayed if no vacations (default setting) have been programmed.

⌂ Select --.-- --.--.



⌂ Activate editing mode for vacations.


The start date can now be edited (inverted reading).

⌂ Set the start date.

⌂ Confirm the start date.

The end date can now be edited.

⌂ Set the end date.



⌂ Confirm the year setting. 'All' is selected. The vacation period then applies to all control circuits.

⌂ If the vacation period is to be only valid for one control circuit, select the required control circuit:

- Heating circuit HC1
- Heating circuit HC2
- Heating circuit HC3
- DHW heating

➔ Only those control circuits are available for selection which can be controlled by the selected system.

The control circuits HC11, HC12 and HC13 are not available.

* Confirm the control circuit.

i Note

An active vacation period is indicated on the display by the ➤ icon.

Proceed in the same manner to program further vacations.

Deleting vacation periods:

- ⌂ Select the start date of the period you wish to delete.
- * Confirm vacation period.
- ⌂ Select --.-- - --.--.
- * Confirm setting.
The vacation period is deleted.

| Vacations | |
|------------------|----------------------------------|
| All | 01.01. - 06.01. --.-- - --.-- |
| Back | |

After programming all vacation periods:

- ⌂ Select 'Back'.
- * Exit the vacations setting.

Turn the rotary switch back to  (operating level).

i Note

Vacations should be deleted by the end of the year so that they are not carried on into the following year.

8.3 Entering day and night set points

The day and night set points can be programmed for each control circuit as well as the deactivation values based on the outdoor temperature.

i Note

When the four-point characteristic mode without room sensor and optimizing mode or flash adaptation is used, it is not possible to adjust the set points for room temperature.

The associated heating circuit is immediately switched off when the outdoor temperature exceeds the limit 'OT deactivation value in rated operation'. The valve is closed and the pump is switched off after $t = 2 \times$ Valve transit time. The heating is immediately switched on again when the outdoor temperature falls below the limit (minus 0.5 °C hysteresis). The default setting causes the system to be switched off during warm weather at an outdoor temperature of 22 °C.

Setup

The associated heating circuit is immediately switched off when the outdoor temperature exceeds the limit 'OT deactivation value in reduced operation'. The valve is closed and the pump is switched off after $t = 2 \times$ Valve transit time. The heating is immediately switched on again when the outdoor temperature falls below the limit (minus 0.5 °C hysteresis).

The default setting causes the system to be switched off at night time at an outdoor temperature of 15 °C to save energy. However, be aware when this setting is used that the system takes awhile in the morning to warm up the building.

Switch position ↓☼

| Parameters | WE | Value range |
|----------------------------|---------|------------------------------|
| HC1 room temperature | 20.0 °C | 0.0 to 40.0 °C |
| HC2 room temperature | 20.0 °C | 0.0 to 40.0 °C |
| HC3 room temperature | 20.0 °C | 0.0 to 40.0 °C |
| HC11 room temperature | 20.0 °C | 0.0 to 40.0 °C |
| HC12 room temperature | 20.0 °C | 0.0 to 40.0 °C |
| HC13 room temperature | 20.0 °C | 0.0 to 40.0 °C |
| DHW temperature | 60.0 °C | Min. to max. DHW temperature |
| HC1 OT deactivation value | 22.0 °C | 0.0 to 50.0 °C |
| HC2 OT deactivation value | 22.0 °C | 0.0 to 50.0 °C |
| HC3 OT deactivation value | 22.0 °C | 0.0 to 50.0 °C |
| HC11 OT deactivation value | 22.0 °C | 0.0 to 50.0 °C |
| HC12 OT deactivation value | 22.0 °C | 0.0 to 50.0 °C |
| HC13 OT deactivation value | 22.0 °C | 0.0 to 50.0 °C |

Switch position ↓☾



| Parameters | WE | Value range |
|---------------------------|---------|------------------------------|
| HC1 room temperature | 15.0 °C | 0.0 to 40.0 °C |
| HC2 room temperature | 15.0 °C | 0.0 to 40.0 °C |
| HC3 room temperature | 15.0 °C | 0.0 to 40.0 °C |
| HC11 room temperature | 15.0 °C | 0.0 to 40.0 °C |
| HC12 room temperature | 15.0 °C | 0.0 to 40.0 °C |
| HC13 room temperature | 15.0 °C | 0.0 to 40.0 °C |
| DHW temperature | 40.0 °C | Min. to max. DHW temperature |
| HC1 OT deactivation value | 15.0 °C | -50.0 to 50.0 °C |

Switch position 

| Parameters | WE | Value range |
|----------------------------|---------|------------------|
| HC2 OT deactivation value | 15.0 °C | -50.0 to 50.0 °C |
| HC3 OT deactivation value | 15.0 °C | -50.0 to 50.0 °C |
| HC11 OT deactivation value | 15.0 °C | -50.0 to 50.0 °C |
| HC12 OT deactivation value | 15.0 °C | -50.0 to 50.0 °C |
| HC13 OT deactivation value | 15.0 °C | -50.0 to 50.0 °C |

Day set points


| | |
|----------------|--------|
| HC1 Room temp. | 20.0°C |
| DHW DHW temp. | 60.0°C |
| HC1 OT deact. | 22.0°C |

Turn the rotary switch to * (day set point) or  (night set point). The day and night set points appear on the display one after the other.


➔ Only those day and night set points are available for selection which can be controlled by the selected system.

i Note

The deactivation values are located in a separate menu (deactivation values) for systems with three control circuits.

 Select the set point.

* Activate editing mode for set point.

 Adjust the set point.

* Confirm setting.

Proceed in the same manner to adjust further set points.

After adjusting all the set points:


Turn the rotary switch back to  (operating level).

Night set points


| | |
|-----------------|--------|
| HC1 Room temp. | 15.0°C |
| DHW DHW temp. | 40.0°C |
| HC1 OT deac. da | 15.0°C |

8.4 Reset to default settings

All parameters set over the rotary switch as well as parameters in the PA1, PA2, PA3, PA11, PA12 and PA13 parameter levels can be reset to their default settings (WE). This does not apply to the maximum flow temperature and the return flow temperature limits in PA1 and PA2.



Turn the rotary switch to  (settings).

 Enter key number 1991.

* Confirm key number.


The settings are reset to default when the following icon appears on the controller display:



8.5 Reading information

Different kinds of information can read off the heating controller display during operation. The heating controller display usually shows the date, time and an actual temperature when the rotary switch is switched to the 'Operating level' position.

Modbus-TCP/IP communication




Modbus TCP/IP connections

 Number of active Modbus TCP/IP connections


Status of connection to SAM DISTRICT ENERGY

 Connection to SAM DISTRICT ENERGY active

 Connection to SAM DISTRICT ENERGY failed



Outdoor-temperature-compensated control · Current temperature = outdoor temperature



Deactivation depending on
outdoor temperature active)




Vacations active

Fixed set point control · Current temperature = Flow temperature




Further information can be obtained by turning the rotary pushbutton:




⌚ Operating state


The following applies for heating circuits HC1, HC2, HC3, HC11, HC12 and HC13:

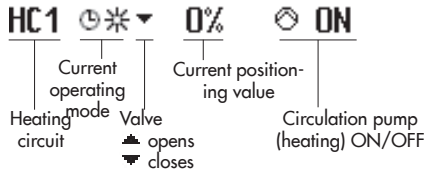

The following applies for DHW heating:

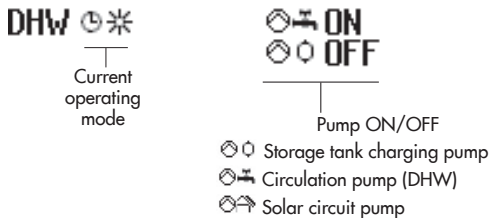

See section 8.1 for further information.




⌚ Selected system code number

See Annex A (configuration instructions) for further information.

| Anlage | 5.1/1 |
|------------|-------|
| Bedarf AE3 | 0.0°C |
| AA1 | 0 % |
| AA2 | 81 % |
| AA3 | 14 % |
| AA4 | 0 % |

- * Reading of analog output signals AA1 to AA4 as well as measured values for the entire system (e.g. measured values and limits of a flow rate or capacity limitation or the demand to be processed), if activated.



⌚ Times-of-use (depending on system code number)

- Heating circuit HC1
- Heating circuit HC2
- Heating circuit HC3
- Heating circuit HC11
- Heating circuit HC12
- Heating circuit HC13
- DHW heating

The day mode times is highlighted in black on the time chart.

Night mode and deactivation times are highlighted in gray on the time chart.

* Measured values, set points and limits of the system section shown are displayed.

| DHW Values p.1/1 | |
|-------------------------|----------------|
| Betrieb: | Zwischenheizen |
| St. tnk temp.1 | 39.3°C |
| St. tank SP 1 | 60.0°C |

The 'DHW values' page also includes information on the operating state of the DHW heating.

The following messages are generated:

- 'Standby'
- 'Monitoring'
- 'Circulation' (= circulation losses are compensated for)
- 'Demand'
- 'Charging'
- 'Lag time'
- 'Intermediate heating'
- 'Discharging protection'


| Special values | |
|-----------------------|------|
| Measured v. 13 | 0.0 |
| Measured v. 2 | 9.8 |
| Measured v. 3 | 45.8 |
| Measured v. 8 | 44.7 |
| Measured v. 9 | 61.2 |

⌚ Special values

Measured values from additional sensor inputs (not relevant for closed-loop control) or from the 0 to 10 V inputs are displayed.

| Alarm list |
|----------------------------|
| 15:45 Sensor failure |
| 28.10. Start with defaults |
| |
| 14.12.2021 15:45 - Failed |

| Event list |
|----------------------------|
| 18:04 C05-F24=0 |
| 18:01 System=4.1 |
| 18:01 HC1 Automatic |
| 17:59 HC1 Stand-by |
| 14.12.2021 18:04 - Functio |



- ⌚ Alarm list
The last four alarm entries are listed.
- * Open the alarm list and select further alarm entries (⌚).
Further information on an alarm (including time and date when it occurred) runs across the display.

- ⌚ Event list
The last four event entries are listed.
- * Open the event list and select further event entries (⌚).
Further information on an event (including time and date when it occurred) runs across the display.

- ⌚ Trend-Viewer
The standard graph shows the data measured at the outdoor sensor AF1 and flow sensor VF1 plotted over time.

Extended operating level

| Information | |
|------------------|------|
| Modbus ID | 5578 |
| Serial number | 4378 |
| Software version | 2.50 |
| Hardware version | 1.75 |

| Information | | p.1/3 |
|-----------------|------|-------|
| Modbus station | 255 | |
| Logging memory | OFF | |
| Solar operation | 0 h | |
| Flow rate 1 | 0 | |
| Special flags | 3840 | |

| Information | | p.2/3 |
|--------------------|--------------------|-------|
| Vf1-Rüf1 | --.-°C | |
| Y1 avg mth bfr lst | 10240 | |
| Y1 avg last month | 0 | |
| Y1 avg this month | 0 | |
| Binary inputs | □ □ □ □ □ □ □ □ | |

| Information | | p.3/3 |
|------------------|----|-------|
| Reason for reset | SW | |

The following details on the controller version (device identification, serial number, software and hardware versions) and meter bus are displayed in the extended operating level.

Turn the rotary switch to \diamond (settings).

⌂ Enter code number 1999.

* Confirm key number.

Turn the rotary switch to \square (operating level).

⌂ Select 'Information'.


The additional "meter" page is displayed with connection status and further meter data for meters 1 to 3 in the "extended operating level" mode when the meter bus is activated (see Annex A). In addition, the respective measuring and limit values are displayed after confirming the plant scheme when the flow rate and/or capacity limitation is active.

i Note

- The additional information is hidden when the key number 1999 is entered again.
 - The key number 1999 cannot be used to change the controller configuration and parameterization. A separate key number exists for configuration and parameterization (see the 'Start-up' section).
-

8.5.1 Adapting the Trend-Viewer


The standard graph shows the data measured at the outdoor sensor AF1 and flow sensor VF1 plotted over time.



- * Open the Trend-Viewer.


Adding measuring data

- ⌚ Select `----` on the display.
- * Activate editing mode for sensor selection.
- ⌚ Select the sensor.
- * Confirm setting.




Deleting measured data:

- ⌚ Select the sensor whose measured data are no longer to be displayed.
- * Activate editing mode for sensor.
- ⌚ Select `----` on the display.
- * Confirm deletion.




Shifting the time line:

- ⌚ Select 'Scroll'.
- * Activate editing mode for scroll function.




- ⌚ Shift the time line.
- * Confirm time display.



Zooming in/out

- ⌂ Select 'Zoom'.
- * Open zoom function.
- ⌂ Zoom in or out.
- * Confirm display.



Closing the Trend-Viewer

- ⌂ Select 'Back'.
- * Close the Trend-Viewer

8.6 Operating the heating controller in manual mode

Switch to manual mode to configure all controller outputs.

⚠ NOTICE

System damage caused by frost when manual operating mode is active!

The frost protection function is deactivated in the manual operating mode.

→ Do not run the heating during cold weather in the manual mode for long periods of time.

Manually changing the positioning value/switching state:

| Handbetrieb | | |
|-------------|--|------|
| TW | | EIN |
| AA1 | | 20% |
| AA2 | | 100% |
| AA3 | | 0% |
| AA4 | | 100% |

Turn the rotary switch to (manual mode). The outputs of the configured system are listed on the display.

- ① Select the output
 - Positioning value
 - Circulation pump (heating)
 - Storage tank charging pump
 - Circulation pump (DHW)
 - Solar circuit pump
 - stetiges 0-bis-10-V-Signal
 - PWM-Signal
 - AA1: 0 to 10 V signal
 - AA2: analog output 2
 - AA3: analog output 3
 - AA4: analog output 4
- ② Activate editing mode for the output.
- ③ Change the positioning value/switching state.
- ④ Confirm the positioning value/switching state.
The modified values remain active as long as the controller is in manual mode.

Turn the rotary switch to (operating level). The manual mode is deactivated.

i Note

The outputs of the heating controller are not affected by merely turning the rotary switch to (manual mode). The outputs are only changed by entering or changing the positioning values or switching states.

9 Malfunctions

A malfunction is indicated by the blinking Δ icon on the display. Additionally, the display is illuminated for one second every 10 seconds. The green illuminated tip of the rotary switch and display indicated that no errors or malfunctions are present. These change to red in the event of an error or malfunction. Press the rotary pushbutton to open the error level. As long as an malfunction exits, the error message is included in the reading loop, even when it has not been opened by pressing the rotary pushbutton.

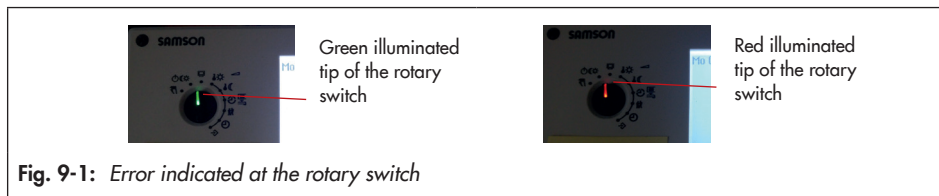


Fig. 9-1: Error indicated at the rotary switch

⚠ DANGER

Risk of electric shock while performing electrical connection.

For wiring and connecting the controller, observe the relevant electrotechnical regulations of the country of use as well as the regulations of the local power suppliers.

→ Only allow properly trained and experienced personnel perform the wiring.

ⓘ NOTICE

Risk of damage to the heating controller due to incorrectly performed work.

→ Only properly trained personnel appropriately qualified to carry out such tasks must be allowed to perform corrective action.

In the error level, the error message is displayed as specified in the following list (see section 9.1).

i Note

After the system code number has been changed or after restarting the controller, any error messages are suppressed for approx. three minutes.

9.1 Error list

| | | |
|---------------------|---|--|
| Sensor failure | = | Sensor failure (see section 9.2) |
| TROVIS I/O failure | = | TROVIS I/O communication error |
| Disinfection | = | Disinfection temperature not reached. See 'Thermal disinfection of DHW storage tank' function in Annex A (configuration instructions). |
| Max. charging temp. | = | Max. charging temperature reached. See 'DHW heating in the storage tank charging system' function in Annex A (configuration instructions). |
| External | = | Error message from device bus |
| Temp. monitoring | = | Temperature monitor alarm |
| Unauthorized access | = | Unauthorized access occurred (see section 9.4) |
| Binary alarm | = | Error message of a binary input |
| Meter bus | = | Meter bus communication error |
| Heat meter | = | Heat meter error registered |

i Note

If the error messages or indications that can be confirmed are included in the list shown, you can decide whether you want to confirm these error messages on exiting the error list.

9.2 Sensor failure

As described in the error list, sensor failures are indicated by the 'Sensor failure' error message in the error level. For detailed information, exit the error level and view the different temperature values in the information level: each sensor icon displayed together with three dashes instead of the measured value indicates a defective sensor. The following list explains how the controller responds to the failure of the different sensors.

- **Outdoor sensor AF1/2:** when the outdoor sensor fails, the controller uses a flow temperature set point of 50 °C or the 'Max. flow temperature' when the max. flow temperature (PA1, 2, 3 -> P07 ¹⁾) is lower than 50 °C. With the setting CO1, 2, 3 -> F05 - 1 ²⁾ (underfloor heating), the flow temperature set point is 30 °C in the event of a malfunction.

- **Flow sensor(s) in heating circuit(s):** when the flow sensors in the heating circuits are defective, the associated valve moves to 30 % travel. DHW heating which use such a sensor to measure the charging temperature is suspended.
- **Flow sensors in the DHW circuit with control valve:** when the DHW circuit has two charging temperature sensors VF2 and VF4, the controller behaves as if VF4 sensor has not been configured if it is defective. As soon as the control of the charging temperature using the VF2 sensor or the DHW temperature becomes impossible, the associated valve is closed.
- **Return flow sensor:** when the return flow sensor fails, the controller continues operation without return flow temperature limitation.
- **Room sensors:** when the room sensor fails, the heating controller uses the settings for operation without room sensor. The controller, for example switches from optimizing mode to reduced operation. The adaptation mode is canceled. The last determined heating characteristic remains unchanged.
- **Storage tank sensors SF1/2:** when one of the two sensors fails, the storage tank is no longer charged (exception: solar system).
- **Solar circuit sensors SF, VF/RüF:** when one of the two sensors fails, the storage tank in the solar circuit is no longer charged.

1) When a connected I/O module is included, also PA11, 12, 13 -> P07

2) When a connected I/O module is included, also CO11, 12, 13 -> F05 - 1

9.3 Temperature monitoring

When a system deviation greater than 10 °C persists in a control circuit for 30 minutes, the 'Temp. monitoring' message is generated.

| Functions | WE | Configuration |
|------------|----|----------------|
| Monitoring | 0 | CO5 -> F19 - 1 |

9.4 Error status register

The error status register is used to indicate controller or system errors. The error messages which cause a change in the state of the configured fault alarm output (CO5 -> F07 - 1) are highlighted in the following table (bold).

The function blocks in the CO8 configuration level allow single heating controller inputs that are not used to be added to the error status register as binary inputs. Either an open or closed binary input can be configured to indicate an error. The heating controller indicates 'Binary alarm' when at least one of the inputs configured in this way registers an error.

i Note

If free inputs are to issue binary signals to a building control station without affecting the error status register, activate the corresponding function block in the CO8 configuration level and select 'None' as the function block parameter.

| Error message | Decimal value | |
|--|---------------|-------|
| Sensor failure | 1 | 1 |
| TROVIS I/O failure | 2 | |
| Disinfection | 4 | |
| Max. charging temp. | 8 | |
| External | 16 | |
| Temp. monitoring | 32 | 32 |
| Unauthorized access | 64 | |
| Binary alarm | 128 | |
| Meter bus | 256 | |
| Heat meter | 512 | |
| | | Total |
| Example: Value of error status register when a sensor fails and a temperature monitoring alarm = | | 33 |

10 Servicing

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

We recommend inspection and testing according to Table 10-1.

Table 10-1: *Recommended inspection and testing*

| Inspection and testing | Action to be taken in the event of a negative result |
|--|--|
| Check the markings, labels and nameplates on the heating controller for their readability and completeness. | → Immediately renew damaged, missing or incorrect nameplates or labels. |
| | → Clean any inscriptions that are covered with dirt and are illegible. |
| Check the electric wiring. | → If any wires are loose, open the controller housing and tighten the terminal screws (see the 'Installation' section). |
| | → Renew damaged wires. |
| Compare the temperature values displayed at the heating controller with the actual temperatures at the point of measurement. | → If the displayed and actual temperatures differ, calibrate the sensors (see the 'Start-up and configuration' section). |

11 Decommissioning

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

⚠ DANGER

Risk of fatal injury due to electric shock.

→ *Before disconnecting live wires at the heating controller, switch off the supply voltage and protect it against unintentional reconnection.*

To put the controller out of operation, the heating controller must be disconnected from the voltage supply:

- When the heating controller is connected to a control station: log off the heating controller from the control station and disconnect the communication cable.
- When the heating controller is connected to TROVIS-VIEW: remove the connecting cable from the RJ-45 jack.
- Disconnect the supply voltage and protect it against unintentional reconnection.
- Unscrew the top left and right screws on the front of the controller to open the controller housing.
- Disconnect the wires from the terminals.
- Pull the wires out of the cable ducts.

12 Removal

The work described in this section is only to be performed by personnel appropriately qualified to carry out such tasks.

Panel mounting

1. Put the heating controller out of operation (see the 'Decommissioning' section).
2. Unscrew the top left and bottom right screws to unfasten the controller housing from the panel.

Wall mounting

1. Put the heating controller out of operation (see the 'Decommissioning' section).
2. Unscrew the fastening screws and remove the back of the housing from the wall.

Rail mounting

1. Put the heating controller out of operation (see the 'Decommissioning' section).
2. Unscrew the top left and bottom right screws to unfasten the controller housing from the top-hat rail.

13 Repairs

A defective heating controller must be repaired or replaced.

! NOTICE

Risk of damage to the heating controller due to incorrect service or repair work.

- *Do not perform any repair work on your own.*
 - *Contact SAMSON's After-sales Service for service and repair work.*
-

13.1 Returning devices to SAMSON

Defective heating controllers can be returned to SAMSON for repair.

Proceed as follows to return devices to SAMSON:

1. Put the heating controller out of operation (see the 'Decommissioning' section).
2. Remove the heating controller (see the 'Removal' section).
3. Proceed as described on the Returning goods page of our website
 - ▶ www.samsongroup.com > Service & Support > After-sales Service > Returning goods

14 Disposal



SAMSON is a producer registered at the following European institution
▶ <https://www.ewrn.org/national-registers/national-registers>.
WEEE reg. no.:
DE 62194439/FR 025665

- Observe local, national and international refuse regulations.
- Do not dispose of components, lubricants and hazardous substances together with your other household waste.

i Note

We can provide you with a recycling passport according to PAS 1049 on request. Simply e-mail us at aftersaleservice@samsongroup.com giving details of your company address.

Tip

On request, we can appoint a service provider to dismantle and recycle the product.

15 Certificates

The following certificate is shown on the next page:

- EU declaration of conformity

The certificate shown was up to date at the time of publishing. The latest certificates can be found on our website:

▶ www.samsongroup.com > Products & Applications > Product selector > Automation Systems > 5578-E

EU declaration of conformity



**EU Konformitätserklärung / EU Declaration of Conformity /
Déclaration UE de conformité**

Die alleinige Verantwortung für die Ausstellung dieser Konformitätserklärung trägt der Hersteller/
This declaration of conformity is issued under the sole responsibility of the manufacturer/
La présente déclaration de conformité est établie sous la seule responsabilité du fabricant.
Für das folgende Produkt / For the following product / Nous certifions que le produit

**Heizungs- und Fernheizungsregler / Heating and District Heating Controller /
Régulateur de chauffage et de chauffage à distance
Typ/Type/Type TROVIS 5578-E**

wird die Konformität mit den einschlägigen Harmonisierungsrechtsvorschriften der Union bestätigt /
the conformity with the relevant Union harmonisation legislation is declared with/
est conforme à la législation d'harmonisation de l'Union applicable selon les normes:

| | |
|-----------------|---|
| EMC 2014/30/EU | EN 61000-6-1:2007, EN 61000-6-3:2007 +A1:2011, EN 61000-6-4:2007+A1:2011 |
| LVD 2014/35/EU | EN 60730-1:2016, EN 50344:2001 |
| RoHS 2011/65/EU | EN 50581:2012 |

Hersteller / Manufacturer / Fabricant:

SAMSON AKTIENGESELLSCHAFT
Weismüllerstraße 3
D-60314 Frankfurt am Main
Deutschland/Germany/Allemagne

Frankfurt / Francfort, 2020-07-29

Im Namen des Herstellers/ On behalf of the Manufacturer/ Au nom du fabricant.

ce.5578_e_de_en_fr_a1_en03sig.pdf

Dipl.-Ing. Gert Nahler
Zentralabteilungsleiter/Head of Department/Chef du département
Entwicklung Automation und Integrationstechnologien/
Development Automation and Integration Technologies

Dipl.-Ing. Silke Bianca Schäfer
Total Quality Management/
Management par la qualité totale

16 Annex A (configuration instructions)

This annex contains information on the configuration of the heating controller.


16.1 Systems

Different hydraulic schematics are available. The system images on the display show the structure of the hydraulic system.

Boiler systems:


Single-stage boiler systems can be configured to include any system whose heating circuits and DHW circuit include just one heat exchanger. These systems are 1.0-1, 1.5-1, 1.6-1, 1.6-2, 1.7-1, 1.8-1, 1.8-2, 1.9, 2.x, 3.x, 4.x, 5.x, 6.0, 7.x, 8.x, 9.x, 11.1-3, 14.x, 15.x, 16.x and 17.x.

The boiler can be controlled by an on/off output (CO1 -> F12 - 0).

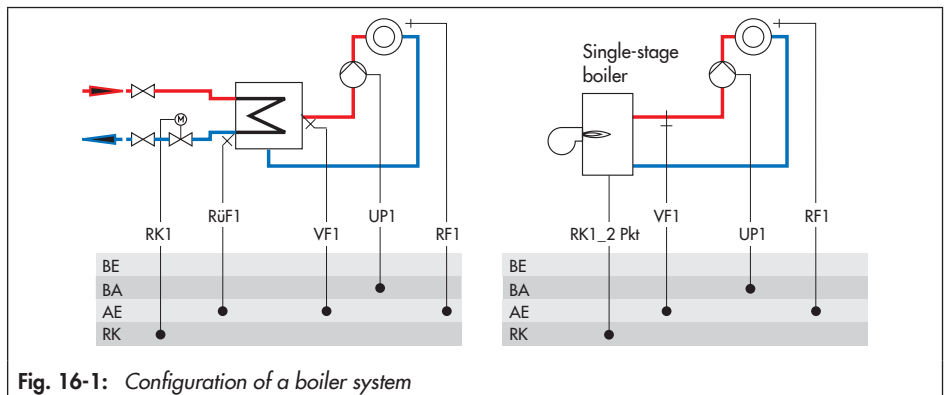


Annex A (configuration instructions)

System Anl 1.0-1

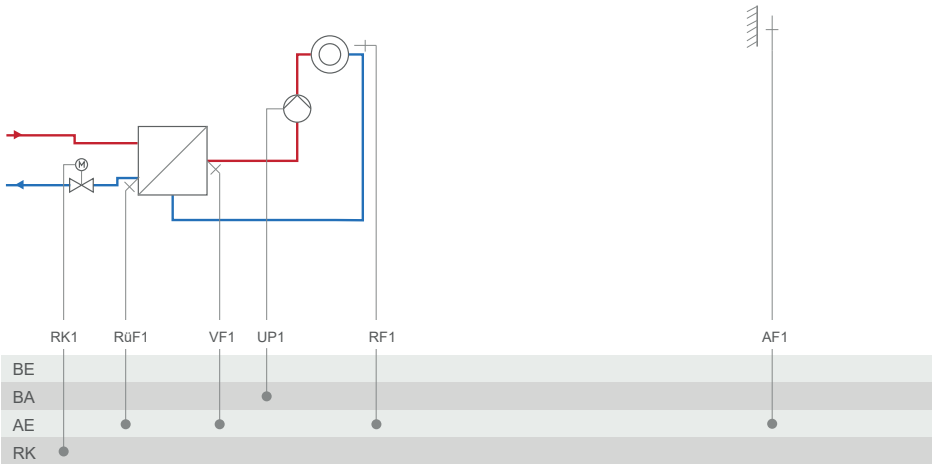

| | |
|---------------------------|---|
| System | 1.0-1 |
| | <p>Anlage 1.0-1</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with R0F1) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Differential temperature control When CO1 -> F23 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p>Direction 'Output'</p> |


System Anl 1.0-2

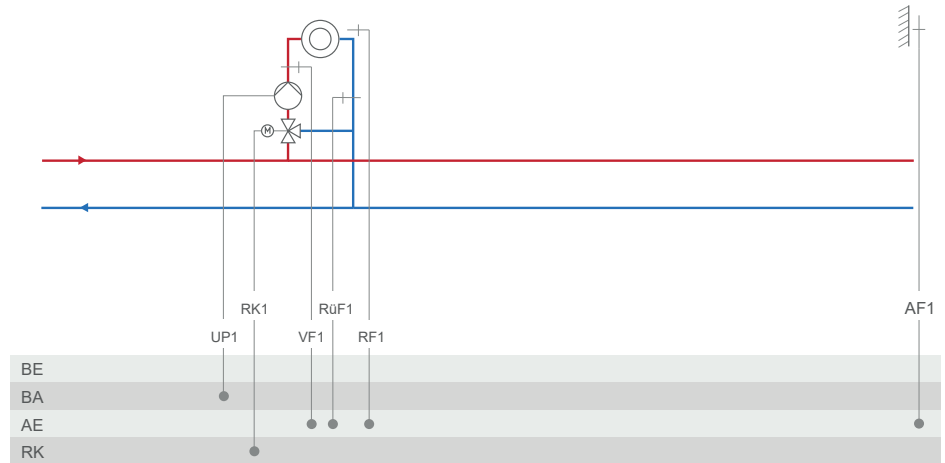

| System | 1.0-2 |
|---------------------------|--|
| | <p>Anlage 1.0-2</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RuF1) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Differential temperature control When CO1 -> F23 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


Annex A (configuration instructions)

System Anl 1.1-1

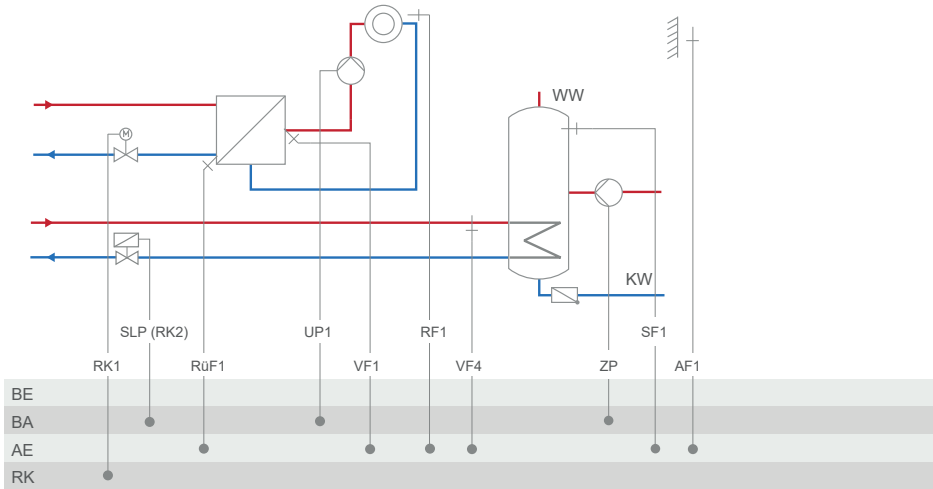

| | | |
|---------------------------|---|---|
| System | 1.1-1 | |
| | Anlage 1.1-1 | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 0 (without RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO4 -> F05 | - 0 (without VF4) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - External demand - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


System Anl 1.1-2

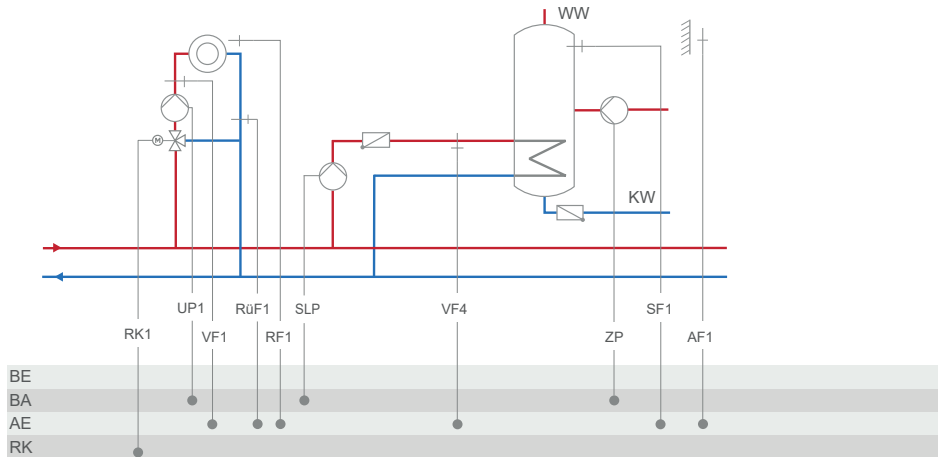

| | | |
|---------------------------|--|--|
| System | 1.1-2 | |
| | Anlage | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 0 (without RUF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO4 -> F05 | - 0 (without VF4) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


Annex A (configuration instructions)


System Anl 1.2

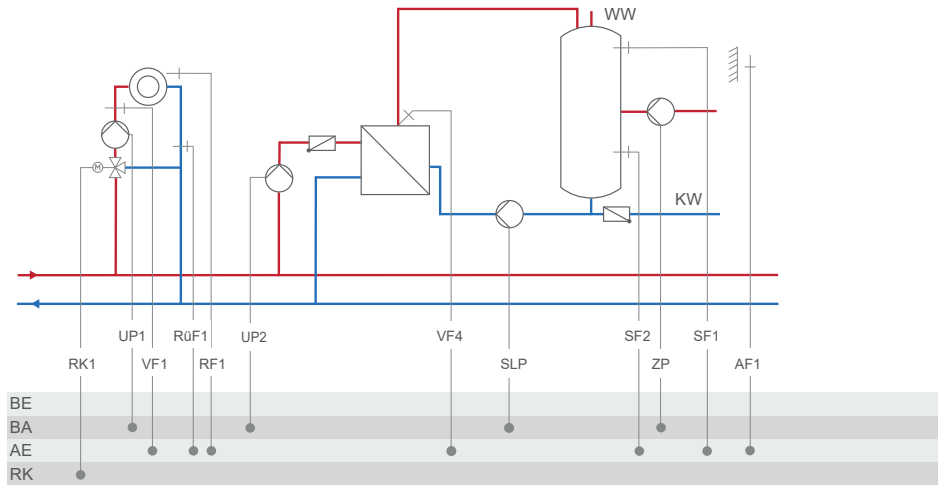

| | | |
|---------------------------|---|--|
| System | 1.2 | |
| | Anlage | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 0 (without RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F05 | - 0 (without VF4) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


System Anl 1.3-1

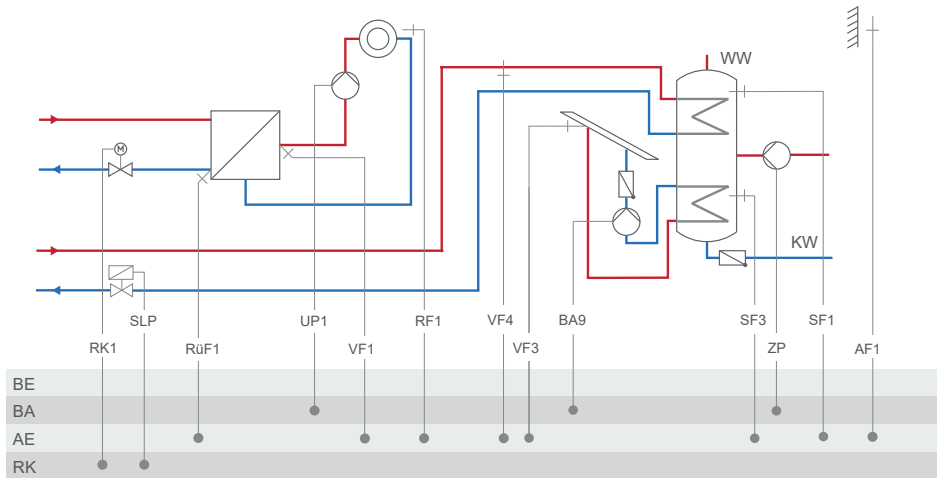


| System | 1.3-1 |
|---------------------------|---|
| | <p>Anlage </p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 0 (without RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


Annex A (configuration instructions)

System Anl 1.3-2

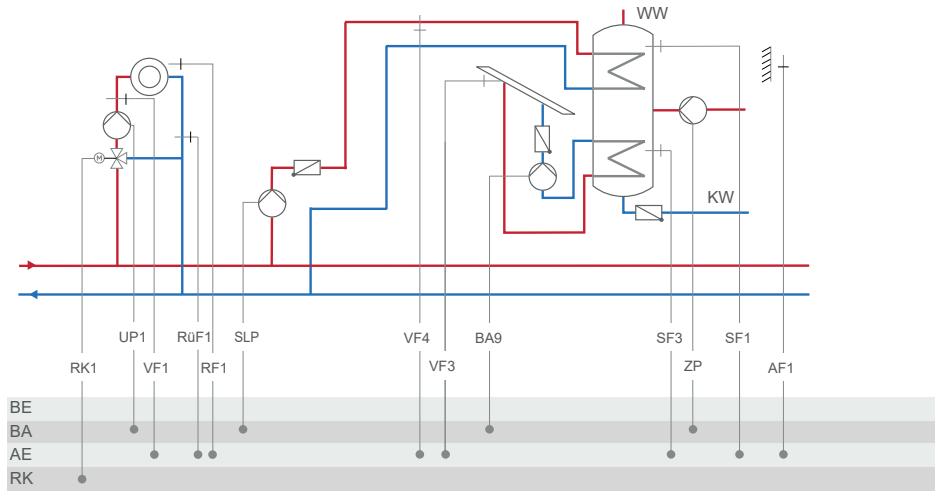

| System | 1.3-2 |
|---------------------------|---|
| | <p>Anlage </p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 0 (without RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 1.4

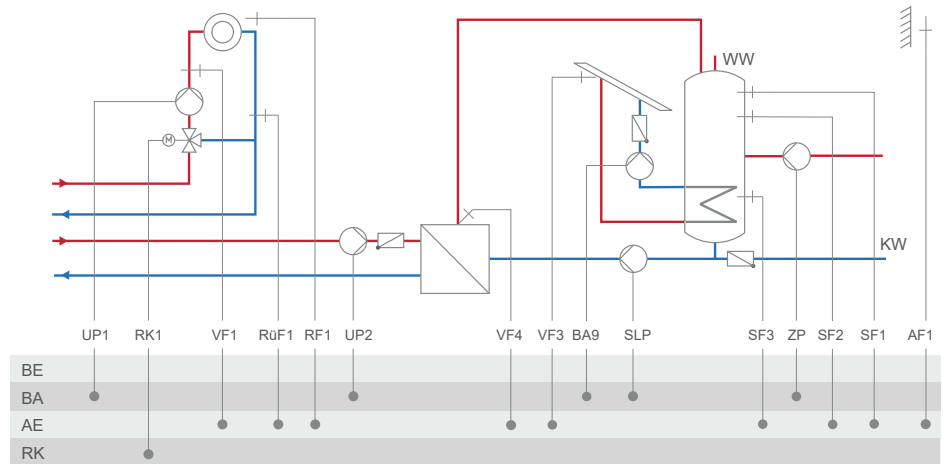

| | | |
|---------------------------|--|---|
| System | 1.4 | |
| | <p>Anlage 1.4</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 0 (without RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO4 -> F05 | - 0 (without VF4) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | <p>When CO1 -> F18 - 1</p> <p>When CO4 -> F21 - 1</p> <p>When CO4 -> F25 - 1</p> <p>When CO5 -> F23 - 1</p> <p>Direction = Output</p> |


Annex A (configuration instructions)


System Anl 1.5-1

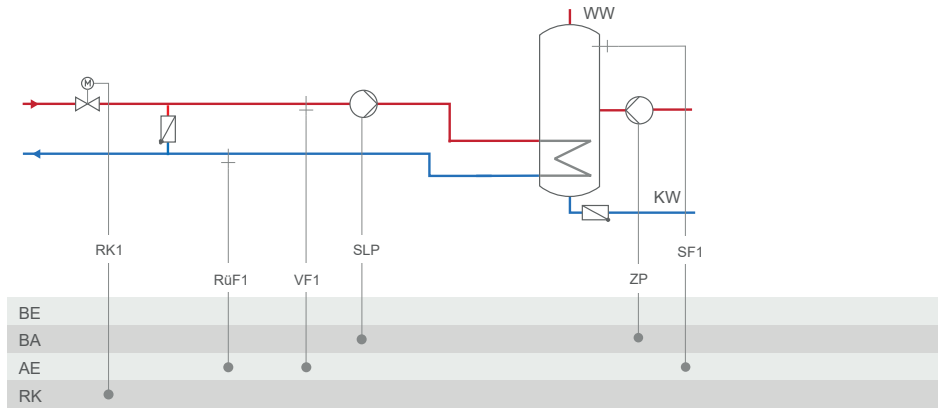

| | | |
|---------------------------|--|---|
| System | 1.5-1 | |
| | | |
| Default setting | | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 |


System Anl 1.5-2

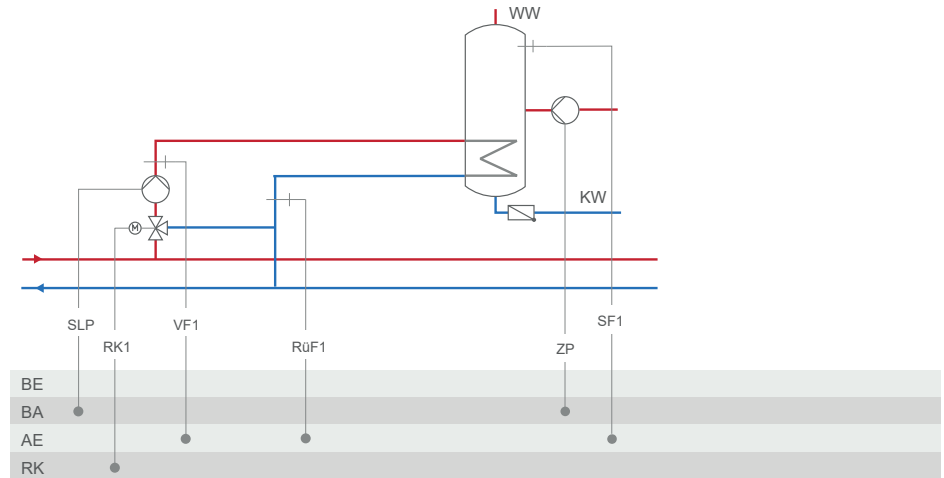

| | | |
|---------------------------|--|--|
| System | 1.5-2 | |
| | Anlage  | |
| Default setting | | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F21 - 1 | |
| | When CO4 -> F25 - 1 | |


Annex A (configuration instructions)

System Anl 1.6-1

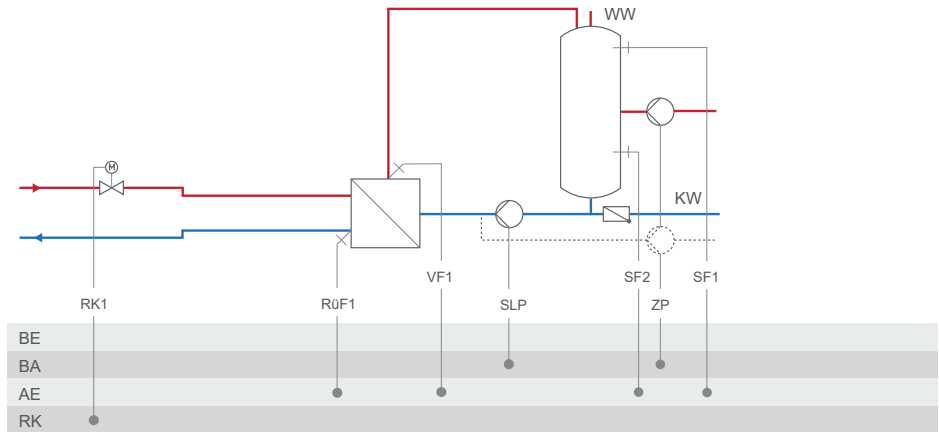

| System | 1.6-1 |
|---------------------------|--|
| | <p>Anlage 1.6-1</p> |
| Default setting | |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div>When CO1 -> F18 - 1</div> <div>When CO4 -> F21 - 1</div> <div>When CO4 -> F25 - 1</div> </div> |


System Anl 1.6-2

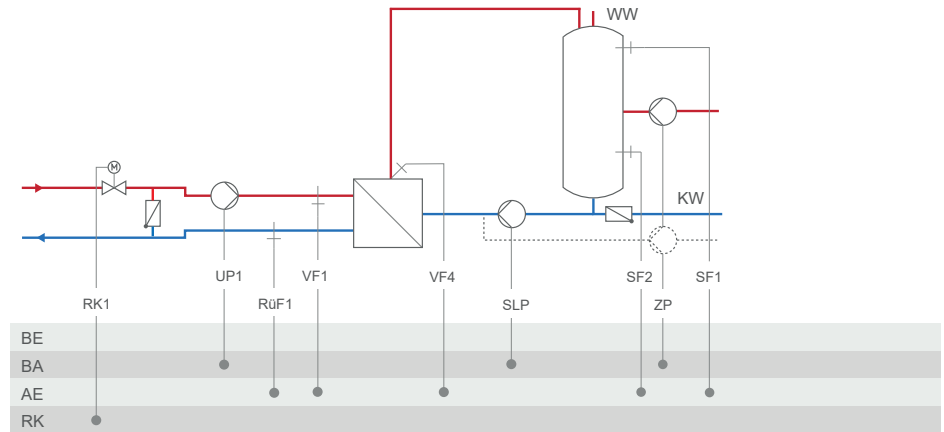

| System | 1.6-2 |
|---------------------------|--|
| | <p>Anlage 1.6-2</p> |
| Default setting | |
| CO1 -> F03 | - 1 (with RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF1 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed <p style="text-align: right;">When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1</p> |


Annex A (configuration instructions)


System Anl 1.6-3

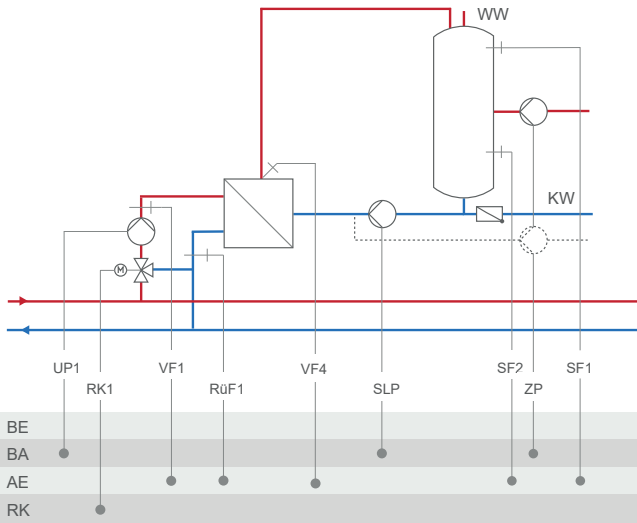

| | | |
|---------------------------|---|--|
| System | 1.6-3 | |
| | Anlage 1.6-3 | |
| Default setting | | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F05 | - 0 (without VF4; in this case, VF1 usually installed at the point of measurement of VF4) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F21 - 1 | |
| | When CO4 -> F25 - 1 | |


System Anl 1.7-1

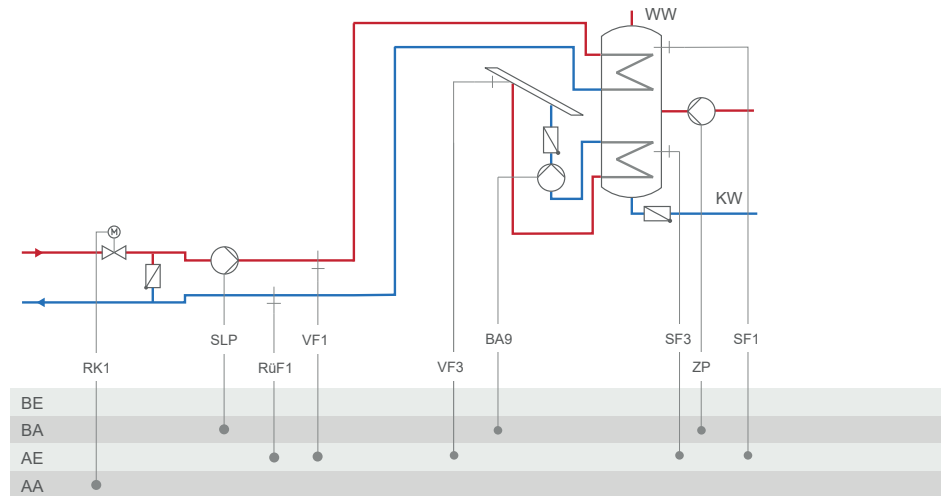


| | |
|---------------------------|--|
| System | 1.7-1 |
| | <p>Anlage </p> |
| Default setting | |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed <p style="text-align: right;">When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1</p> |


Annex A (configuration instructions)

System Anl 1.7-2

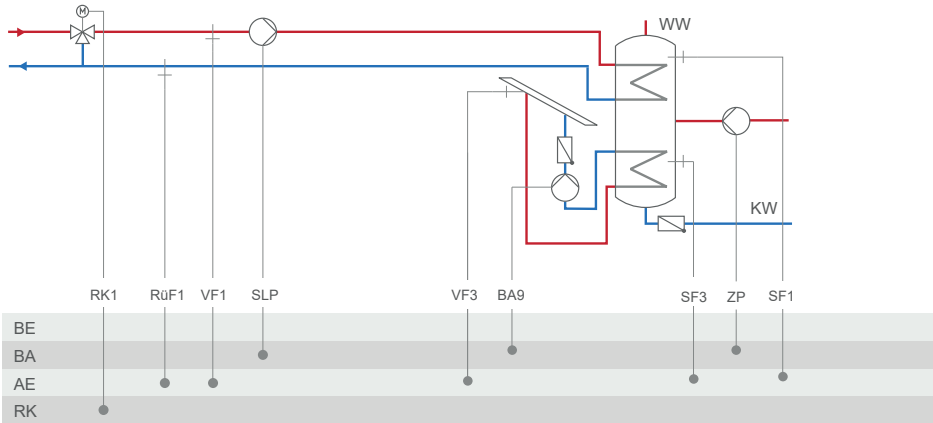

| | |
|---------------------------|--|
| System | 1.7-2 |
| | Anlage  |
| Default setting | |
| CO1 -> F03 | - 1 (with RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO1 -> F18 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO4 -> F21 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO4 -> F25 - 1</div> </div> |


System Anl 1.8-1

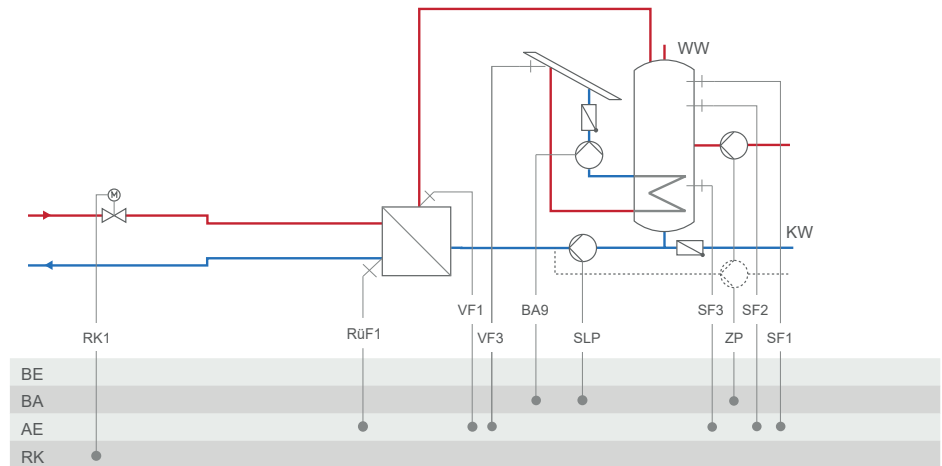

| System | 1.8-1 |
|---------------------------|--|
| | |
| Default setting | |
| CO1 -> F03 | - 1 (with RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed |
| | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 |


Annex A (configuration instructions)


System Anl 1.8-2

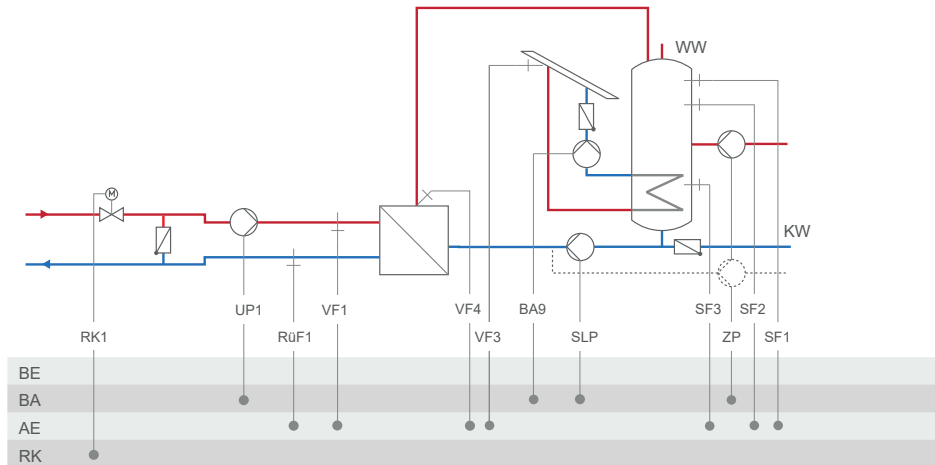

| System | 1.8-2 |
|---------------------------|--|
| | |
| Default setting | |
| CO1 -> F03 | - 1 (with RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF1 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO1 -> F18 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO4 -> F21 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO4 -> F25 - 1</div> </div> |


System Anl 1.8-3

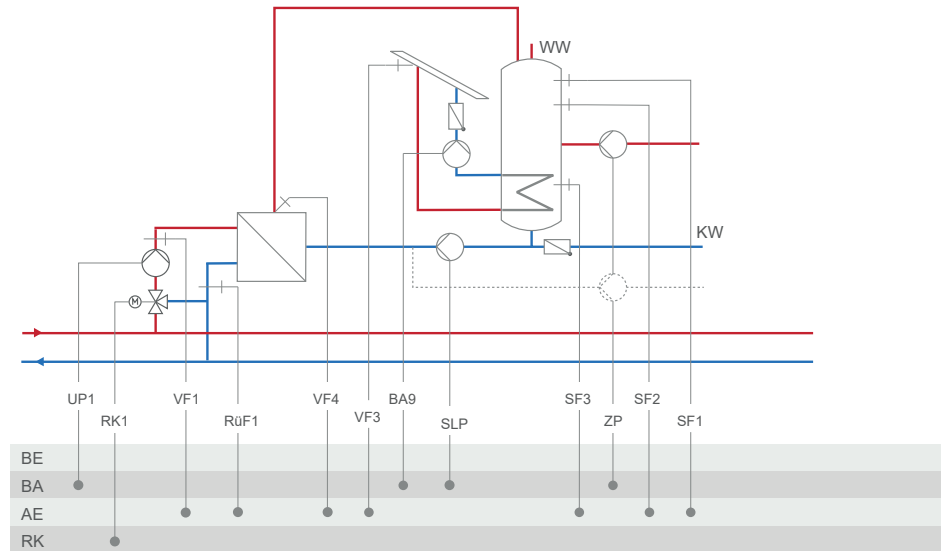


| | | |
|---------------------------|--|---|
| System | 1.8-3 | |
| | Anlage  | |
| Default setting | | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F05 | - 0 (without VF4; in this case, VF1 usually installed at the point of measurement of VF4) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 |


Annex A (configuration instructions)


System Anl 1.9-1

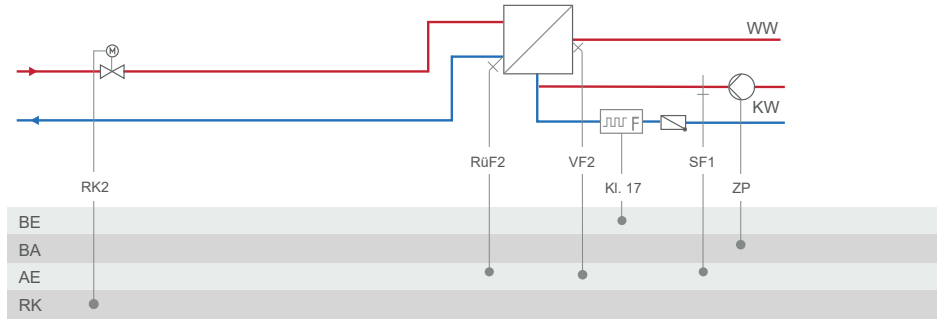

| System | 1.9-1 |
|---------------------------|---|
| | Anlage  |
| Default setting | |
| CO4 -> F01 | - 0 (without SF1) |
| CO4 -> F03 | - 0 (without RüF2) |
| CO4 -> F04 | - 0 (without flow rate sensor) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y2 (RK2) - 10 V supply - External demand - ZP speed <div style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F25 - 1 </div> |


System Anl 1.9-2

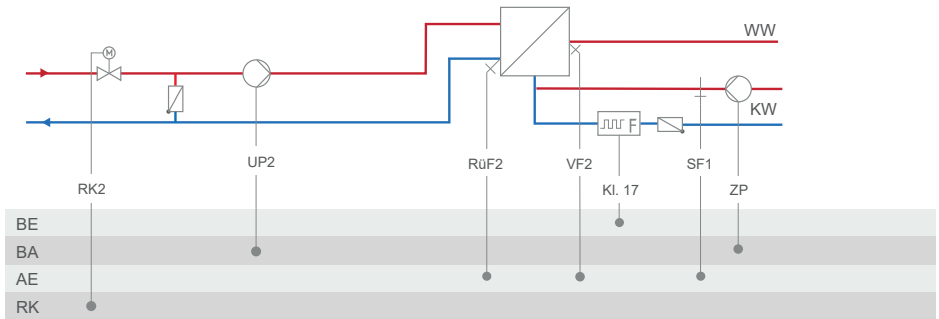

| | |
|---------------------------|---|
| System | 1.9-2 |
| | <p>Anlage </p> |
| Default setting | |
| CO4 -> F01 | - 0 (without SF1) |
| CO4 -> F03 | - 0 (without RüF2) |
| CO4 -> F04 | - 0 (without flow rate sensor) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y2 (RK2) - 10 V supply - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 |


Annex A (configuration instructions)

System Anl 2.0

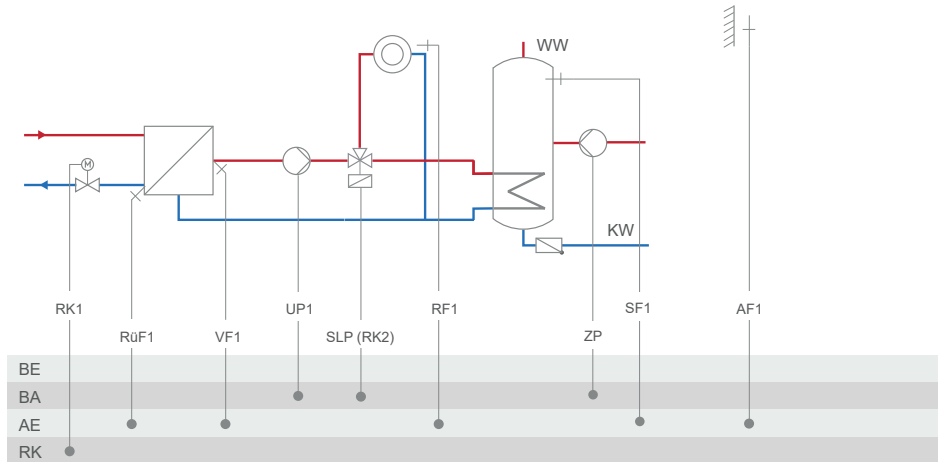

| System | 2.0 |
|---------------------------|---|
| | <p>Anlage 2.0</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - ZP speed - Outdoor temperature <div style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </div> |


System Anl 2.1

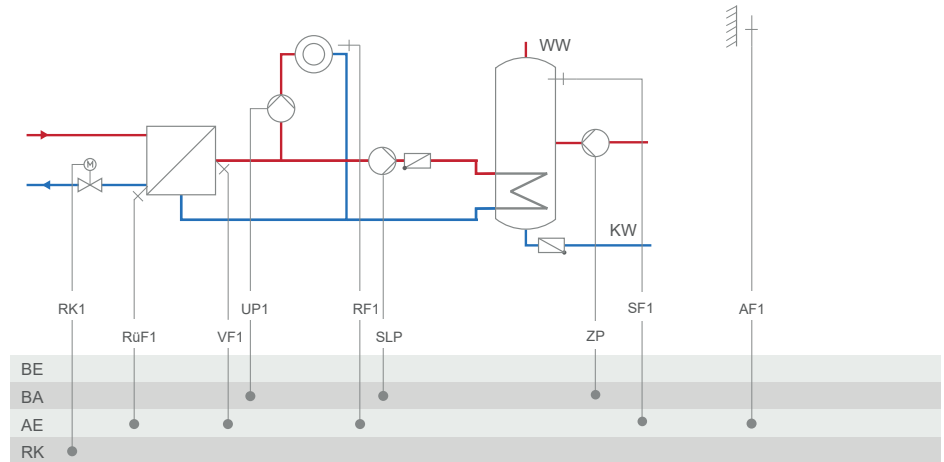

| System | 2.1 |
|---------------------------|---|
| | <p>Anlage 2.1</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


Annex A (configuration instructions)

System Anl 2.2

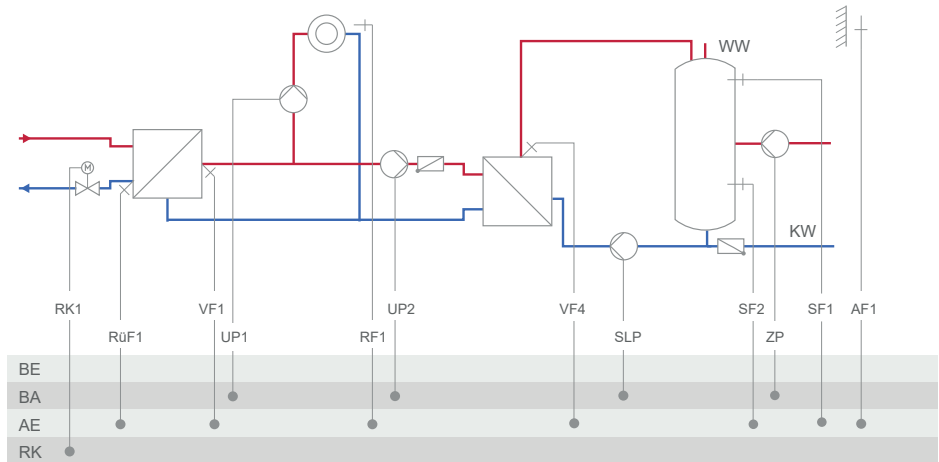

| System | 2.2 |
|---------------------------|---|
| | <p>Anlage 2.2</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 2.3

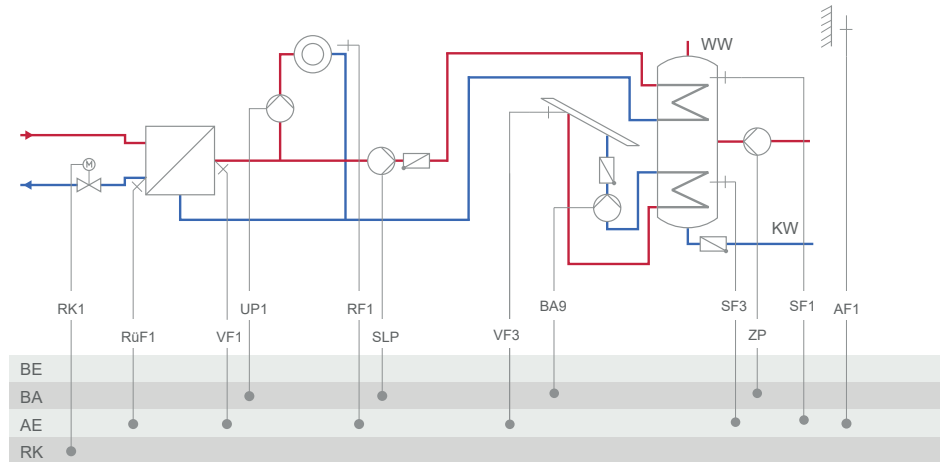

| | | |
|---------------------------|--|--|
| System | 2.3 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F21 - 1 | |
| | When CO4 -> F25 - 1 | |
| | When CO5 -> F23 - 1 | |
| | Direction = Output | |


Annex A (configuration instructions)

System Anl 2.4

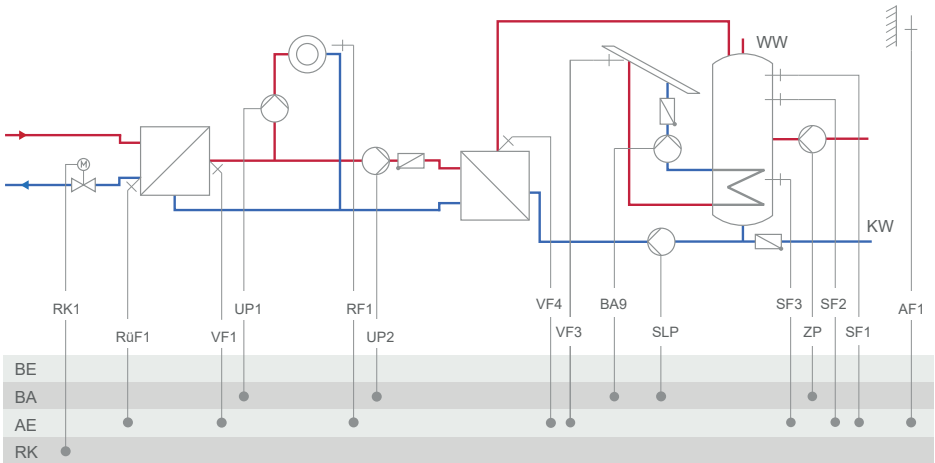

| System | 2.4 |
|---------------------------|---|
| | <p>Anlage 2.4</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 3.0

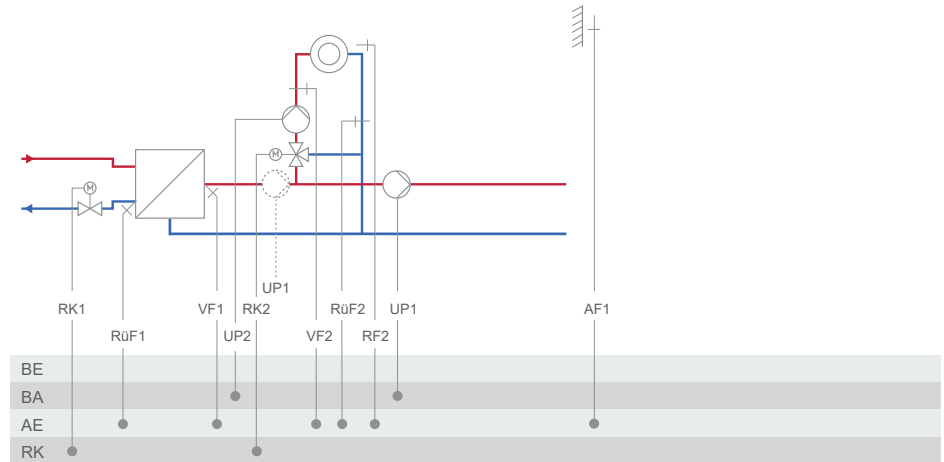

| | | |
|---------------------------|--|--|
| System | 3.0 | |
| | Anlage 3.0 | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 0 (without RüF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - Outdoor temperature | |
| | When CO1 -> F18 - 1 | |
| | When CO5 -> F23 - 1 | |
| | Direction = Output | |


Annex A (configuration instructions)

System Anl 3.1

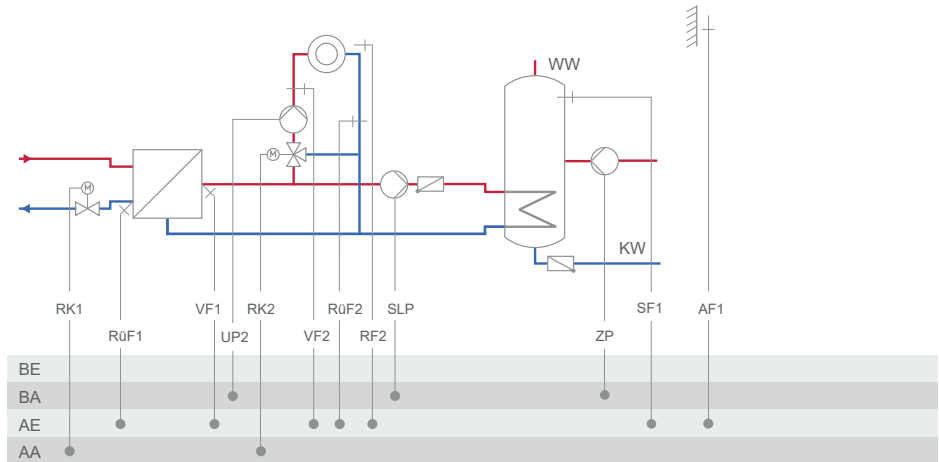


| | | |
|---------------------------|--|--|
| System | 3.1 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 0 (without RüF2) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F21 - 1 | |
| | When CO4 -> F25 - 1 | |
| | When CO5 -> F23 - 1 | |
| | Direction = Output | |


System Anl 3.2

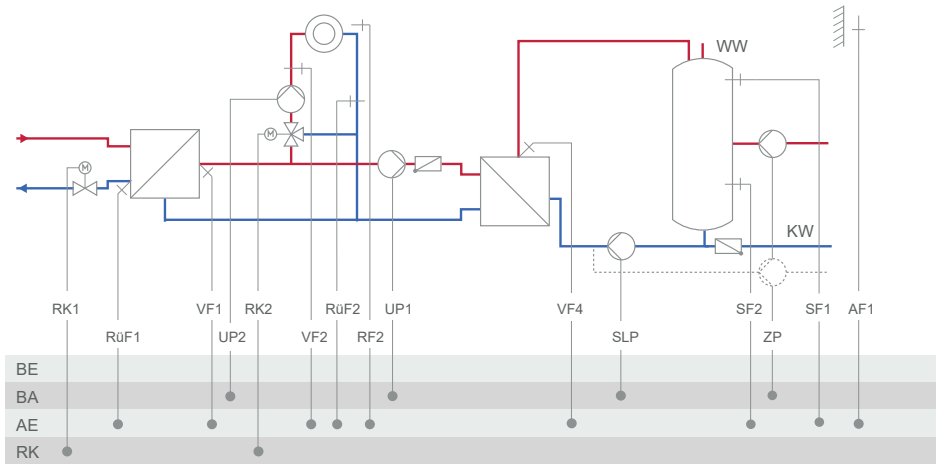

Annex A (configuration instructions)

| System | 3.2 |
|---------------------------|--|
| | <p>Anlage 3.2</p>  |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 3.3

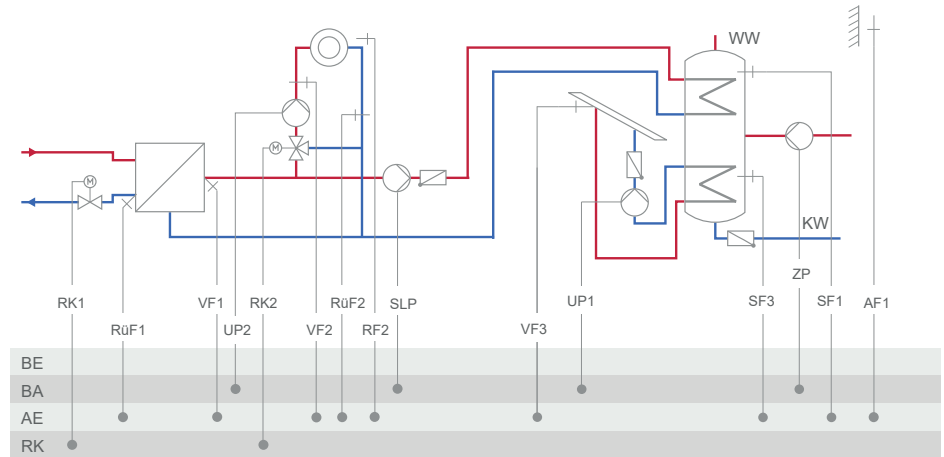

| | | |
|---------------------------|---|--|
| System | 3.3 | |
| | Anlage 3.3 | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 0 (without RüF2) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |

Annex A (configuration instructions)


System Anl 3.4

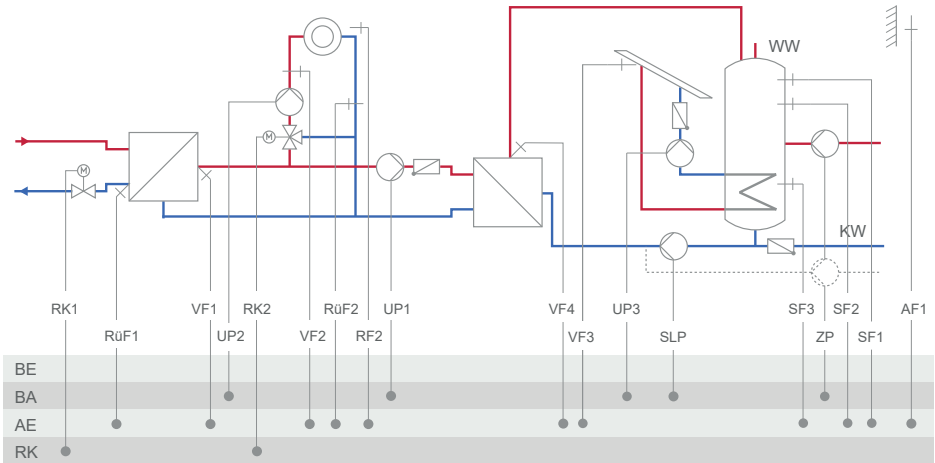

| | | |
|---------------------------|--|--|
| System | 3.4 | |
| | <p>Anlage 3.4</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with R F1) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 0 (without R F2) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO4 -> F05 | - 0 (without VF4) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | |


Annex A (configuration instructions)

System Anl 3.5

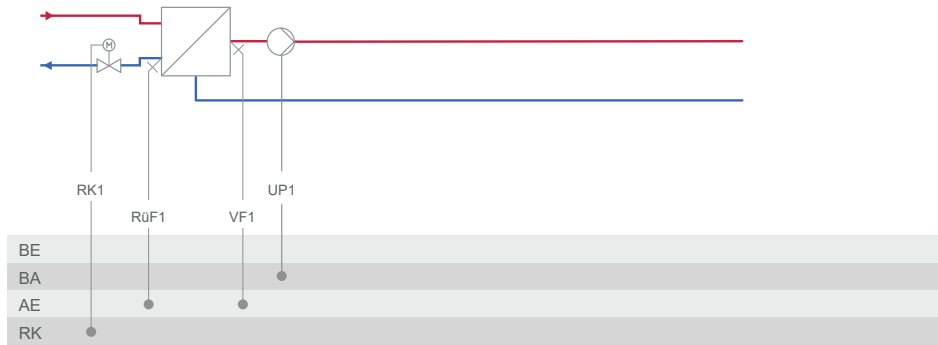


| | |
|---------------------------|---|
| System | 3.5 |
| | <p>Anlage 3.5</p> |
| Note: | Closed control circuit and UP1 are only active during the processing for an external demand |
| Default settings | |
| CO1 -> F03 | - 1 (with RüF1) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - External demand |
| | When CO1 -> F18 - 1 |


System Anl 3.9

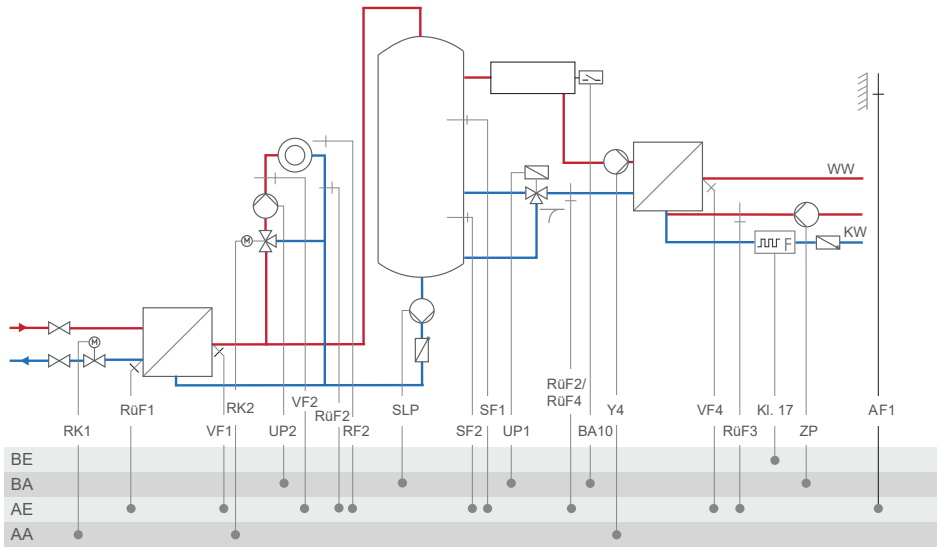

Annex A (configuration instructions)

| System | 3.9 |
|---------------------------|---|
| | <p>Anlage 3.9</p>  |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2 in RK2) |
| CO4 -> F03 | - 0 (without RüF2/RüF4) |
| CO4 -> F04 | - 0 (without flow switch) |
| CO4 -> F14 | - 0 (without RüF3) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y4 - SLP speed When CO1 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 4.0

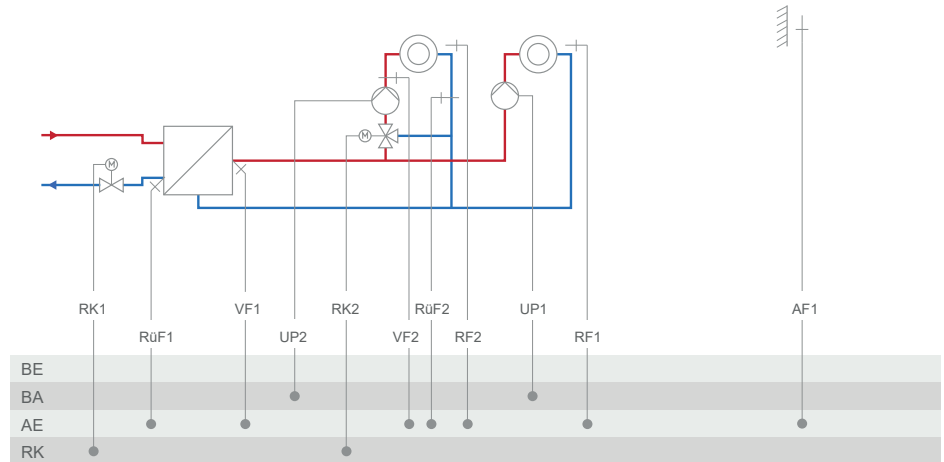

| System | 4.0 |
|---------------------------|---|
| | <p>Anlage 4.0</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> |


Annex A (configuration instructions)

System Anl 4.1

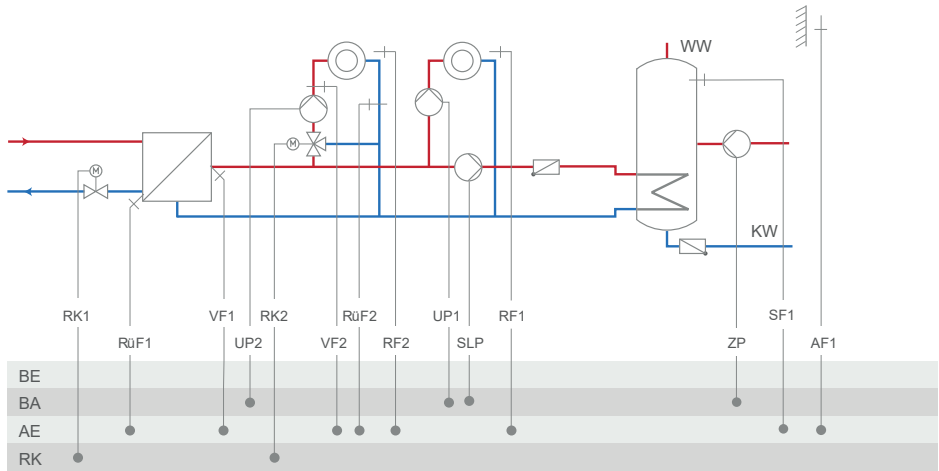


| System | 4.1 |
|---------------------------|---|
| | Anlage 4.1 |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


System Anl 4.2

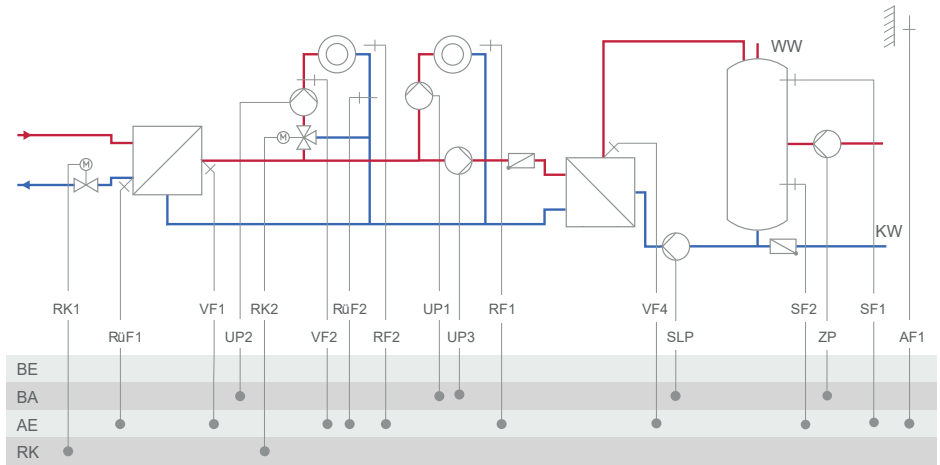

Annex A (configuration instructions)

| System | 4.2 |
|---------------------------|--|
| | <p>Anlage 4.2</p>  |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 4.3

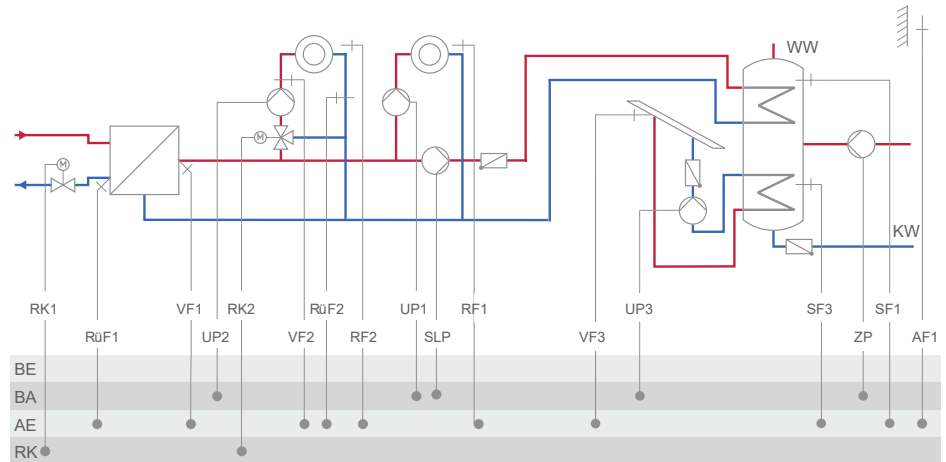

| | | |
|---------------------------|---|---|
| System | 4.3 | |
| | <p>Anlage 4.3</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 0 (without RüF2) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | <p>When CO1 -> F18 - 1</p> <p>When CO4 -> F21 - 1</p> <p>When CO4 -> F25 - 1</p> <p>When CO5 -> F23 - 1</p> <p>Direction = Output</p> |


Annex A (configuration instructions)

System Anl 4.5

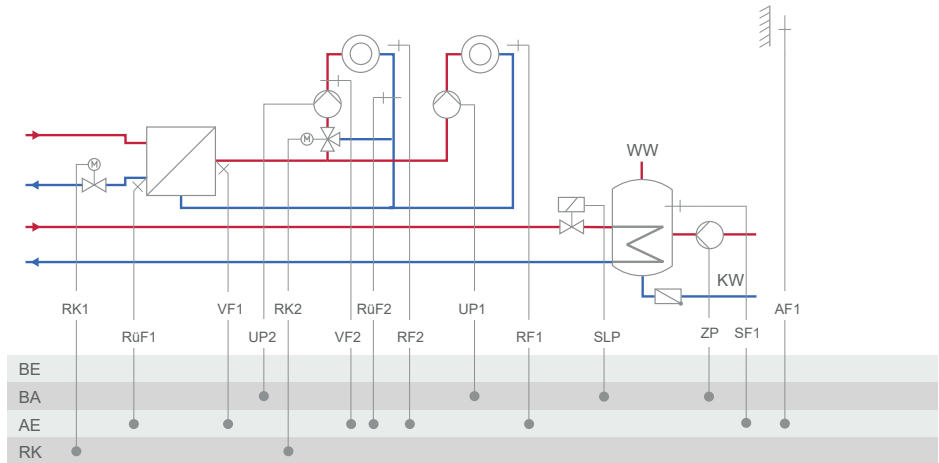


| | | |
|---------------------------|--|--|
| System | 4.5 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 0 (without RUF2) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - ZP speed - Outdoor temperature | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F25 - 1 | |
| | When CO5 -> F23 - 1 | |
| | Direction = Output | |


System Anl 5.0

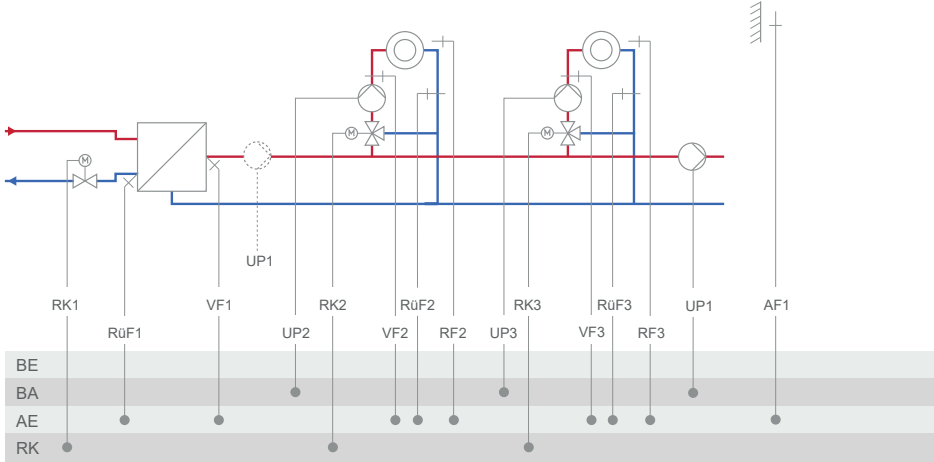

Annex A (configuration instructions)

| System | 5.0 |
|---|--|
| | <p>Anlage 5.0</p>  |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RüF3) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 5.1

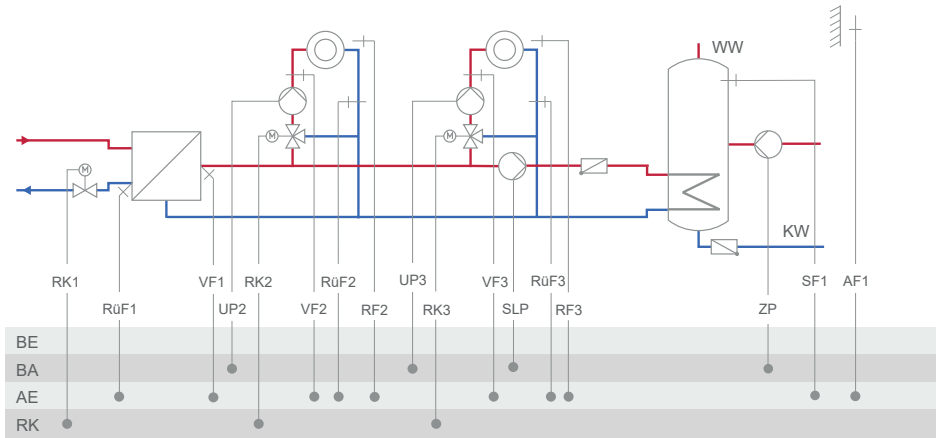

Annex A (configuration instructions)

| System | 5.1 |
|---------------------------|---|
| | <p>Anlage 5.1</p> |
| | <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with R F1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without R F2) |
| CO3 -> F01 | - 0 (without RF2) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without R F2) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 5.2

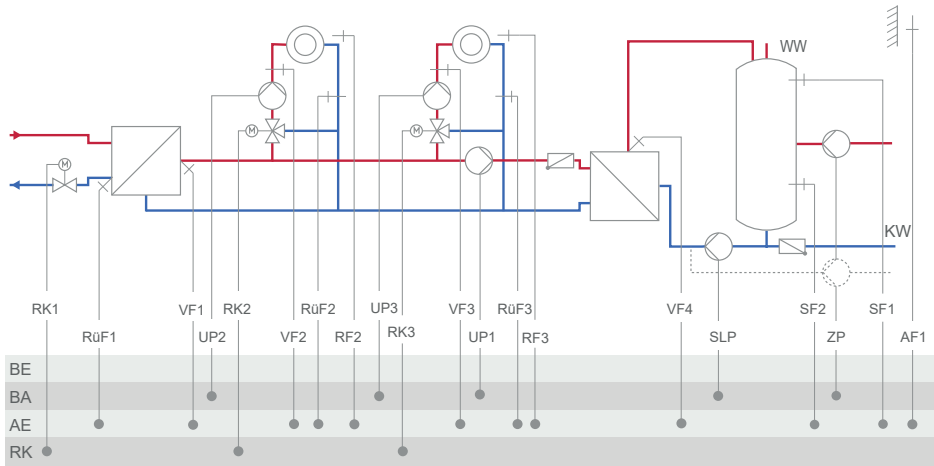

Annex A (configuration instructions)

| System | 5.2 |
|---|---|
| | <p>Anlage 5.2</p> |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RUF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RUF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 5.9

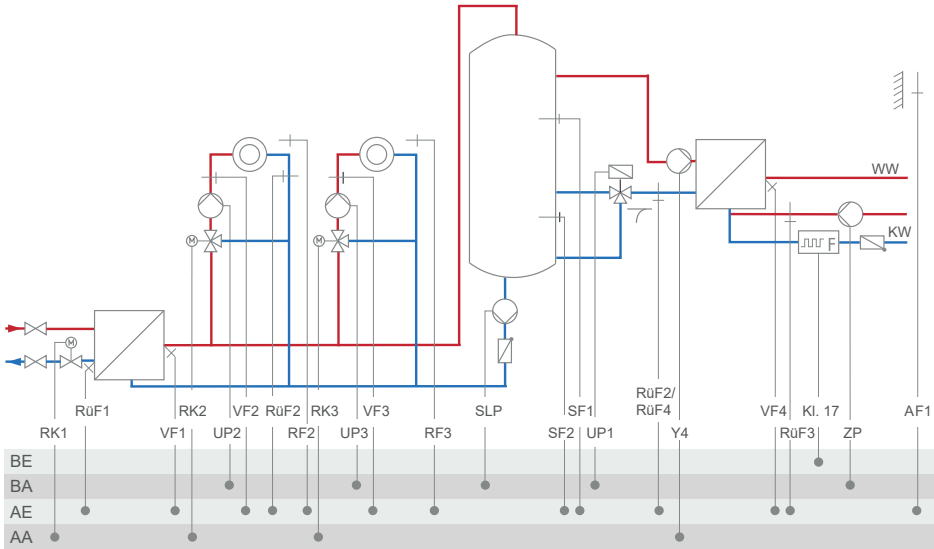


Annex A (configuration instructions)

| System | 5.9 |
|---|--|
| | <p>Anlage 5.9</p> |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RÜF2 in RK2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO4 -> F03 | - 0 (without RÜF2/RÜF4) |
| CO4 -> F04 | - 0 (without flow switch) |
| CO4 -> F14 | - 0 (without RÜF3) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - Control signal Y4 - SLP speed When CO1 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 6.0

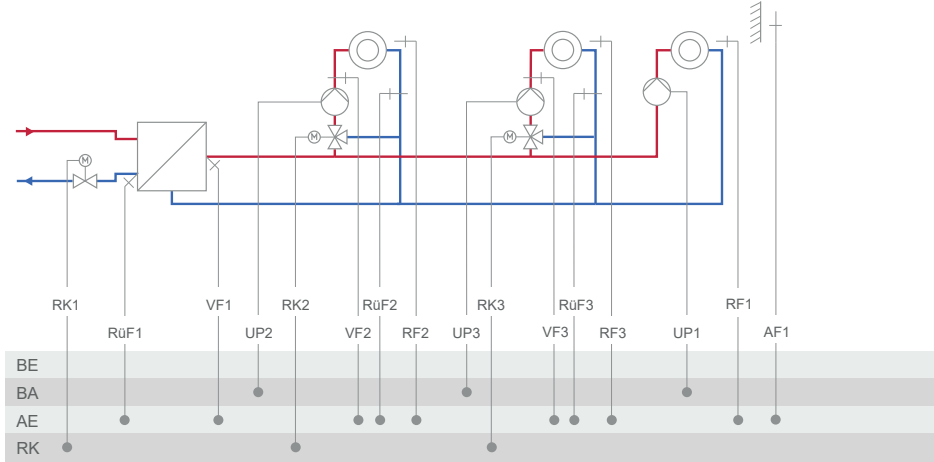

Annex A (configuration instructions)

| System | 6.0 |
|---|--|
| | <p>Anlage 6.0</p>  |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RüF3) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> |


System Anl 6.1

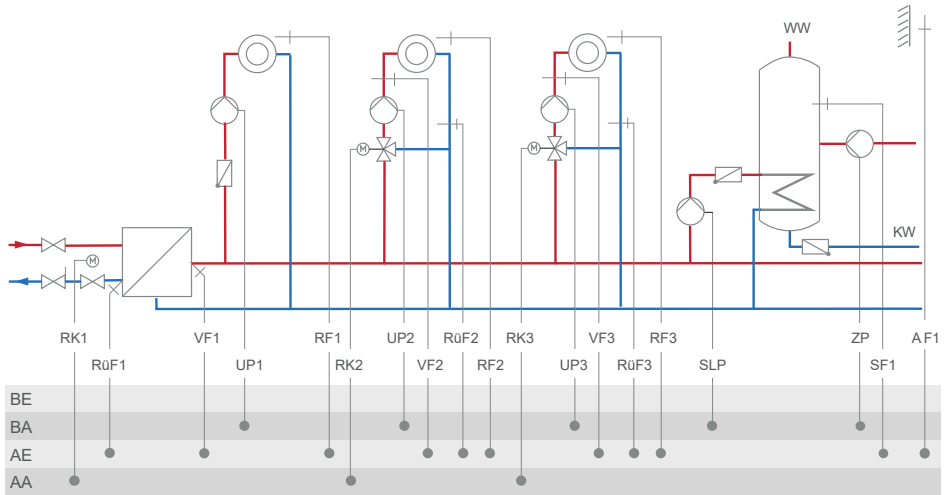

Annex A (configuration instructions)

| System | 6.1 |
|---------------------------|---|
| | <p>Anlage 6.1</p> |
| | <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RüF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 7.1

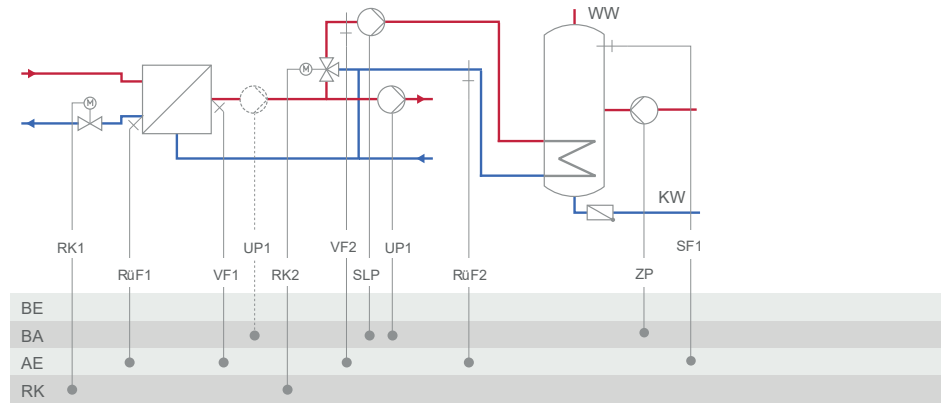

| | | |
|---------------------------|--|--|
| System | 7.1 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 0 (without AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO4 -> F03 | - 0 (without RUF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F21 - 1 | |
| | When CO4 -> F25 - 1 | |


Annex A (configuration instructions)


System Anl 7.2

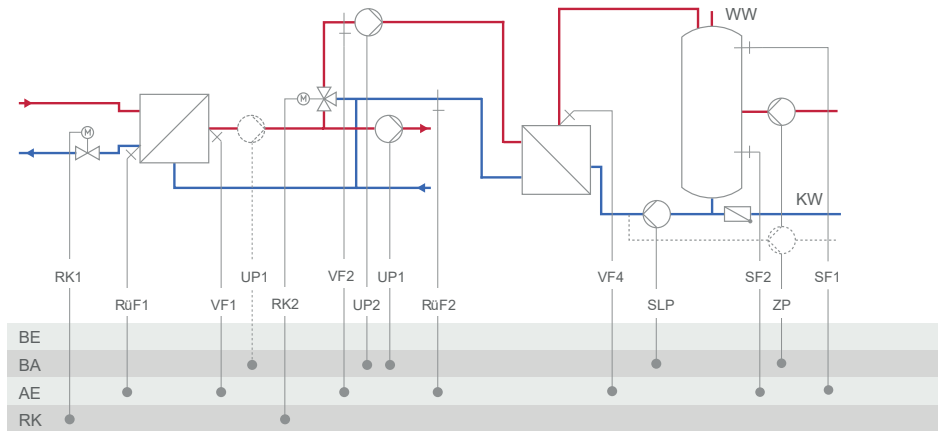

| System | 7.2 |
|---------------------------|---|
| | <p>Anlage</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 0 (without AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed <p style="text-align: right;">When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1</p> |


System Anl 8.1

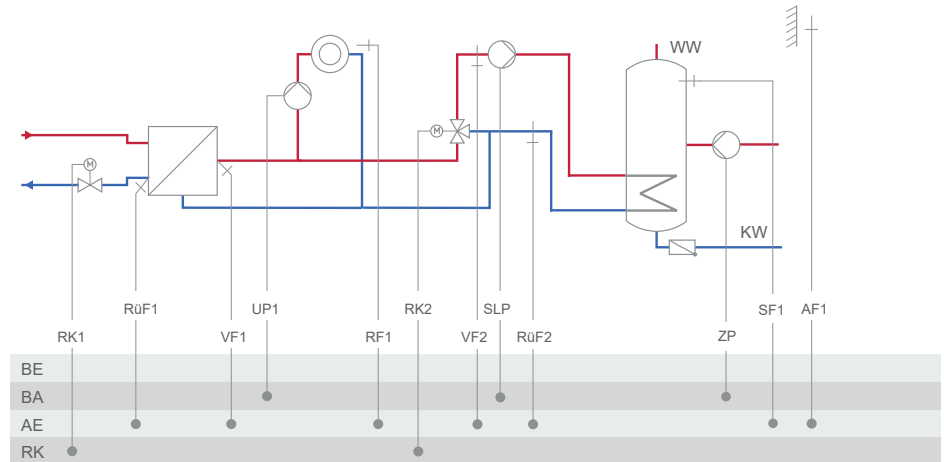

| System | 8.1 |
|---------------------------|--|
| | <p>Anlage </p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F03 | - 0 (without RüF2) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


Annex A (configuration instructions)

System Anl 8.2

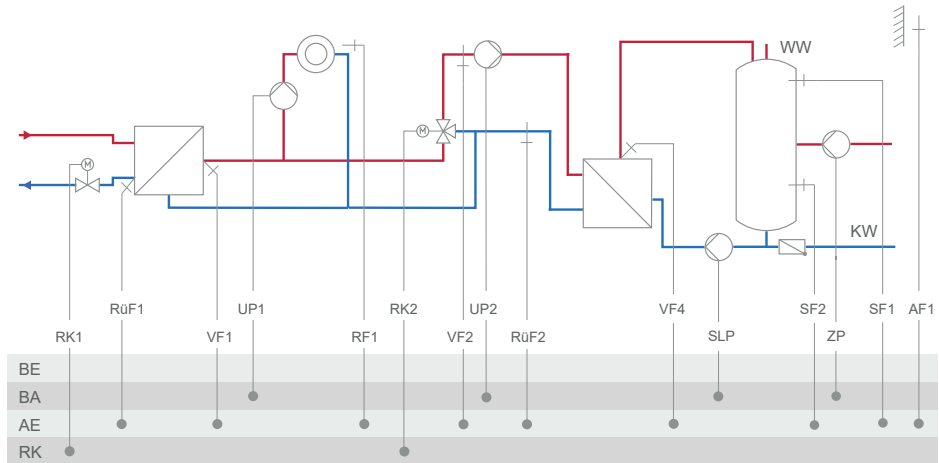


| System | 8.2 |
|---------------------------|---|
| | <p>Anlage 8.2</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature <div style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </div> |


System Anl 9.1

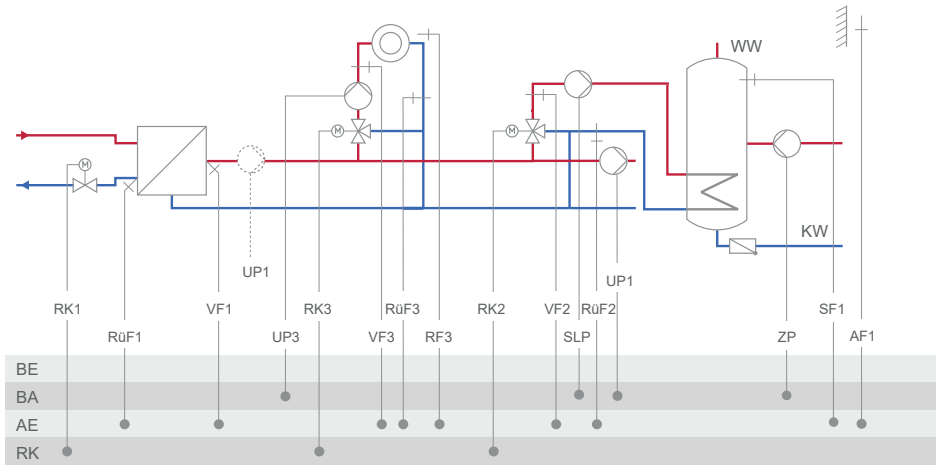


Annex A (configuration instructions)

| System | 9.1 |
|---|---|
| | <p>Anlage 9.1</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with R F1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without R F3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F03 | - 0 (without R F2) |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 9.2

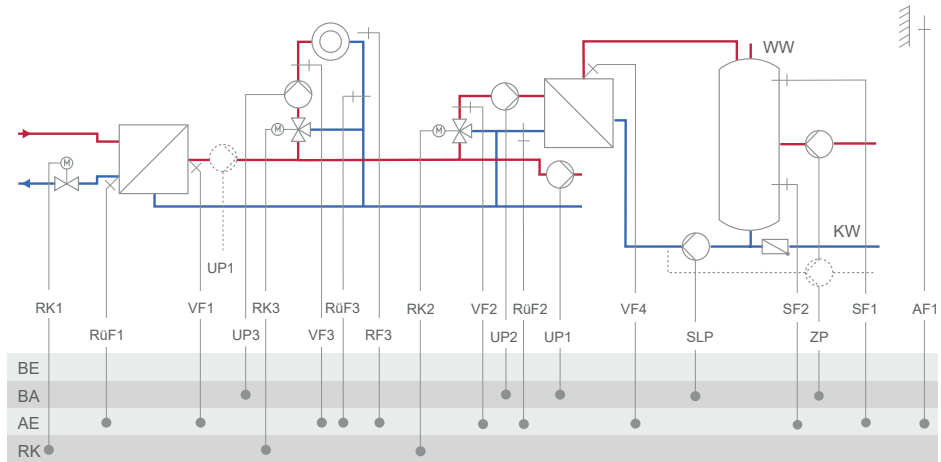


Annex A (configuration instructions)

| System | 9.2 |
|---|---|
| | <p>Anlage 9.2</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RUF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 9.5

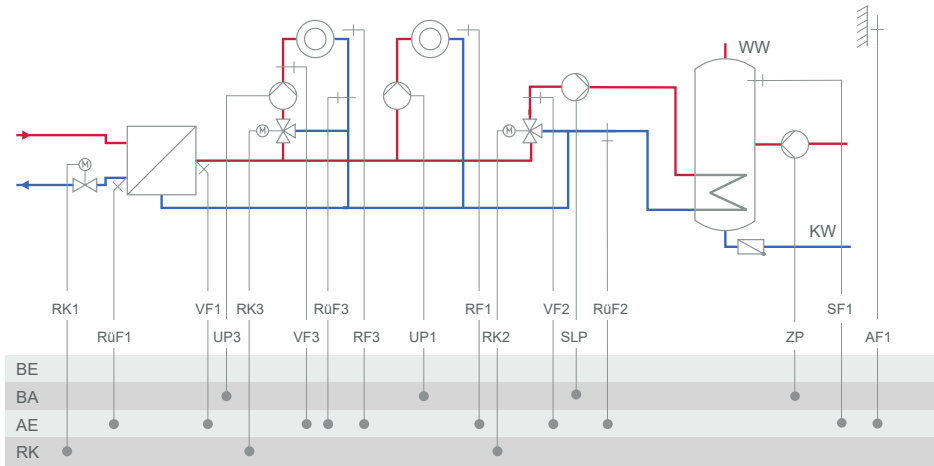

Annex A (configuration instructions)

| System | 9.5 |
|---|---|
| | <p>Anlage 9.5</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RüF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F03 | - 0 (without RüF2) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 9.6

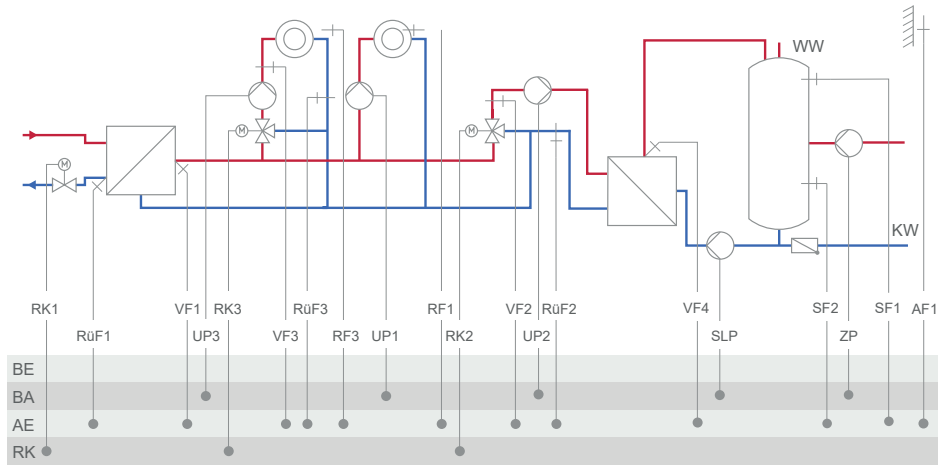

Annex A (configuration instructions)

| System | 9.6 |
|---------------------------|---|
| | <p>Anlage</p> |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RUF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right; margin-right: 20px;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 10.0-1

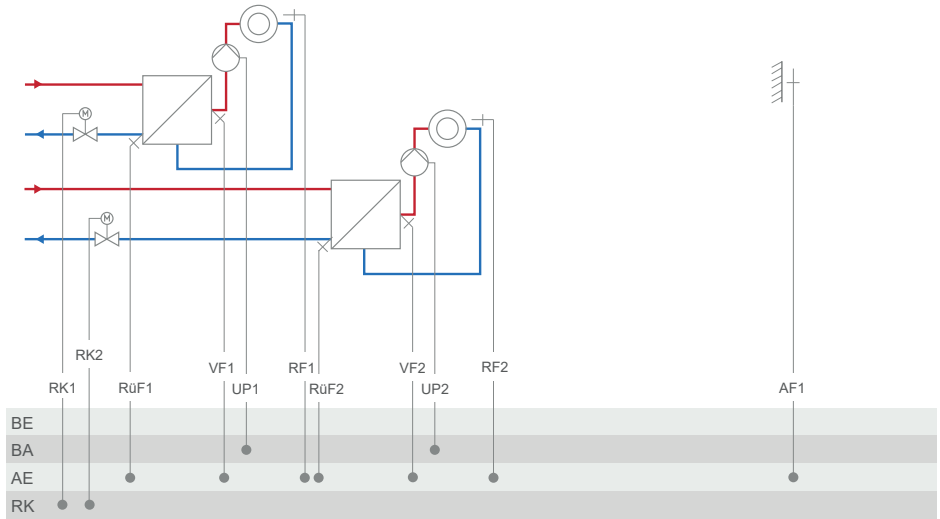

| | |
|---|---|
| System | 10.0-1 |
| | <p>Anlage 10.0-1</p> |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 1 (with RüF2) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> |


Annex A (configuration instructions)

System Anl 10.0-2

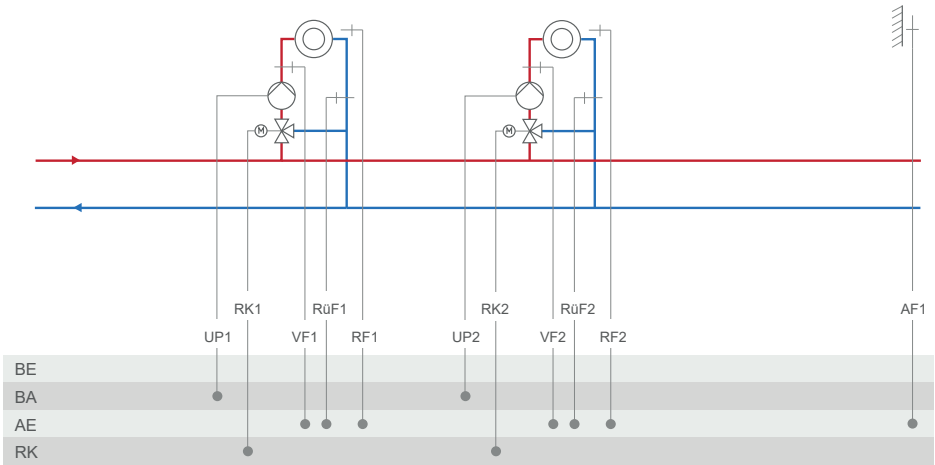

| System | 10.0-2 |
|---|--|
| | Anlage 10.0-2 |
| RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 1 (with RüF2) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - Outdoor temperature |
| | When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output |


System Anl 10.1-1

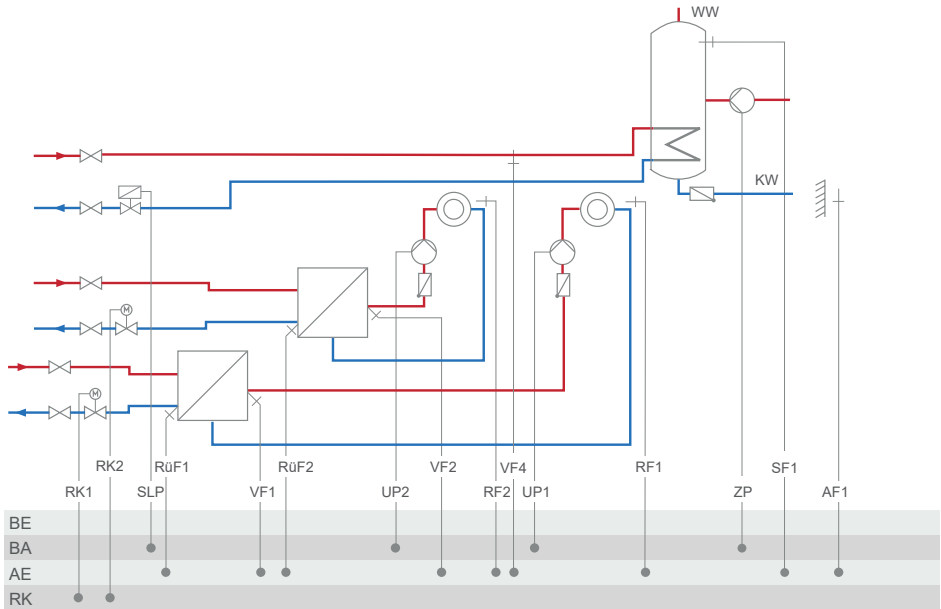


Annex A (configuration instructions)

| System | | 10.1-1 | |
|---|---|---|--|
| | | <p>Anlage 10.1-1</p> | |
| RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 | | | |
| Default setting | | | |
| CO1 -> F01 | - 0 (without RF1) | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 0 (without R F1) | | |
| CO2 -> F01 | - 0 (without RF2) | | |
| CO2 -> F02 | - 1 (with AF1) | | |
| CO2 -> F03 | - 0 (without R F2) | | |
| CO4 -> F01 | - 1 (with SF1) | | |
| CO4 -> F02 | - 0 (without SF2) | | |
| CO4 -> F05 | - 0 (without VF4) | | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 Direction = Output | | |


System Anl 10.1-2

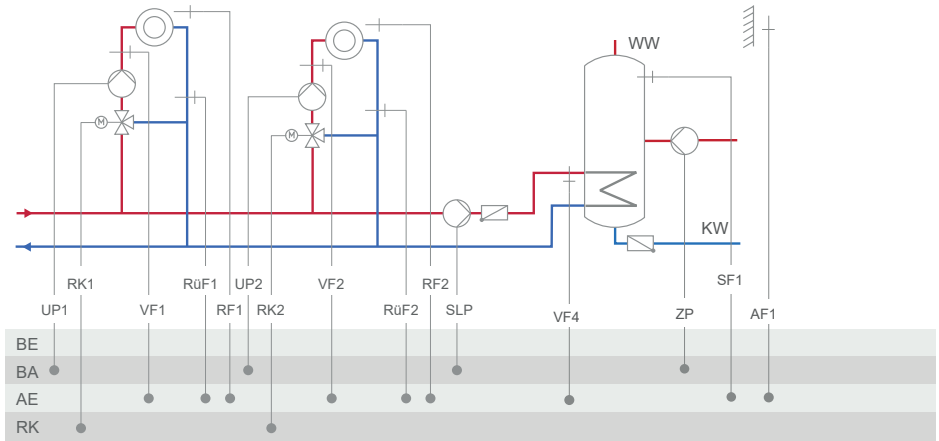


Annex A (configuration instructions)

| System | | 10.1-2 | |
|---|---|---|--|
| | | <p>Anlage</p>  | |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | | |
| Default setting | | | |
| CO1 -> F01 | - 0 (without RF1) | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 0 (without R F1) | | |
| CO2 -> F01 | - 0 (without RF2) | | |
| CO2 -> F02 | - 1 (with AF1) | | |
| CO2 -> F03 | - 0 (without R F2) | | |
| CO4 -> F01 | - 1 (with SF1) | | |
| CO4 -> F02 | - 0 (without SF2) | | |
| CO4 -> F05 | - 0 (without VF4) | | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | | |
| | | When CO1 -> F18 - 1 | |
| | | When CO4 -> F21 - 1 | |
| | | When CO4 -> F25 - 1 | |
| | | When CO5 -> F23 - 1 | |
| | | Direction = Output | |


System Anl 10.2

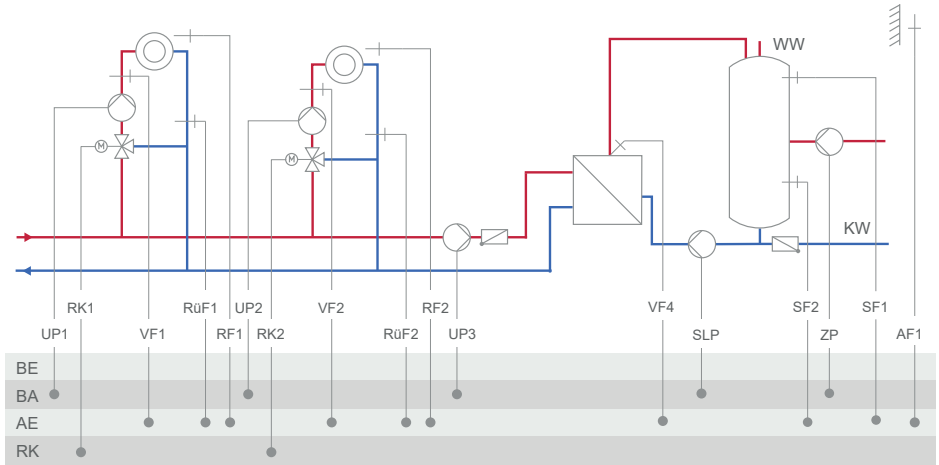

Annex A (configuration instructions)

| System | 10.2 |
|---|--|
| | <p>Anlage</p>  |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 0 (without R F1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without R F2) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F05 | - 0 (without VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |

System Anl 10.3-1

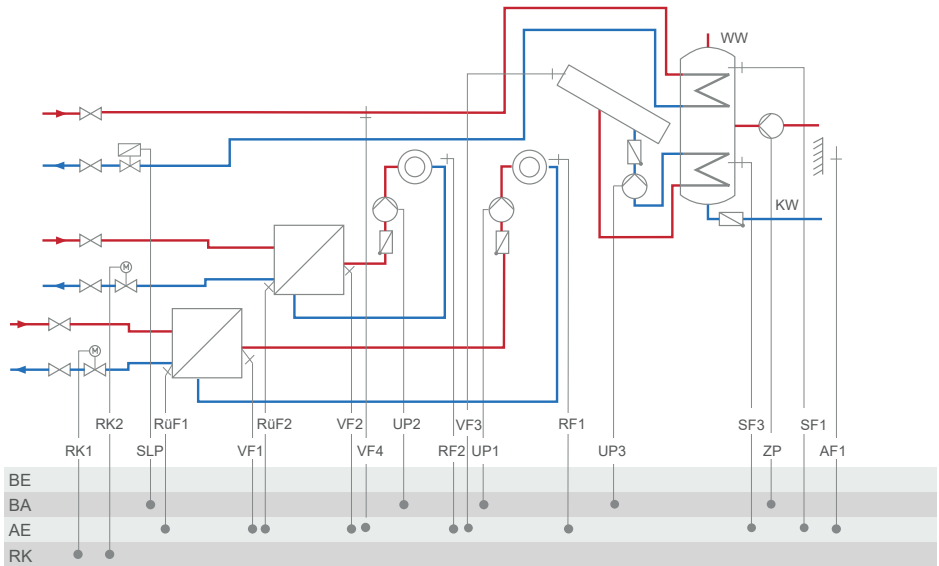


Annex A (configuration instructions)

| System | | 10.3-1 | |
|---|--|---|---|
| | | <p>Anlage</p> | |
| RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 | | | |
| Default setting | | | |
| CO1 -> F01 | | - 0 (without RF1) | |
| CO1 -> F02 | | - 1 (with AF1) | |
| CO1 -> F03 | | - 0 (without R F1) | |
| CO2 -> F01 | | - 0 (without RF2) | |
| CO2 -> F02 | | - 1 (with AF1) | |
| CO2 -> F03 | | - 0 (without R F2) | |
| CO4 -> F01 | | - 1 (with SF1) | |
| CO4 -> F02 | | - 0 (without SF2) | |
| CO4 -> F05 | | - 0 (without VF4) | |
| CO5 -> F07 | | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - ZP speed - Outdoor temperature | |
| | | | When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |

Annex A (configuration instructions)

| System | | 10.3-2 | |
|---|---|---------------------|--|
| | | <p>Anlage</p> | |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | | |
| Default setting | | | |
| CO1 -> F01 | - 0 (without RF1) | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 0 (without R F1) | | |
| CO2 -> F01 | - 0 (without RF2) | | |
| CO2 -> F02 | - 1 (with AF1) | | |
| CO2 -> F03 | - 0 (without R F2) | | |
| CO4 -> F01 | - 1 (with SF1) | | |
| CO4 -> F02 | - 0 (without SF2) | | |
| CO4 -> F05 | - 0 (without VF4) | | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | | |
| | | When CO1 -> F18 - 1 | |
| | | When CO4 -> F21 - 1 | |
| | | When CO4 -> F25 - 1 | |
| | | When CO5 -> F23 - 1 | |
| | | Direction = Output | |


System Anl 10.5

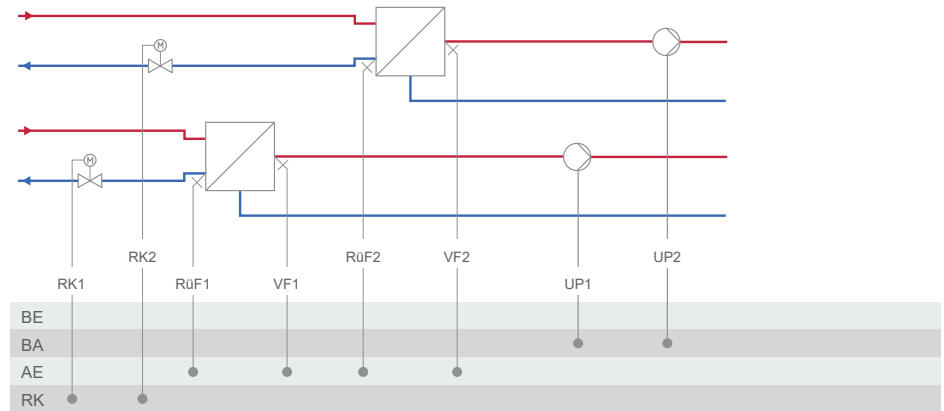

| | |
|---------------------------|--|
| System | 10.5 |
| | <p>Anlage 10.5</p> |
| Default setting | |
| CO1 -> F02 | - 0 (without AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F02 | - 0 (without AF1) |
| CO2 -> F03 | - 1 (with RüF2) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand <p style="text-align: right;">When CO1 -> F18 - 1</p> |


Annex A (configuration instructions)

System Anl 11.0

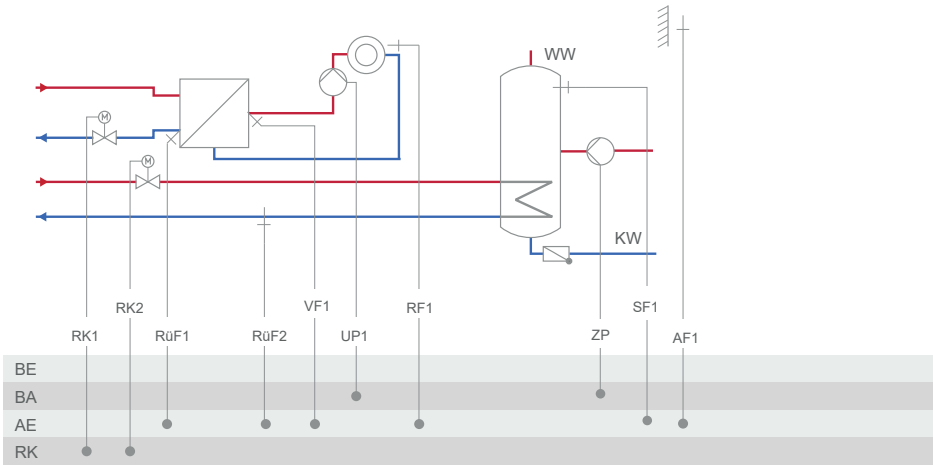

| | | |
|---------------------------|---|--------|
| System | 11.0 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F03 | - 0 (without RUF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - ZP speed - Outdoor temperature | |
| | When CO1 -> F18 | - 1 |
| | When CO4 -> F25 | - 1 |
| | When CO5 -> F23 | - 1 |
| | Direction = | Output |


System Anl 11.1-1

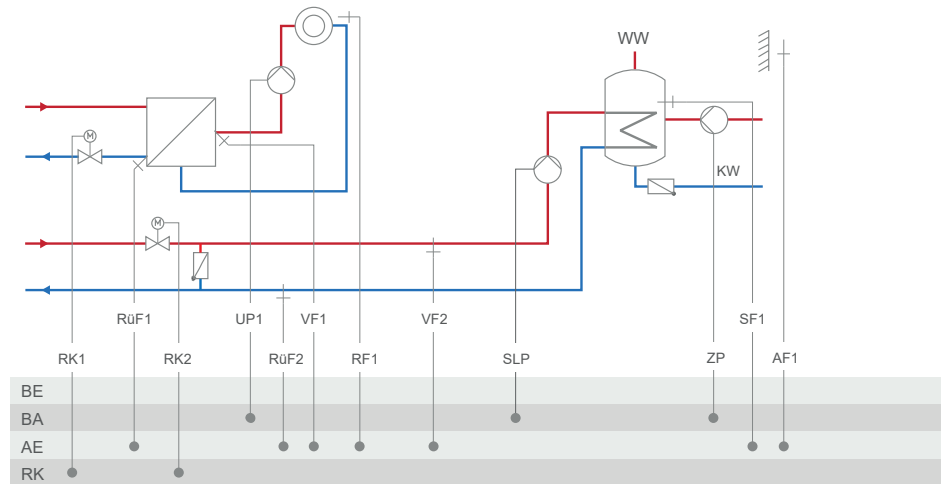

| | | |
|---------------------------|---|--|
| System | 11.1-1 | |
| | Anlage | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO4 -> F03 | - 0 (without RüF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


Annex A (configuration instructions)


System Anl 11.1-2

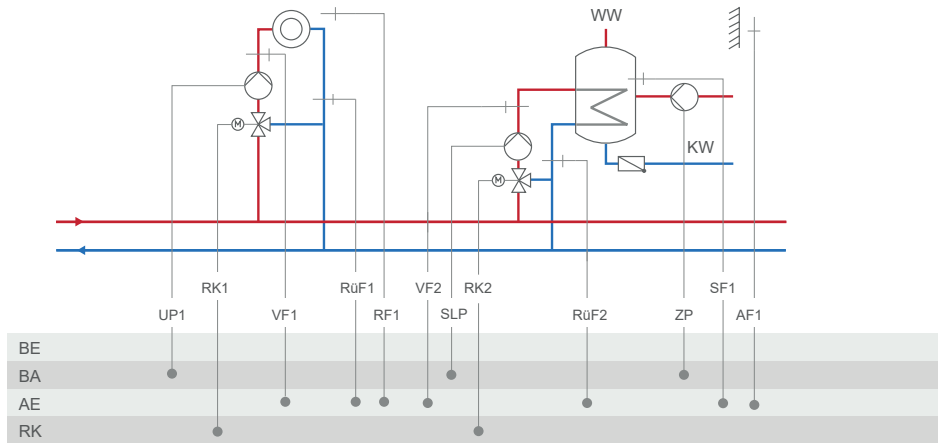

| System | 11.1-2 |
|---------------------------|---|
| | Anlage 11.1-2 |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO1 -> F18 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div></div> <div>When CO4 -> F21 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div></div> <div>When CO4 -> F25 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div></div> <div>When CO5 -> F23 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div></div> <div>Direction = Output</div> </div> |


System Anl 11.1-3

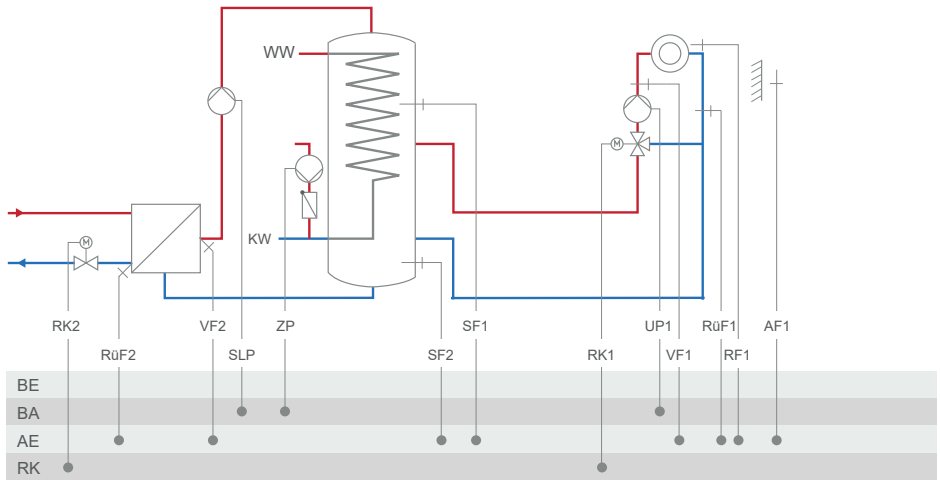

| | | |
|---------------------------|--|--|
| System | 11.1-3 | |
| | Anlage  | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO4 -> F03 | - 0 (without RüF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


Annex A (configuration instructions)

System Anl 11.2-1

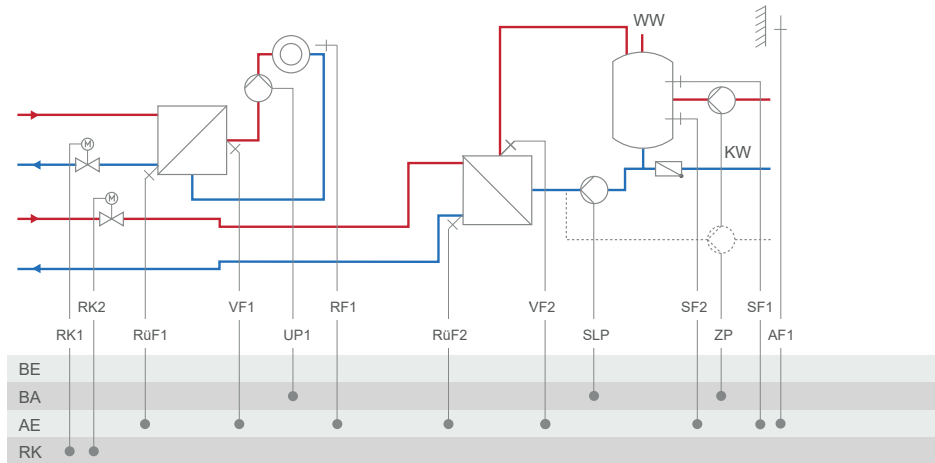

| | | |
|---------------------------|---|--|
| System | 11.2-1 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F03 | - 0 (without RUF2) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


System Anl 11.2-2

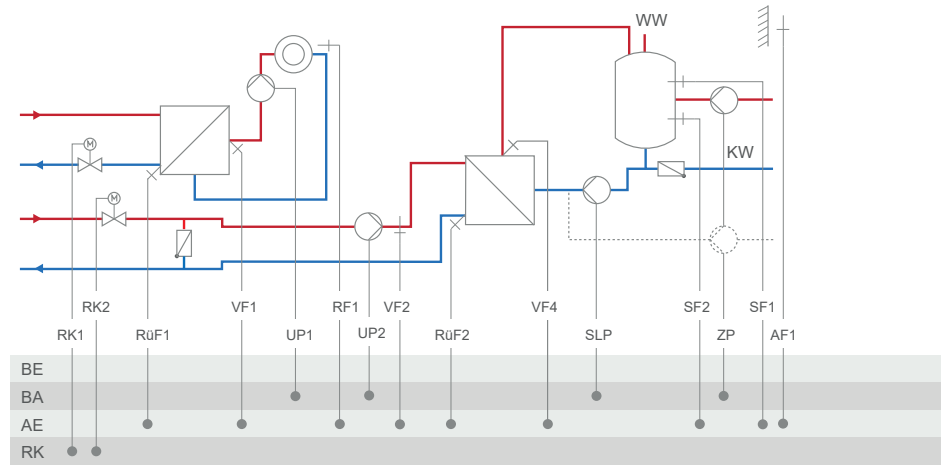


| System | 11.2-2 |
|---------------------------|--|
| | <p>Anlage </p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output</p> |

Annex A (configuration instructions)


System Anl 11.2-3

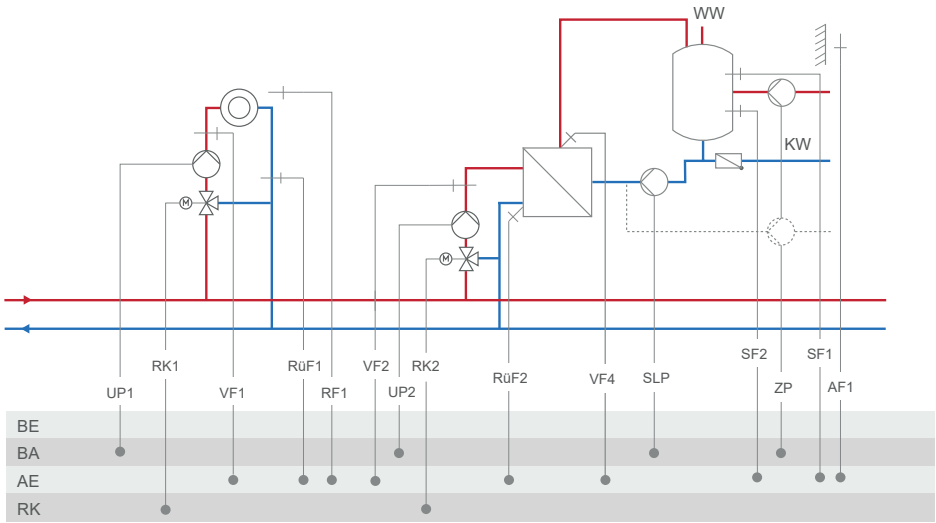

| | | |
|---------------------------|---|---|
| System | 11.2-3 | |
| | <p>Anlage </p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with R F1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F03 | - 0 (without R F2) | |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | <p>When CO1 -> F18 - 1</p> <p>When CO4 -> F21 - 1</p> <p>When CO4 -> F25 - 1</p> <p>When CO5 -> F23 - 1</p> <p>Direction = Output</p> |


Annex A (configuration instructions)

System Anl 11.3

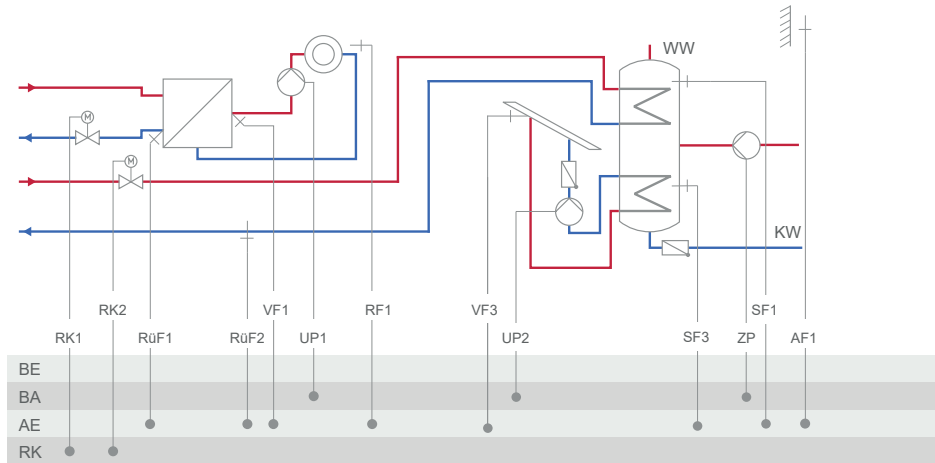

| | | |
|---------------------------|---|--|
| System | 11.3 | |
| | <p>Anlage 11.3</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO4 -> F03 | - 0 (without RüF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - ZP speed - Outdoor temperature | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F25 - 1 | |
| | When CO5 -> F23 - 1 | |
| | Direction = Output | |


System Anl 11.4

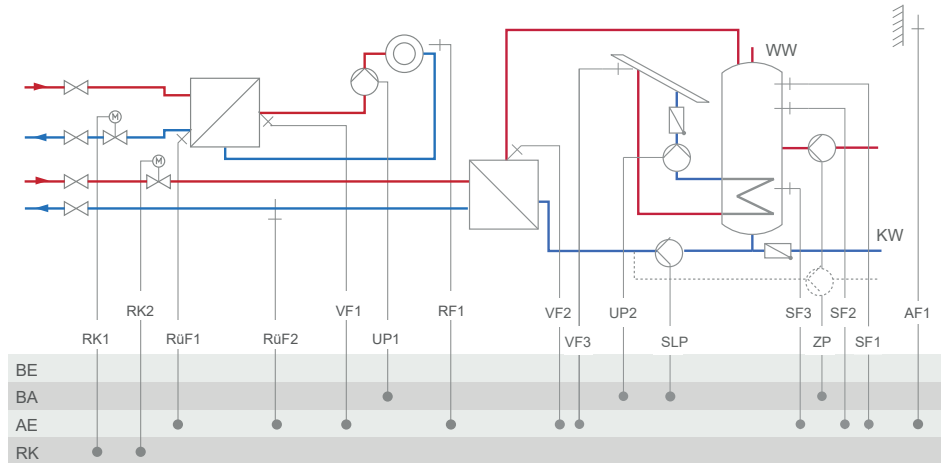

| | | |
|---------------------------|--|--|
| System | 11.4 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | -1 (with SF2) | |
| CO4 -> F03 | - 0 (without RUF2) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | When CO1 -> F18 - 1 | |
| | When CO4 -> F21 - 1 | |
| | When CO4 -> F25 - 1 | |
| | When CO5 -> F23 - 1 | |
| | Direction = Output | |


Annex A (configuration instructions)

System Anl 11.5

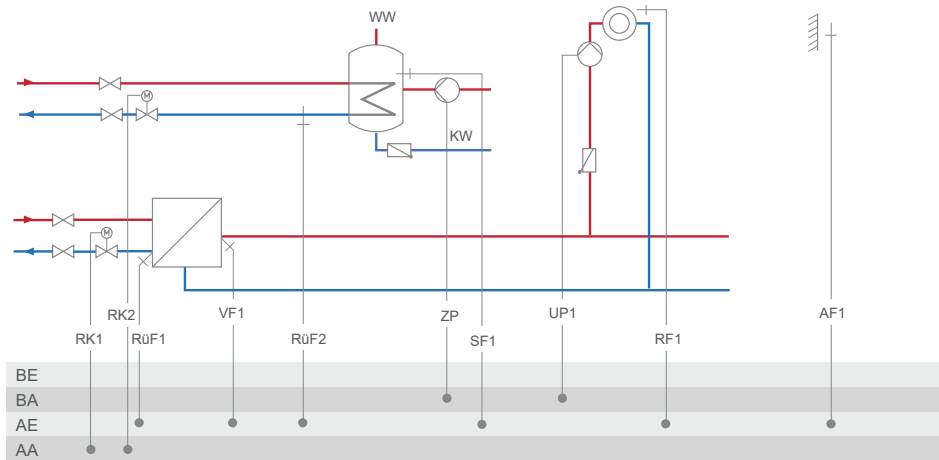

| | |
|---------------------------|--|
| System | 11.5 |
| | <p>Anlage 11.5</p> |
| Note: | DHW circuit with adjustable valve position for storage tank charging in absolute priority operation. By using RüF2, the ready-adjusted valve position is subject to the return flow temperature limitation. |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F03 | - 1 (with RüF2) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - ZP speed - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output</p> |


System Anl 11.6-1

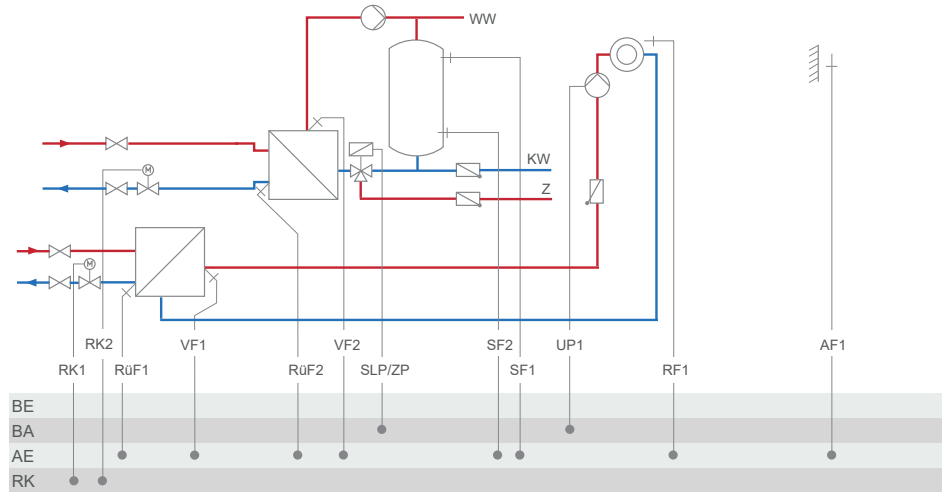

| | |
|---------------------------|---|
| System | 11.6-1 |
| | <p>Anlage 11.6-1</p> |
| Note: | Install a continuously running pump in the DHW circuit and connect it directly to the supply voltage. |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> |


Annex A (configuration instructions)

System Anl 11.6-2

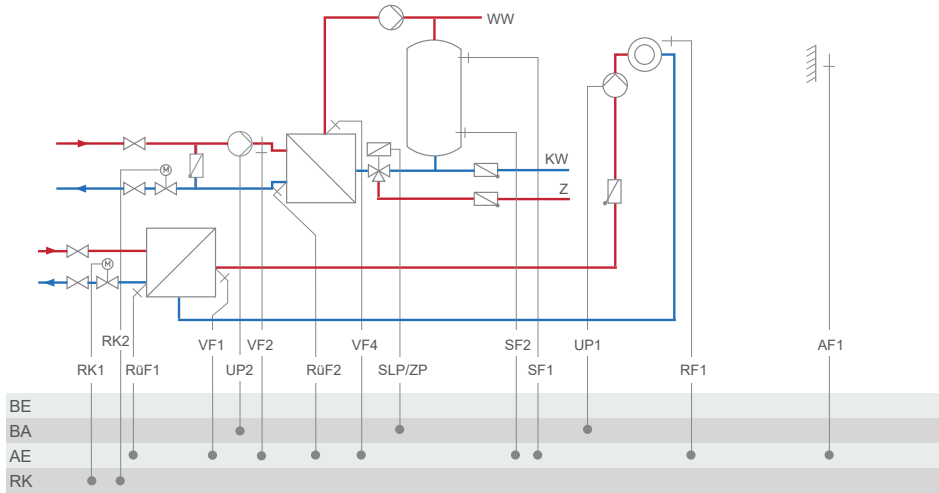

| | |
|---------------------------|---|
| System | 11.6-2 |
| | <p>Anlage </p> |
| Note: | Install a continuously running pump in the DHW circuit and connect it directly to the supply voltage. |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> |


System Anl 11.9-1

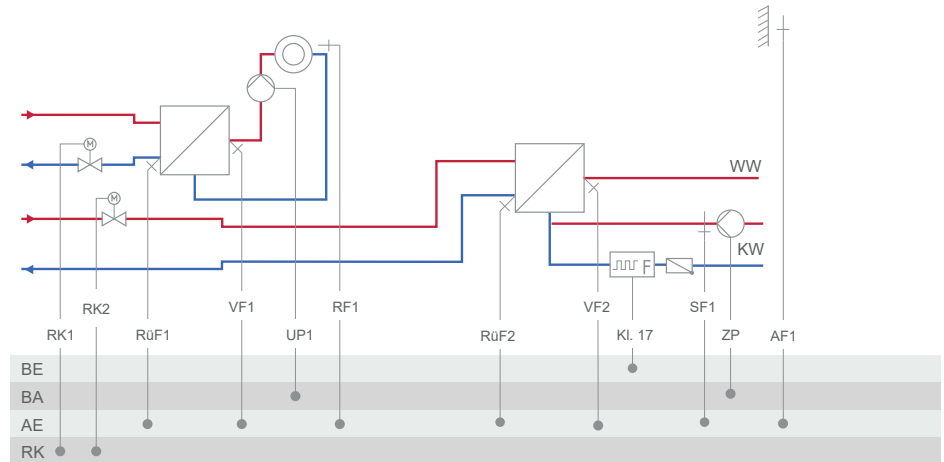

| System | 11.9-1 |
|---------------------------|--|
| | <p>Anlage 11.9-1</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO4 -> F01 | - 0 (without SF1) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F04 | - 0 (without flow rate sensor) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - 10 V supply - External demand - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


Annex A (configuration instructions)

System Anl 11.9-2

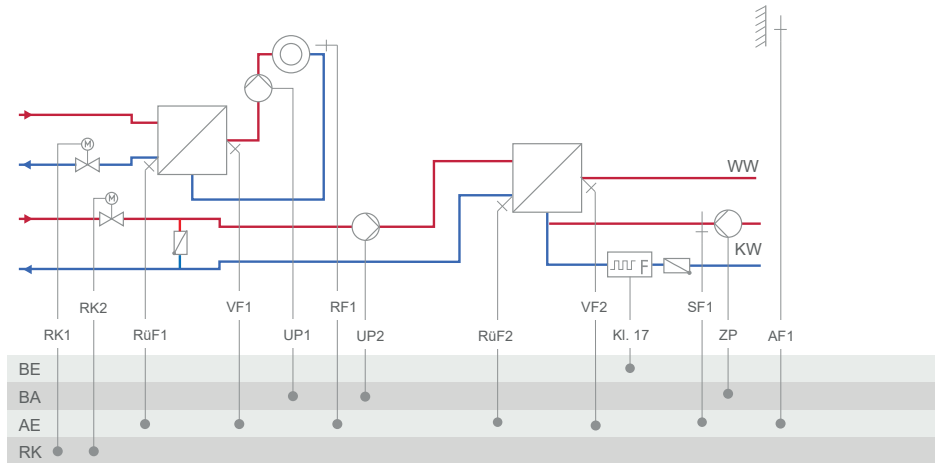

| | | |
|---------------------------|--|---|
| System | 11.9-2 | |
| | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F01 | - 0 (without SF1) | |
| CO4 -> F03 | - 0 (without RUF2) | |
| CO4 -> F04 | - 0 (without flow rate sensor) | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - 10 V supply - External demand - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


System Anl 12.0

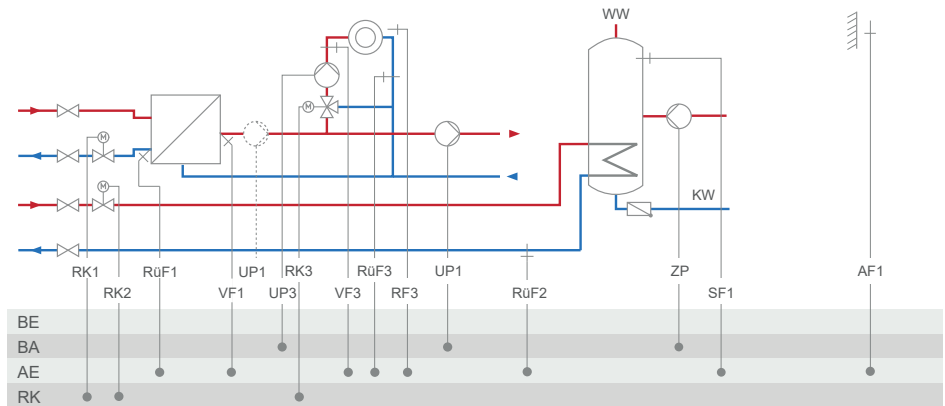

| System | 12.0 |
|---|---|
| | <p>Anlage 12.0</p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RüF3) |
| CO4 -> F03 | - 0 (without RüF2) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - ZP speed - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output</p> |

Annex A (configuration instructions)


System Anl 12.1

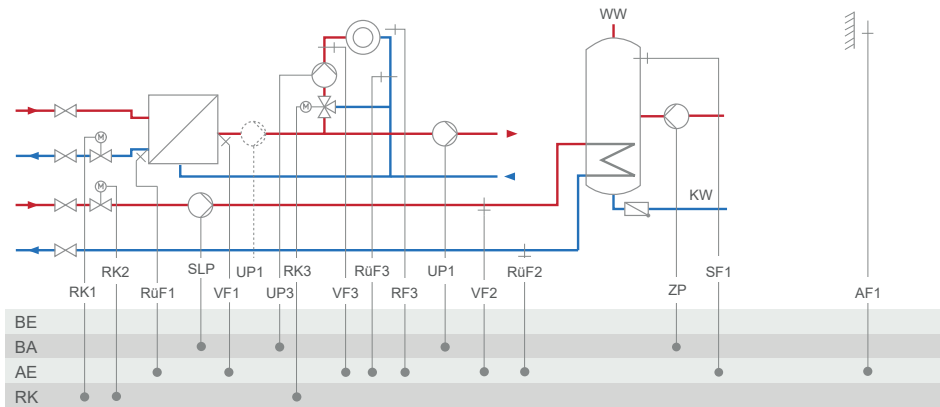

| System | | 12.1 | |
|---|---|---|--|
| | | <p>Anlage 12.1</p> | |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | | |
| Default setting | | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 1 (with RUF1) | | |
| CO3 -> F01 | - 0 (without RF3) | | |
| CO3 -> F02 | - 1 (with AF1) | | |
| CO3 -> F03 | - 0 (without RUF3) | | |
| CO4 -> F01 | - 1 (with SF1) | | |
| CO4 -> F02 | - 0 (without SF2) | | |
| CO4 -> F03 | - 0 (without RUF2) | | |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) | | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | | |

Annex A (configuration instructions)


System Anl 12.2-1

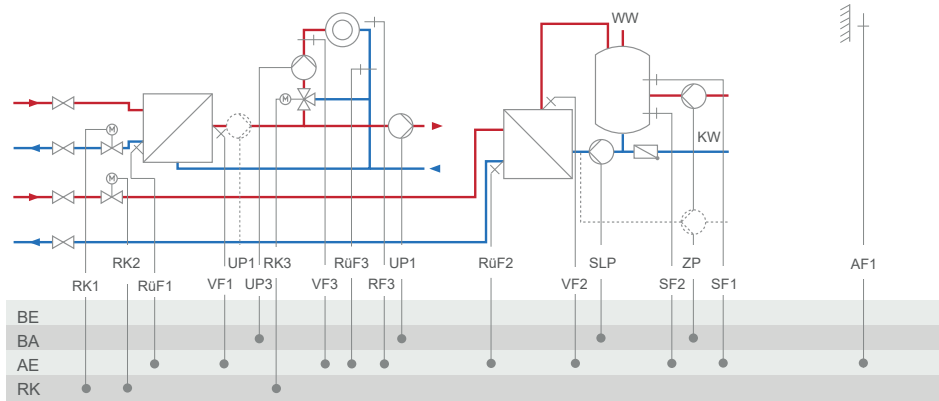

| | | |
|---------------------------|---|--|
| System | 12.2-1 | |
| | <p>Anlage 12.2-1</p> | |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO3 -> F01 | - 0 (without RF3) | |
| CO3 -> F02 | - 1 (with AF1) | |
| CO3 -> F03 | - 0 (without RUF3) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F03 | - 0 (without RUF2) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | |

Annex A (configuration instructions)


System Anl 12.2-2

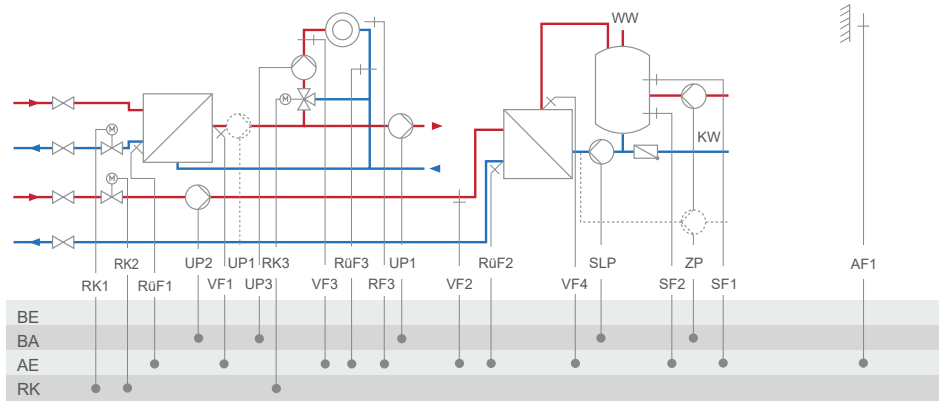

| | | |
|---------------------------|---|--|
| System | 12.2-2 | |
| | <p>Anlage 12.2-2</p> | |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO3 -> F01 | - 0 (without RF3) | |
| CO3 -> F02 | - 1 (with AF1) | |
| CO3 -> F03 | - 0 (without RUF3) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F03 | - 0 (without RUF2) | |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | |

Annex A (configuration instructions)


System Anl 12.9-1

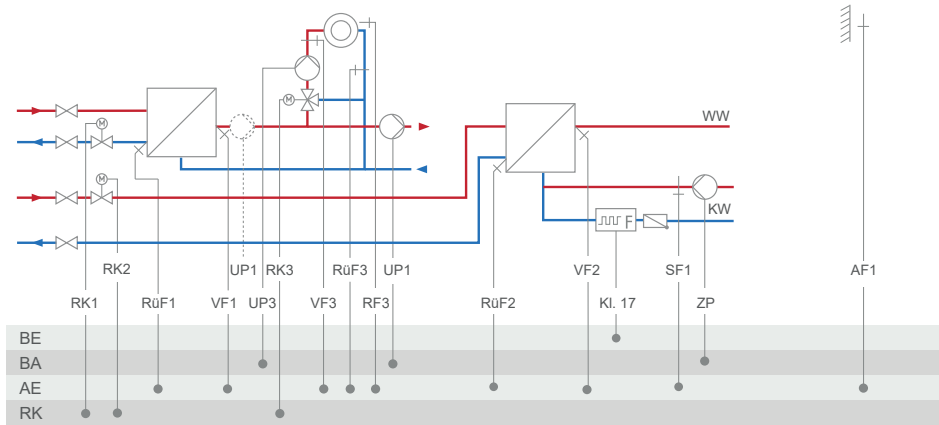

| System | | 12.9-1 | |
|---|--|--|--|
| | | <p>Anlage 12.9-1</p> | |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | | |
| Default setting | | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 1 (with RÜF1) | | |
| CO3 -> F01 | - 0 (without RF3) | | |
| CO3 -> F02 | - 1 (with AF1) | | |
| CO3 -> F03 | - 0 (without RÜF3) | | |
| CO4 -> F01 | - 0 (without SF1) | | |
| CO4 -> F03 | - 0 (without RÜF2) | | |
| CO4 -> F04 | - 0 (without flow rate sensor) | | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | | |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) | | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - 10 V supply - External demand - ZP speed - Outdoor temperature | | |
| | | When CO1 -> F18 - 1 | |
| | | When CO4 -> F25 - 1 | |
| | | When CO5 -> F23 - 1 | |
| | | Direction = Output | |

Annex A (configuration instructions)


System Anl 12.9-2

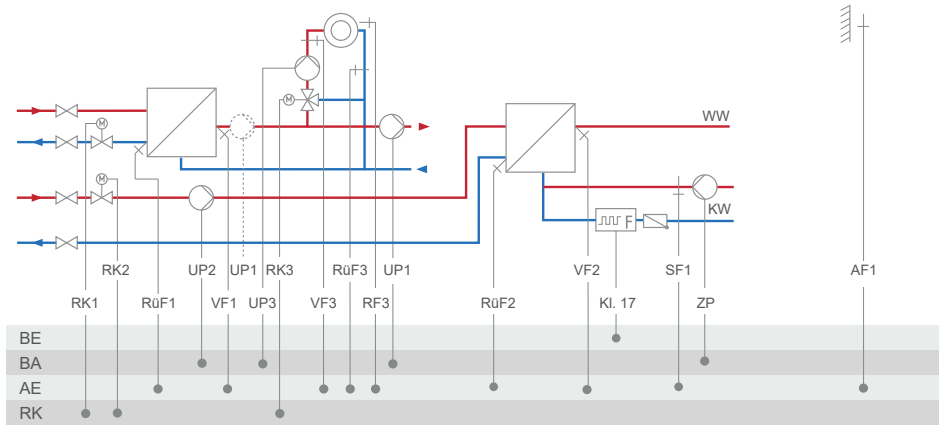

| System | | 12.9-2 | |
|---|---|--|--|
| | | <p>Anlage 12.9-2</p> | |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | | |
| Default setting | | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 1 (with RÜF1) | | |
| CO3 -> F01 | - 0 (without RF3) | | |
| CO3 -> F02 | - 1 (with AF1) | | |
| CO3 -> F03 | - 0 (without RÜF3) | | |
| CO4 -> F01 | - 0 (without SF1) | | |
| CO4 -> F03 | - 0 (without RÜF2) | | |
| CO4 -> F04 | - 0 (without flow rate sensor) | | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | | |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) | | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - 10 V supply - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | | |

Annex A (configuration instructions)


System Anl 13.0

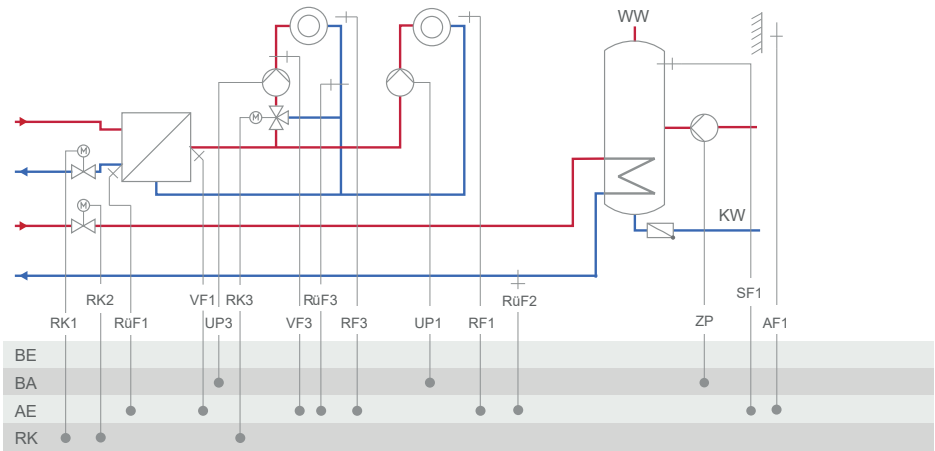

| | | |
|---------------------------|--|--|
| System | 13.0 | |
| | <p>Anlage 13.0</p> | |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO3 -> F01 | - 0 (without RF3) | |
| CO3 -> F02 | - 1 (with AF1) | |
| CO3 -> F03 | - 0 (without RüF3) | |
| CO4 -> F03 | - 0 (without RüF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | |

Annex A (configuration instructions)


System Anl 13.1

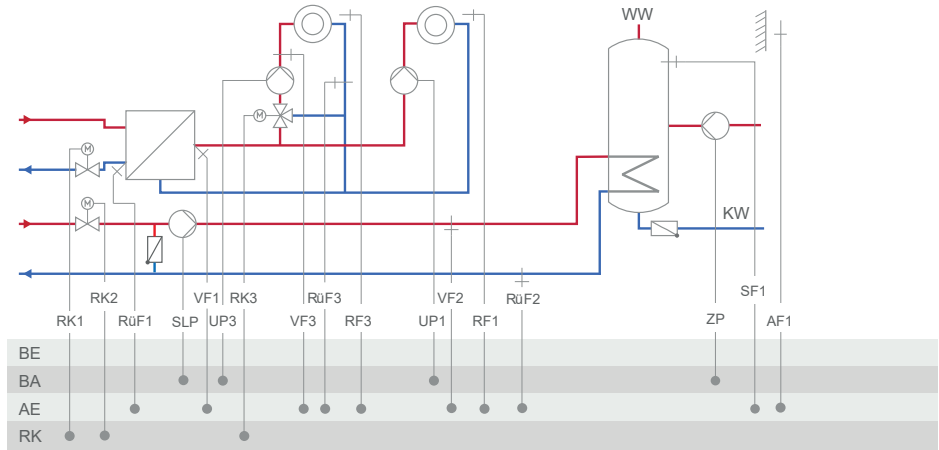

| System | | 13.1 | |
|---|---|--|--|
| | | <p>Anlage 13.1</p> | |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | | |
| Default setting | | | |
| CO1 -> F01 | - 0 (without RF1) | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 1 (with RüF1) | | |
| CO3 -> F01 | - 0 (without RF3) | | |
| CO3 -> F02 | - 1 (with AF1) | | |
| CO3 -> F03 | - 0 (without RüF3) | | |
| CO4 -> F01 | - 1 (with SF1) | | |
| CO4 -> F02 | - 0 (without SF2) | | |
| CO4 -> F03 | - 0 (without RüF2) | | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | | |

Annex A (configuration instructions)


System Anl 13.2-1

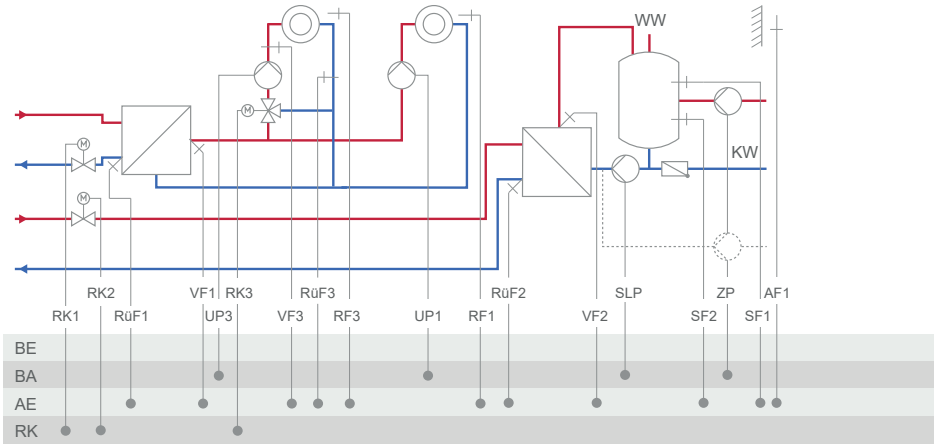


| | | |
|---------------------------|---|--|
| System | 13.2-1 | |
| | <p>Anlage 13.2-1</p> | |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO3 -> F01 | - 0 (without RF3) | |
| CO3 -> F02 | - 1 (with AF1) | |
| CO3 -> F03 | - 0 (without RüF3) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F03 | - 0 (without RüF2) | |
| CO4 -> F04 | - 0 (without flow rate sensor) | |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | |

Annex A (configuration instructions)


System Anl 13.2-2

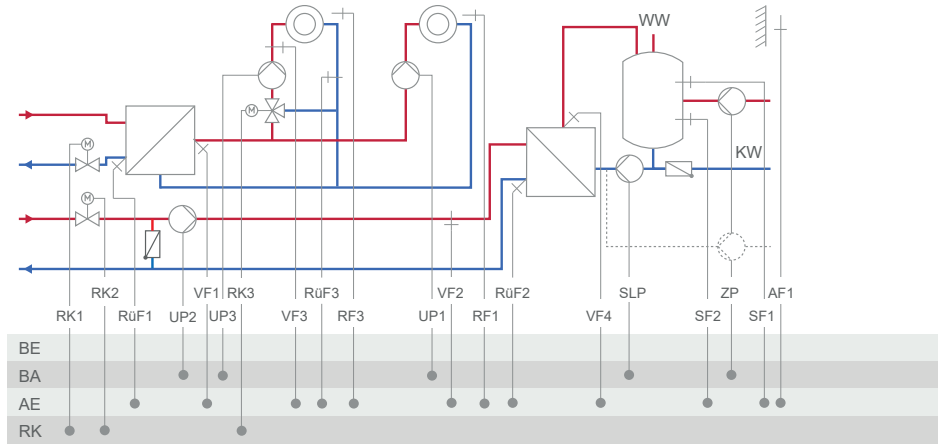


| System | 13.2-2 |
|---|---|
| | <p>Anlage </p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with R F1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without R F3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without R F2) |
| CO4 -> F04 | - 0 (without flow rate sensor) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |

Annex A (configuration instructions)


System Anl 13.6-1

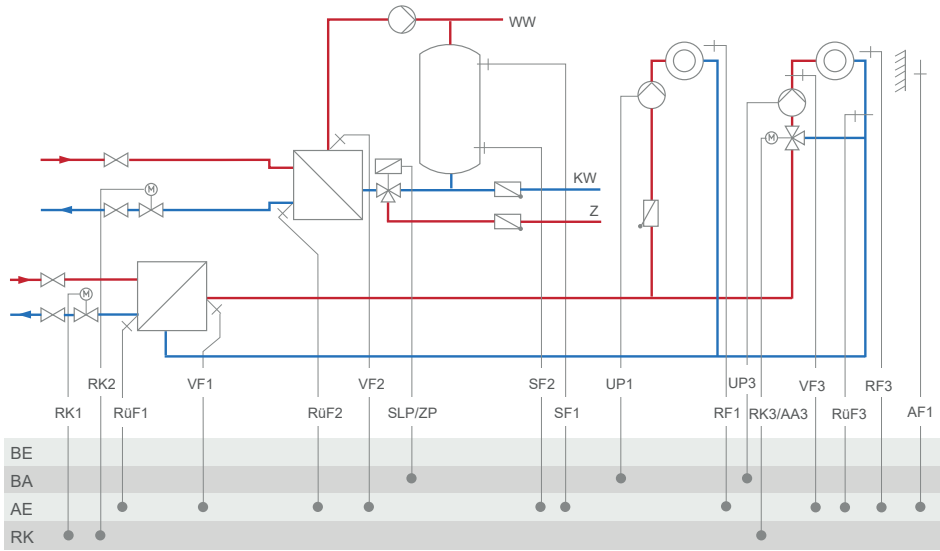

| | | |
|---------------------------|---|---|
| System | 13.6-1 | |
| | <p>Anlage </p> | |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Note: | <p>Install a continuously running pump in the DHW circuit and connect it directly to the supply voltage.</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO3 -> F01 | - 0 (without RF3) | |
| CO3 -> F02 | - 1 (with AF1) | |
| CO3 -> F03 | - 0 (without R F3) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO4 -> F03 | - 0 (without R F2) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - Outdoor temperature | |
| | | <p>When CO1 -> F18 - 1</p> <p>When CO5 -> F23 - 1</p> <p>Direction = Output</p> |

Annex A (configuration instructions)


System Anl 13.6-2

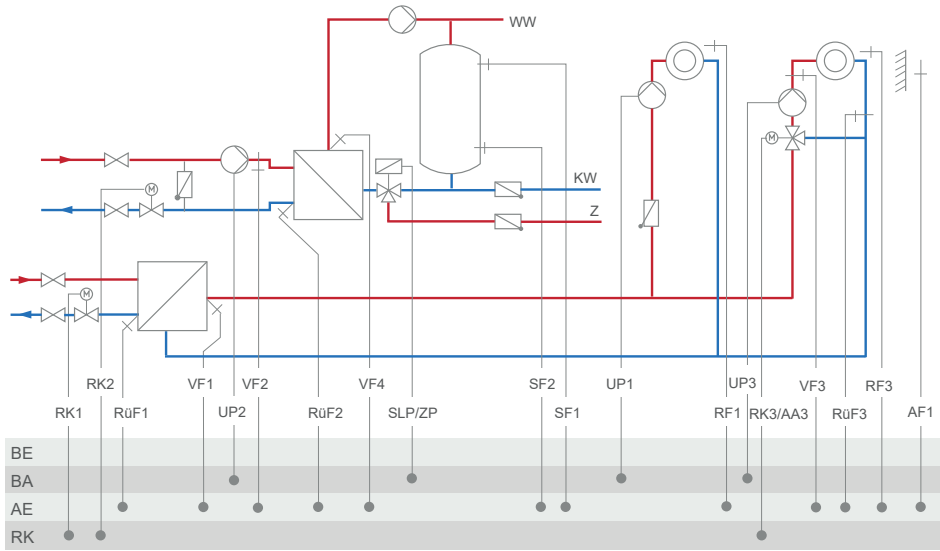


| | |
|---------------------------|--|
| System | 13.6-2 |
| | <p>Anlage 13.6-2</p> |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> |
| Note: | Install a continuously running pump in the DHW circuit and connect it directly to the supply voltage. |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without R F3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without R F2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> |

Annex A (configuration instructions)


System Anl 13.9-1

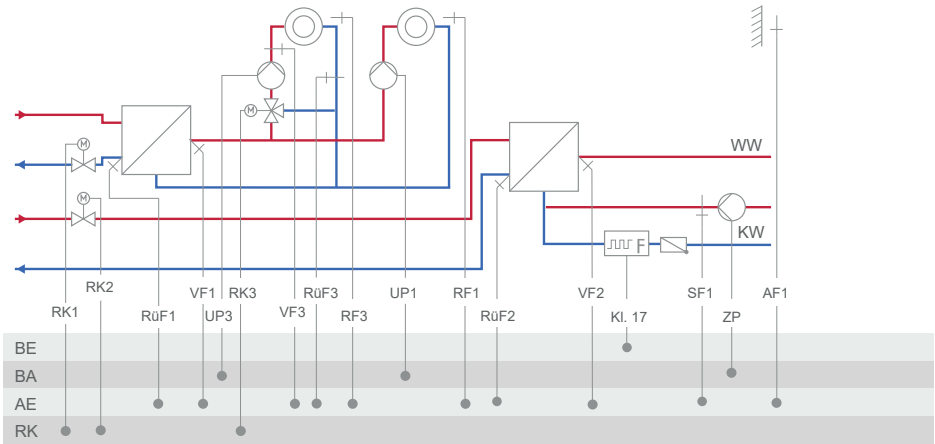

| System | | 13.9-1 | |
|---|--|---|---|
| | | <p>Anlage </p> | |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | | |
| Default setting | | | |
| CO1 -> F01 | - 0 (without RF1) | | |
| CO1 -> F02 | - 1 (with AF1) | | |
| CO1 -> F03 | - 1 (with RüF1) | | |
| CO3 -> F01 | - 0 (without RF3) | | |
| CO3 -> F02 | - 1 (with AF1) | | |
| CO3 -> F03 | - 0 (without RüF3) | | |
| CO4 -> F01 | - 0 (without SF1) | | |
| CO4 -> F03 | - 0 (without RüF2) | | |
| CO4 -> F04 | - 0 (without flow rate sensor) | | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - 10 V supply - External demand - ZP speed - Outdoor temperature | | |
| | | | <p>When CO1 -> F18 - 1</p> <p>When CO4 -> F25 - 1</p> <p>When CO5 -> F23 - 1</p> <p>Direction = Output</p> |

Annex A (configuration instructions)


System Anl 13.9-2

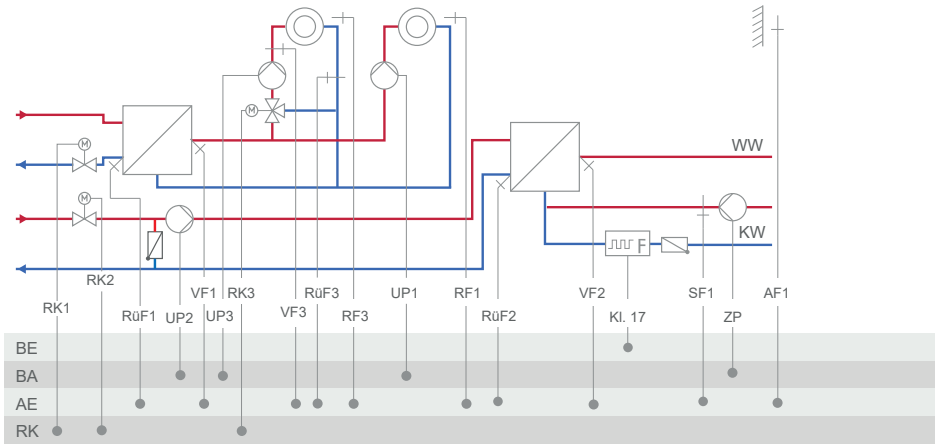

| | | |
|---------------------------|---|--|
| System | 13.9-2 | |
| | <p>Anlage 13.9-2</p> | |
| | <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with R F1) | |
| CO3 -> F01 | - 0 (without RF3) | |
| CO3 -> F02 | - 1 (with AF1) | |
| CO3 -> F03 | - 0 (without R F3) | |
| CO4 -> F01 | - 0 (without SF1) | |
| CO4 -> F03 | - 0 (without R F2) | |
| CO4 -> F04 | - 0 (without flow rate sensor) | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - 10 V supply - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | |


Annex A (configuration instructions)

System Anl 14.1

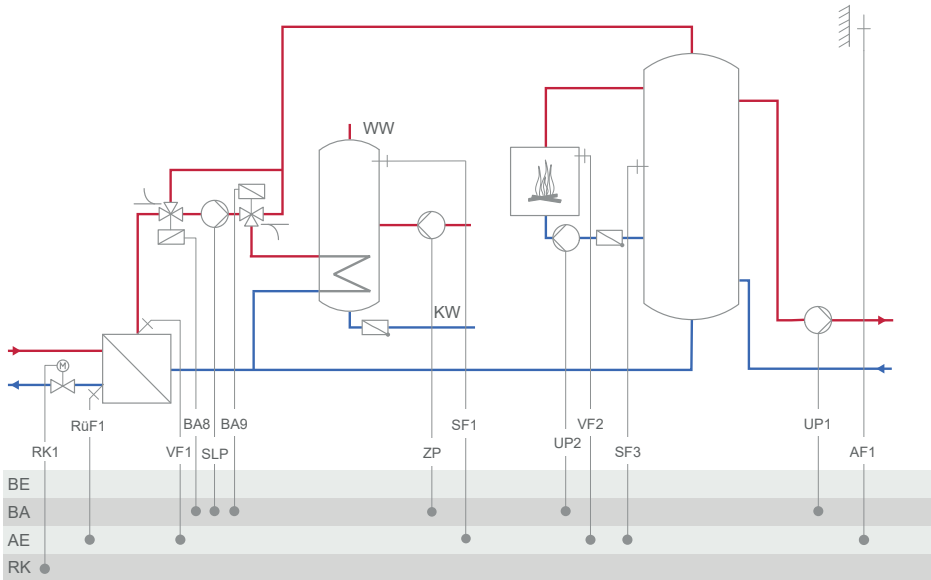

| | | |
|---------------------------|---|---|
| System | 14.1 | |
| | Anlage 14.1 | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 0 (without SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - External demand - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


System Anl 14.2

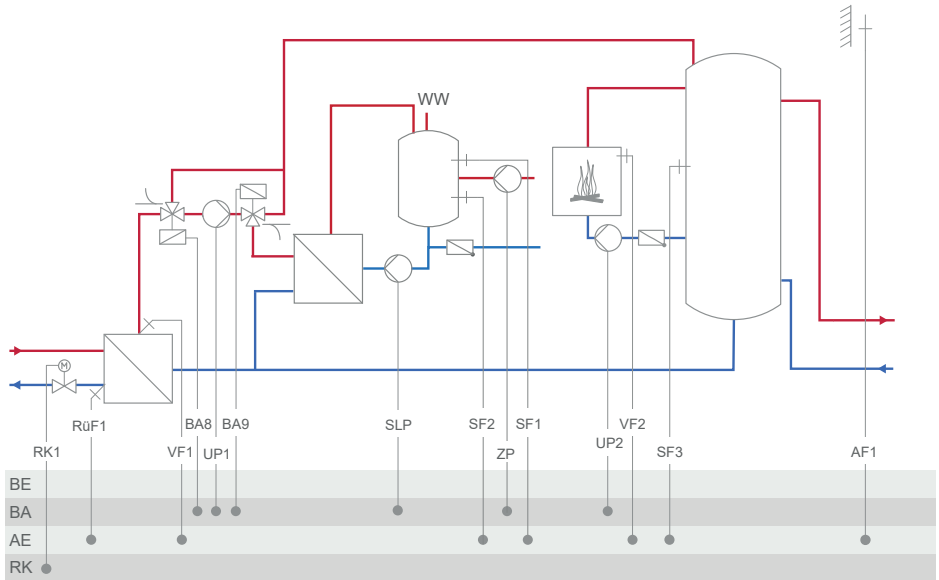

| | | |
|---------------------------|--|--|
| System | 14.2 | |
| | Anlage 14.2 | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO4 -> F01 | - 1 (with SF1) | |
| CO4 -> F02 | - 1 (with SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 46) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - SLP speed - ZP speed - Outdoor temperature | |
| | | When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output |


Annex A (configuration instructions)

System Anl 14.3

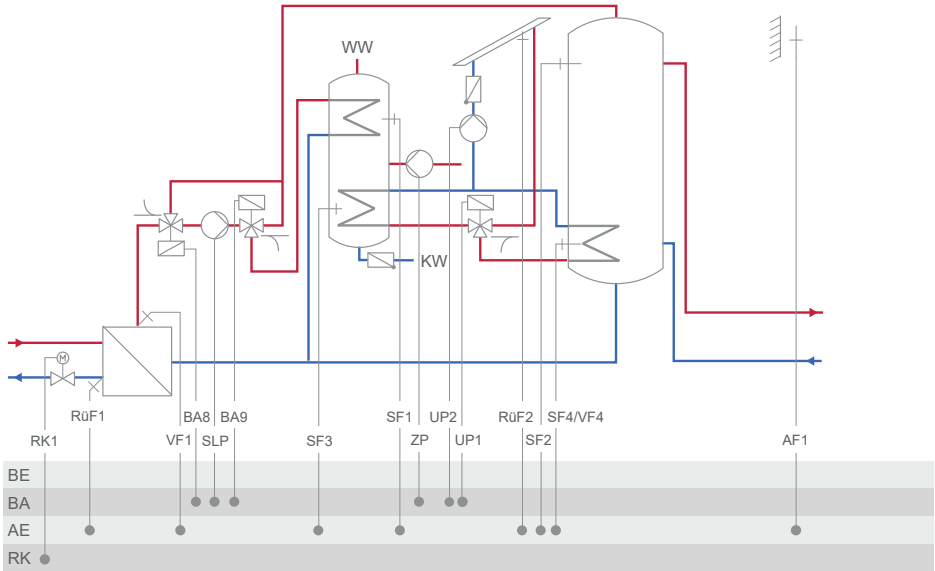

| System | 14.3 |
|---------------------------|---|
| | <p>Anlage 14.3</p> |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO4 -> F01 | - 1 (with SF1) |
| CO5 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - External demand - ZP speed - Outdoor temperature <div style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </div> |


System Anl 15.0

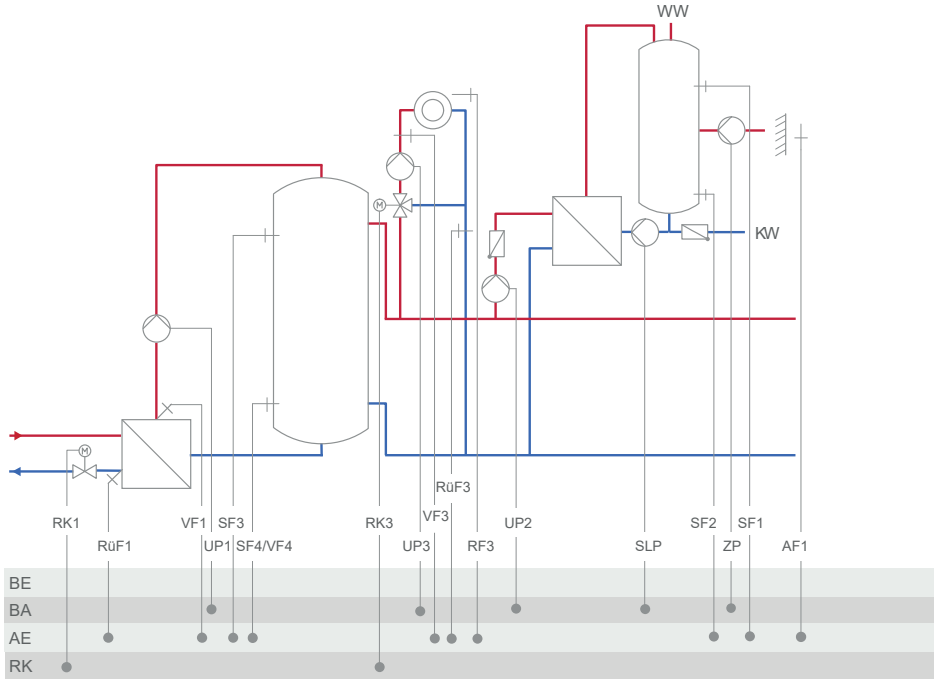


Annex A (configuration instructions)

| | |
|---|--|
| System | 15.0 |
| | <p>Anlage 15.0</p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RUF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 15.1

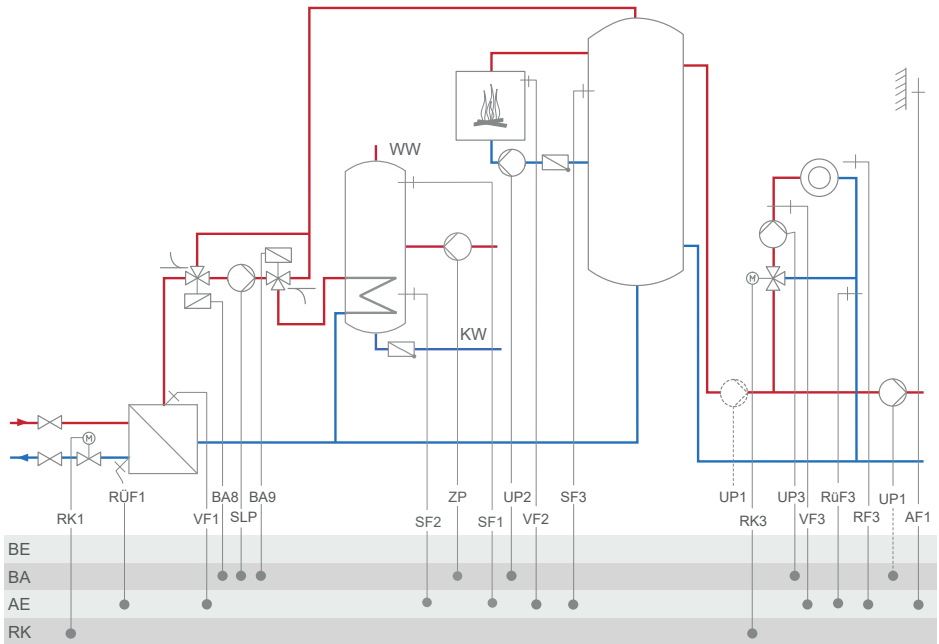


Annex A (configuration instructions)

| System | |
|---|---|
| | <p>15.1</p> <p>Anlage </p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RUF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO5 -> F14 | - 0 (UP1 only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - External demand - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 15.2

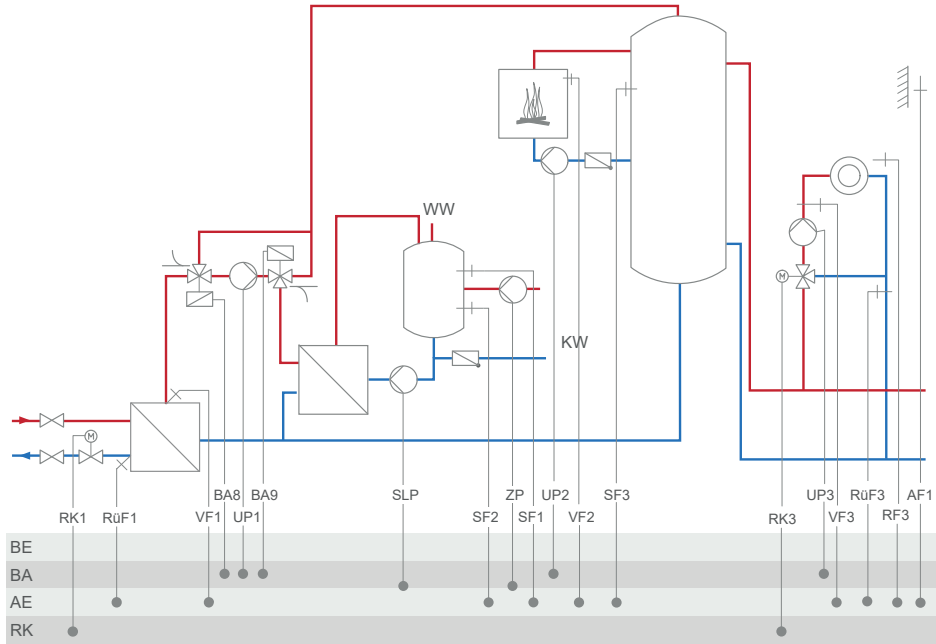

Annex A (configuration instructions)

| System | 15.2 |
|---|--|
| | <p>Anlage 15.2</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RÜF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 15.3

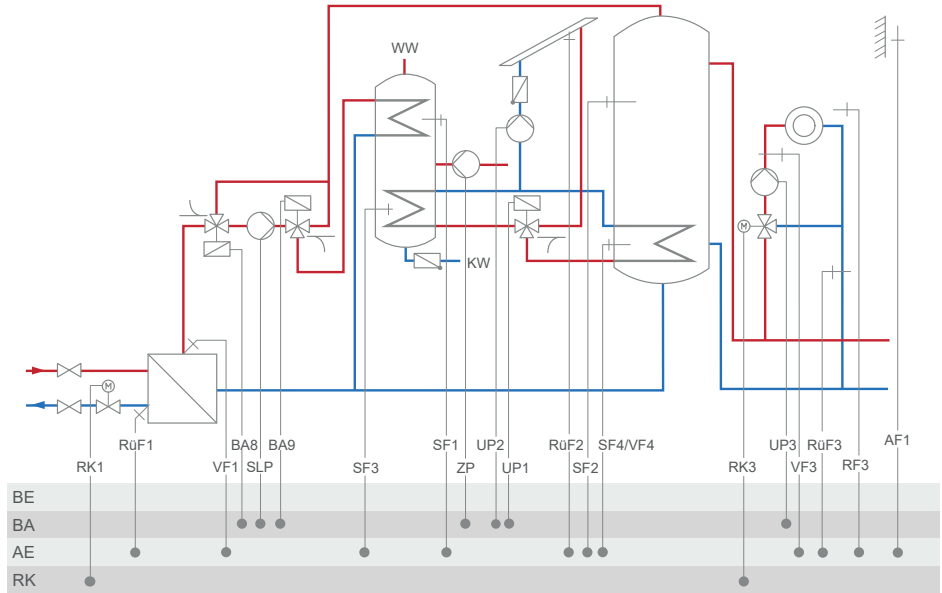


Annex A (configuration instructions)

| | |
|---|---|
| System | 15.3 |
| | <p>Anlage</p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RÜF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - External demand - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 15.4

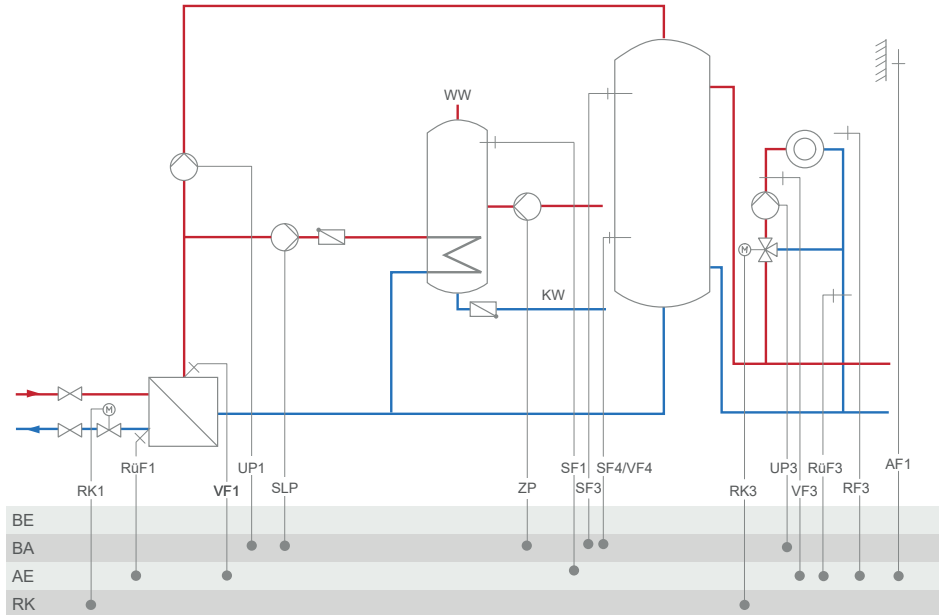


Annex A (configuration instructions)

| | |
|---|--|
| System | 15.4 |
| | <p>Anlage 15.4</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RÜF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 15.5

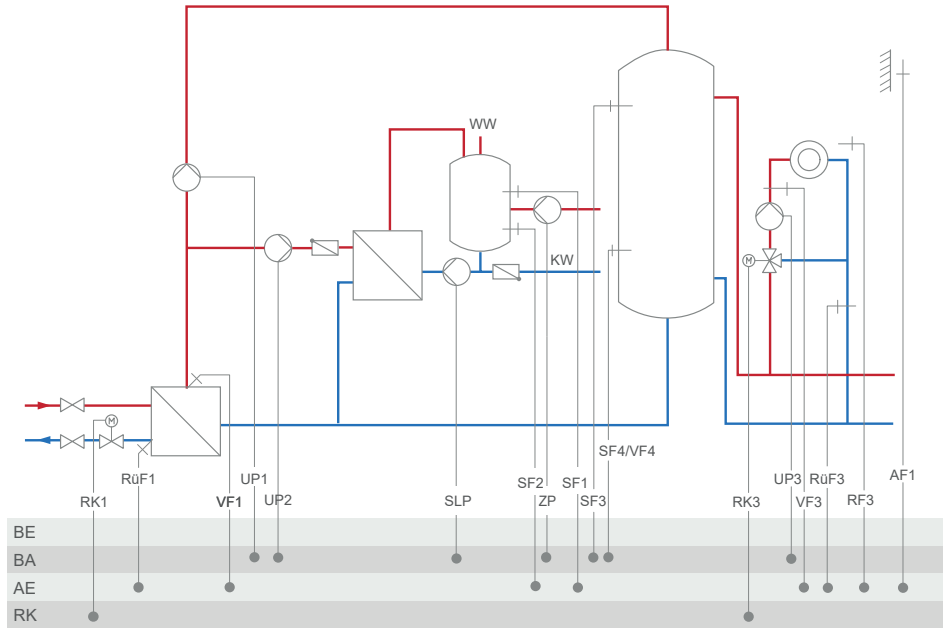

Annex A (configuration instructions)

| System | 15.5 |
|---|--|
| | <p>Anlage 15.5</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RÜF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 16.0

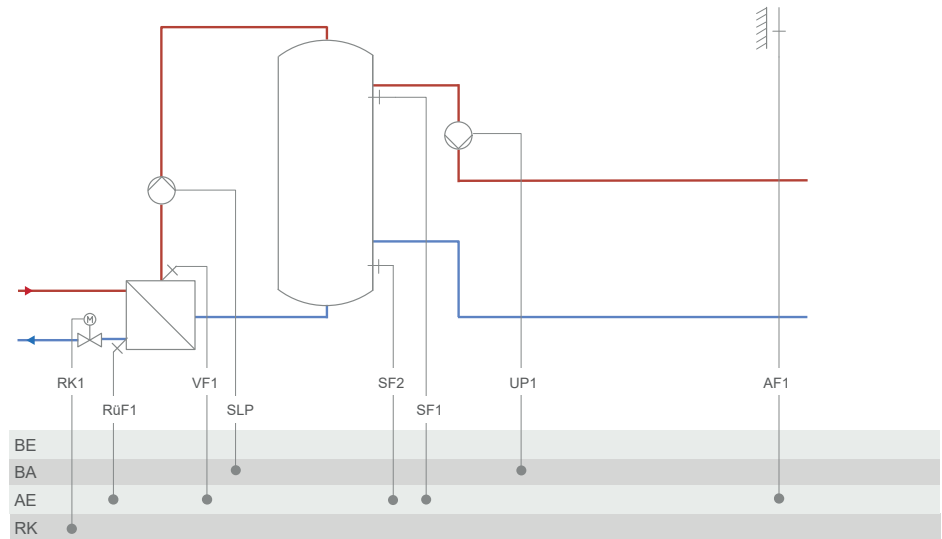

| System | 16.0 |
|---------------------------|--|
| | Anlage 16.0 |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - SLP speed When CO1 -> F21 - 1 - Differential temperature control When CO1 -> F23 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 Direction = Output |

Annex A (configuration instructions)


System Anl 16.1

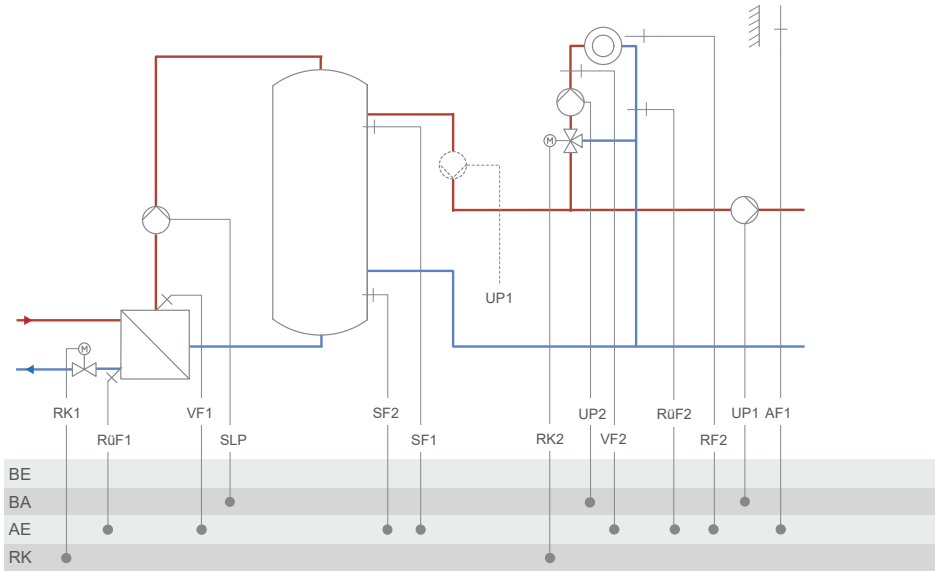


| | | |
|---------------------------|--|--|
| System | 16.1 | |
| | <p>Anlage 16.1</p> | |
| | <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RÜF1) | |
| CO1 -> F06 | - 1 (with SF2) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 0 (without RÜF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 38) | |
| CO5 -> F14 | - 0 (UP1 according to the ZP schedule or only active during the processing for an external demand) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - SLP speed When CO1 -> F21 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> | |


Annex A (configuration instructions)


System Anl 16.2

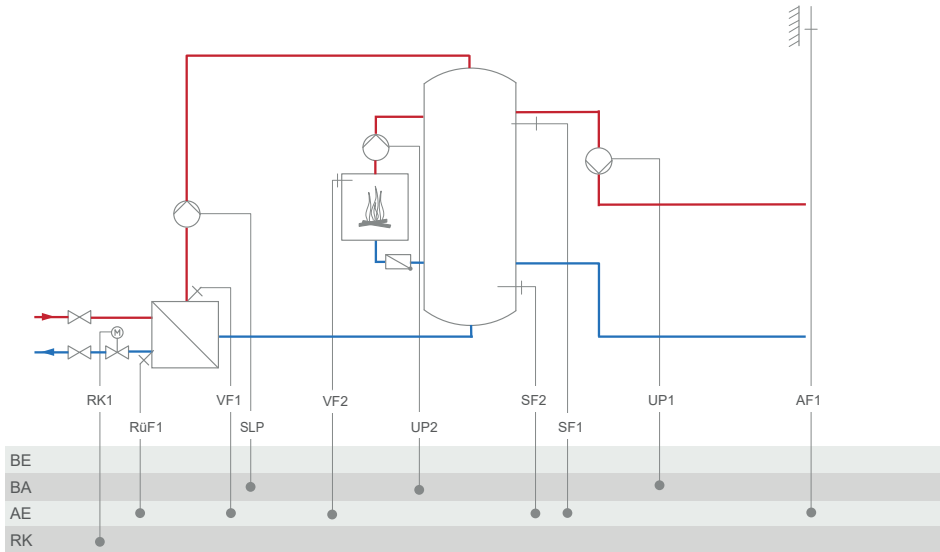

| | | |
|---------------------------|--|--|
| System | 16.2 | |
| | Anlage 16.2  | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO1 -> F06 | - 1 (with SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - SLP speed - External demand - Outdoor temperature | |
| | When CO1 -> F21 - 1 | |
| | When CO1 -> F18 - 1 | |
| | When CO5 -> F23 - 1 | |
| | Direction = Output | |


System Anl 16.3

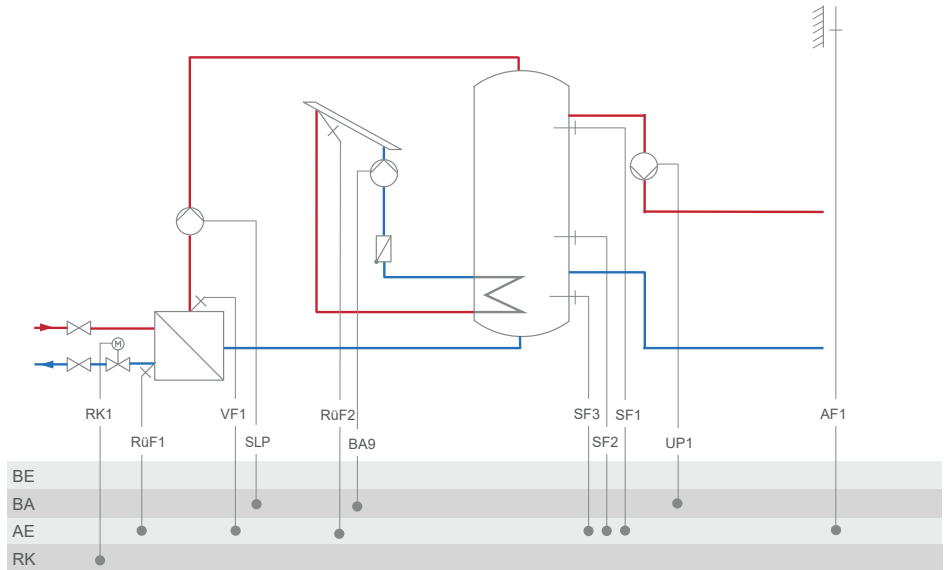


| | | |
|---------------------------|--|---|
| System | 16.3 | |
| | Anlage 16.3  | |
| Default setting | | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RüF1) | |
| CO1 -> F06 | - 1 (with SF2) | |
| CO5 -> F07 | - 0 (without error message at terminal 43) | |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - SLP speed - External demand - Outdoor temperature | |
| | | When CO1 -> F21 - 1 When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output |


Annex A (configuration instructions)

System Anl 16.4

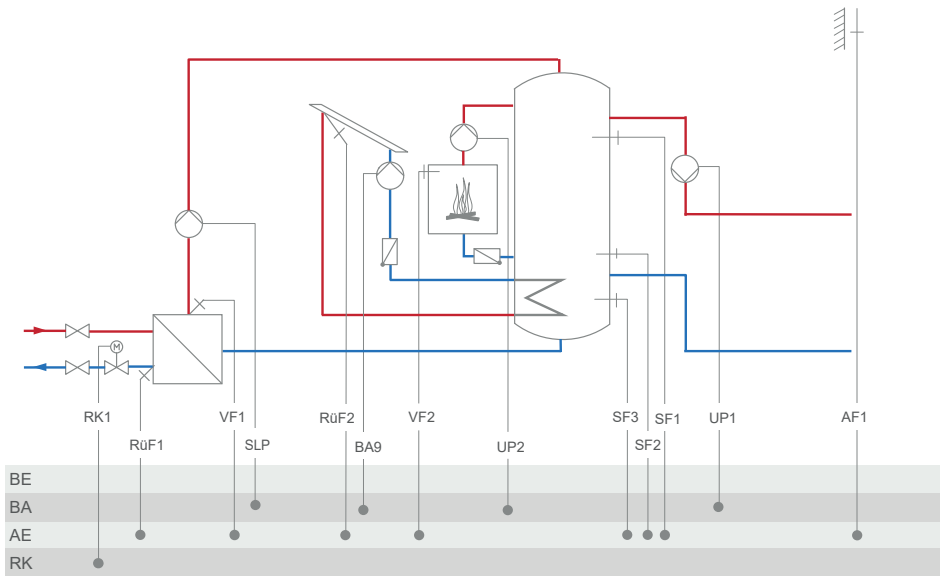


| | |
|---------------------------|---|
| System | 16.4 |
| | Anlage 16.4  |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - SLP speed - External demand - Outdoor temperature <div style="display: flex; justify-content: space-between; margin-top: 10px;"> <div></div> <div>When CO1 -> F21 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div></div> <div>When CO1 -> F18 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div></div> <div>When CO5 -> F23 - 1</div> </div> <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div></div> <div>Direction = Output</div> </div> |


System Anl 16.8

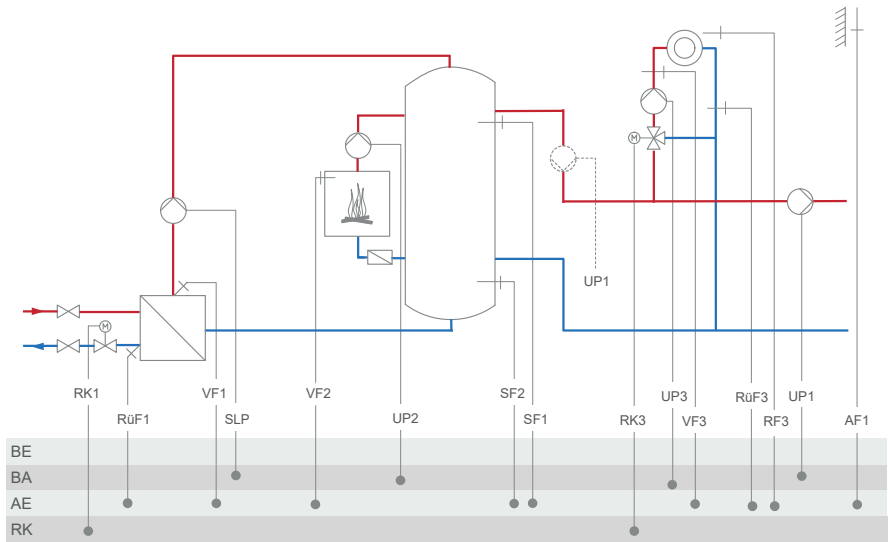


Annex A (configuration instructions)

| System | 16.5 |
|---|--|
| | <p>Anlage 16.5</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RÜF3) |
| CO5 -> F07 | - 0 (without error message at terminal 38) |
| CO5 -> F14 | - 0 (UP1 according to the ZP schedule or only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - SLP speed When CO1 -> F21 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 16.6

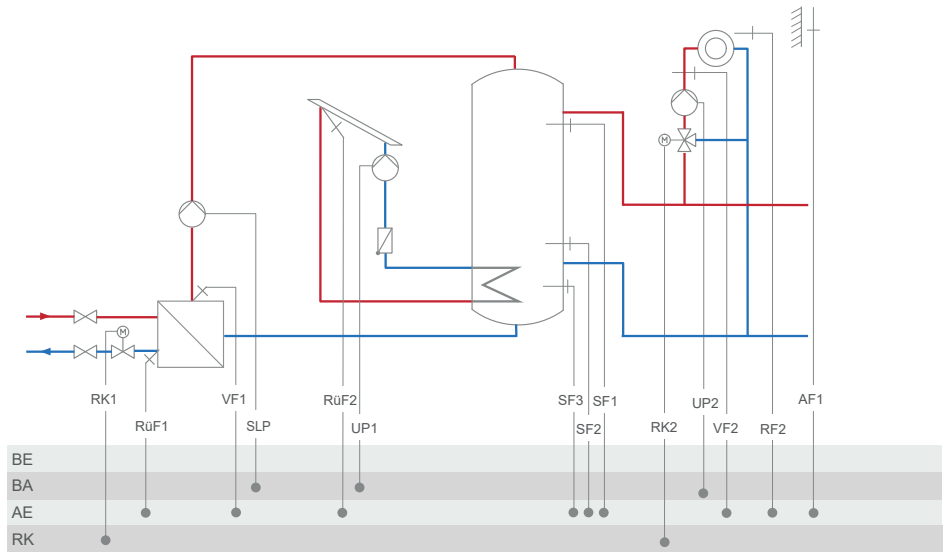


Annex A (configuration instructions)

| | |
|---|--|
| System | 16.6 |
| | <p>Anlage 16.6</p>  |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO5 -> F07 | - 0 (without error message at terminal 38) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - SLP speed When CO1 -> F21 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |

Annex A (configuration instructions)

| System | 16.7 |
|---|--|
| | <p>Anlage 16.7</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RÜF3) |
| CO5 -> F07 | - 0 (without error message at terminal 43) |
| CO5 -> F14 | - 0 (UP1 according to the ZP schedule or only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y3 (RK3) - SLP speed When CO1 -> F21 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 16.8

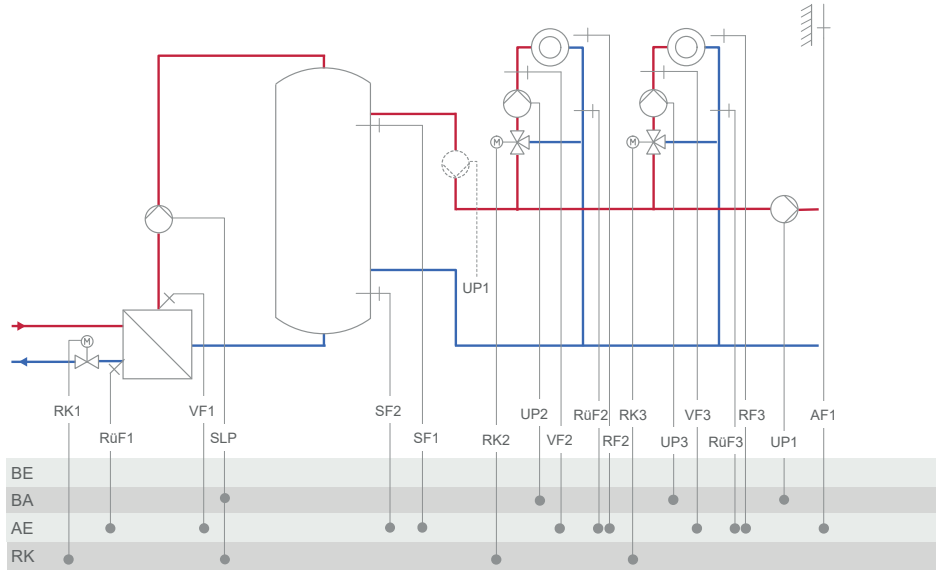

Annex A (configuration instructions)

| System | 16.8 |
|---------------------------|--|
| | <p>Anlage 16.8</p> |
| | <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RÜF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without RÜF3) |
| CO5 -> F07 | - 0 (without error message at terminal 38) |
| CO5 -> F14 | - 0 (UP1 according to the ZP schedule or only active during the processing for an external demand) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - SLP speed - External demand - Outdoor temperature <p style="text-align: right; padding-right: 20px;"> When CO1 -> F21 - 1 When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 17.1

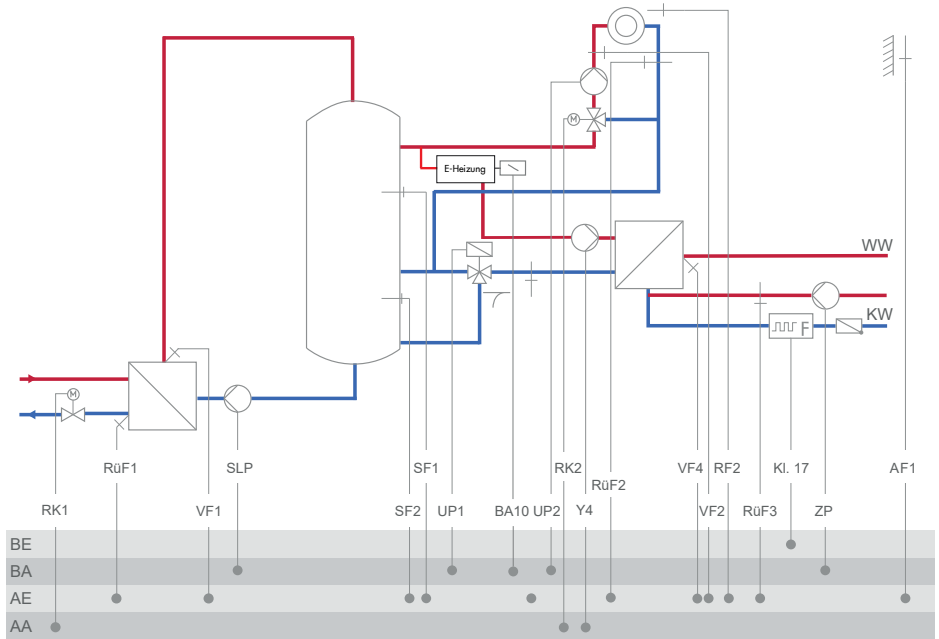


Annex A (configuration instructions)

| | |
|---|---|
| System | 17.1 |
| | <p>Anlage 17.1</p> |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RÜF2 in RK2) |
| CO4 -> F03 | - 0 (without RÜF2/RÜF4) |
| CO4 -> F04 | - 0 (without flow switch) |
| CO4 -> F14 | - 0 (without RÜF3) |
| CO4 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y4 - SLP speed When CO1 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - External demand When CO1 -> F18 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 17.8

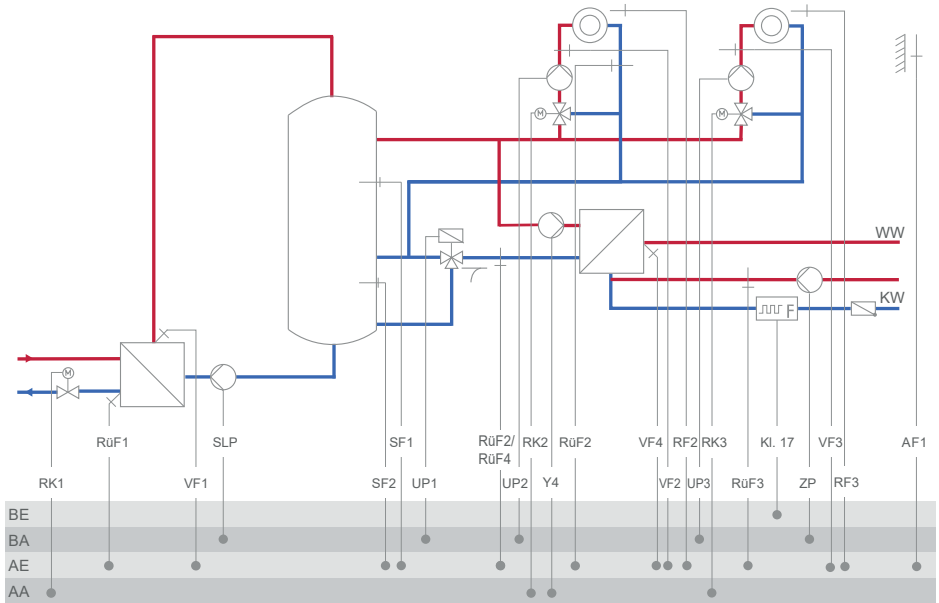


Annex A (configuration instructions)

| System | 17.8 |
|---|--|
| | <p>Anlage 17.8</p>  |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 0 (without RüF2 in RK2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO4 -> F03 | - 0 (without RüF2/RüF4) |
| CO4 -> F04 | - 0 (without flow switch) |
| CO4 -> F14 | - 0 (without RüF3) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - Control signal Y4 - SLP speed - External demand - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F21 - 1 When CO1 -> F18 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 18.1-1

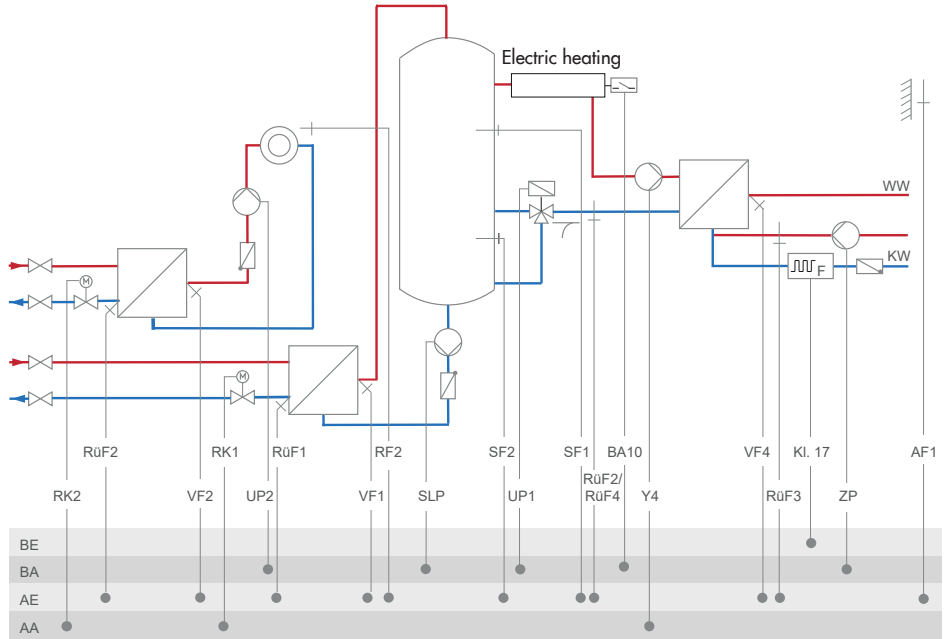


Annex A (configuration instructions)

| System | 18.1-1 |
|---|---|
| | <p>Anlage 18.1-1</p>  |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 1 (with RÜF2 in RK2) |
| CO4 -> F03 | - 0 (without RÜF2/RÜF4) |
| CO4 -> F04 | - 0 (without flow switch) |
| CO4 -> F14 | - 0 (without RÜF3) |
| CO4 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y4 - SLP speed When CO1 -> F21 - 1 - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 18.1-2

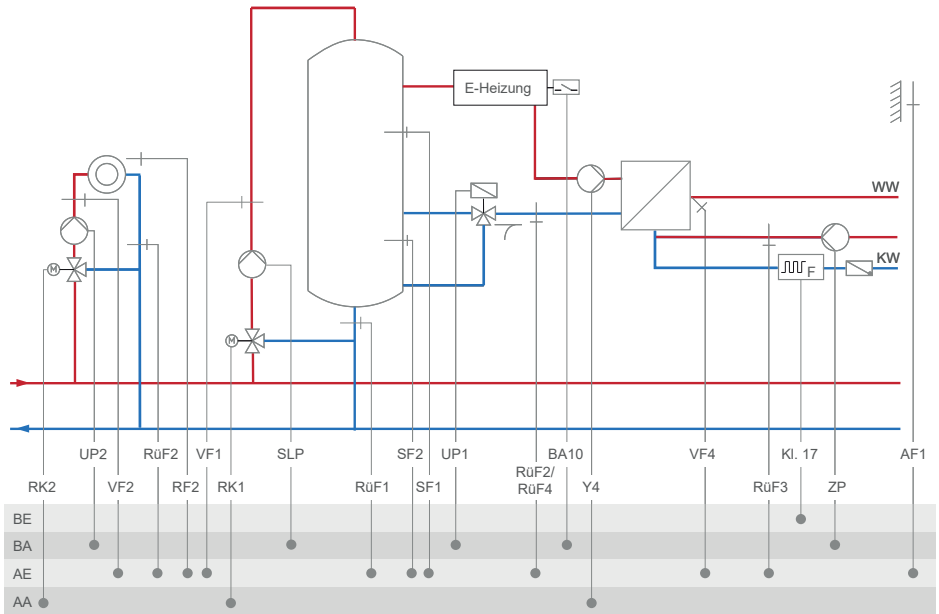


Annex A (configuration instructions)

| System | 18.1-2 |
|---|---|
| | <p>Anlage 18.1-2</p>  |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO1 -> F06 | - 1 (with SF2) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 1 (with RÜF2 in RK2) |
| CO4 -> F03 | - 0 (without RÜF2/RÜF4) |
| CO4 -> F04 | - 0 (without flow switch) |
| CO4 -> F14 | - 0 (without RÜF3) |
| CO4 -> F07 | - 0 (without error message at terminal 46) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y4 - SLP speed When CO1 -> F21 - 1 - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 21.0

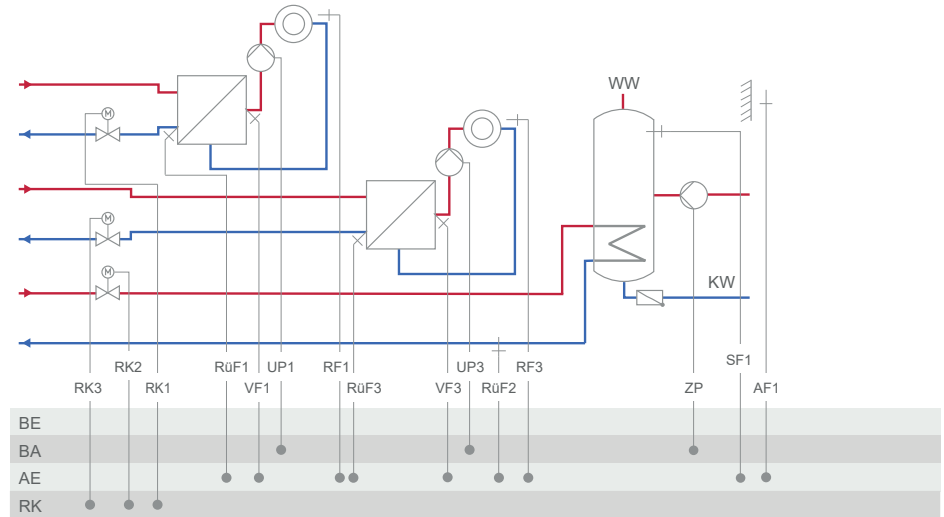

Annex A (configuration instructions)

| System | 21.0 |
|---|--|
| | <p>Anlage 21.0</p>  |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 1 (with RUF3) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 21.1-1

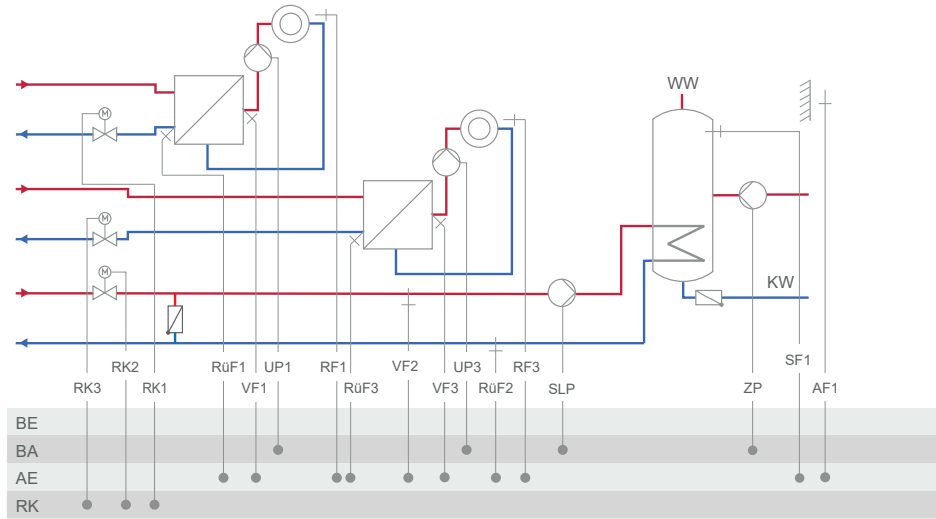


Annex A (configuration instructions)

| System | |
|---|---|
| | <p>21.1-1</p> <p>Anlage</p> <p>The diagram shows three input lines from the left, each with a fuse symbol labeled HK1, HK3, and TMU. These lines are connected to a central power supply unit represented by a rectangle with a lightning bolt symbol.</p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 0 (without R F1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without R F3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F03 | - 0 (without R F2) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 21.1-2

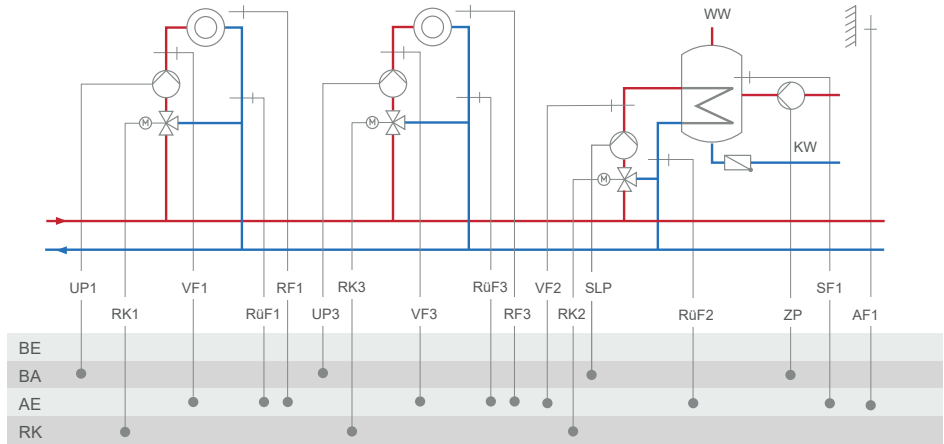

Annex A (configuration instructions)

| System | 21.1-2 |
|---|---|
| | <p>Anlage </p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 0 (without R F1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 0 (without R F3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 0 (without SF2) |
| CO4 -> F03 | - 0 (without R F2) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 21.2-1

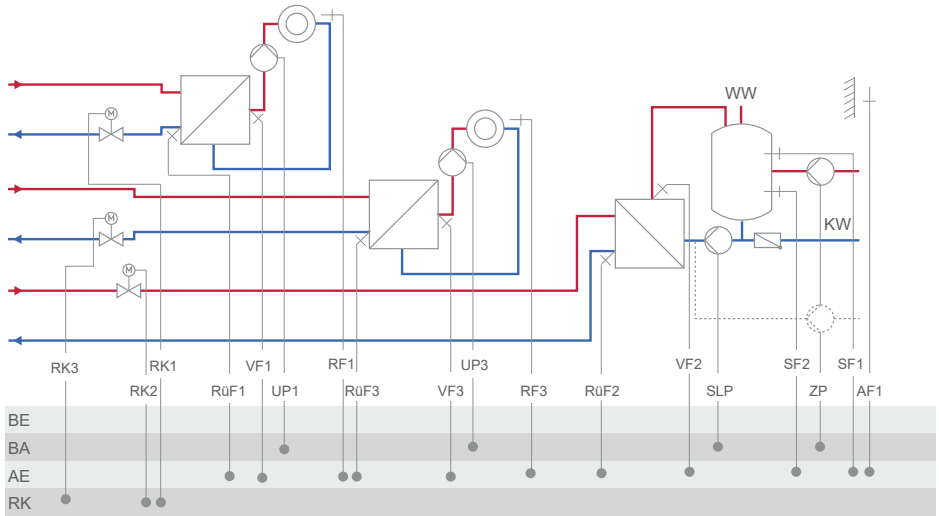

Annex A (configuration instructions)

| System | |
|---|---|
| | <p>21.2-1</p> <p>Anlage</p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 1 (with RUF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RUF2) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - SLP speed - ZP speed - Outdoor temperature <p style="text-align: right;"> When CO1 -> F18 - 1 When CO4 -> F21 - 1 When CO4 -> F25 - 1 When CO5 -> F23 - 1 Direction = Output </p> |


System Anl 21.2-2

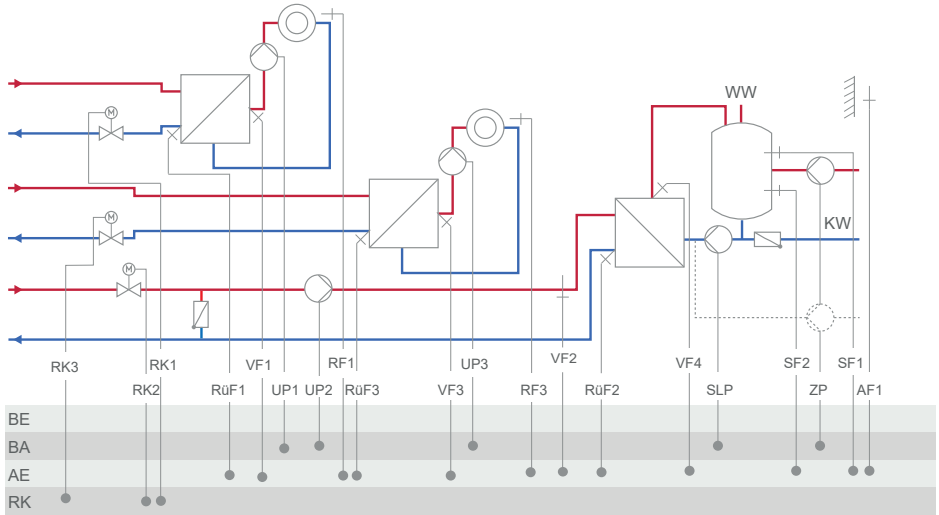


Annex A (configuration instructions)

| System | 21.2-2 |
|---|---|
| | <p>Anlage 21.2-2</p> |
| RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 1 (with RÜF3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without RÜF2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <div style="text-align: right; margin-top: 5px;">Direction = Output</div> |


System Anl 21.2-3

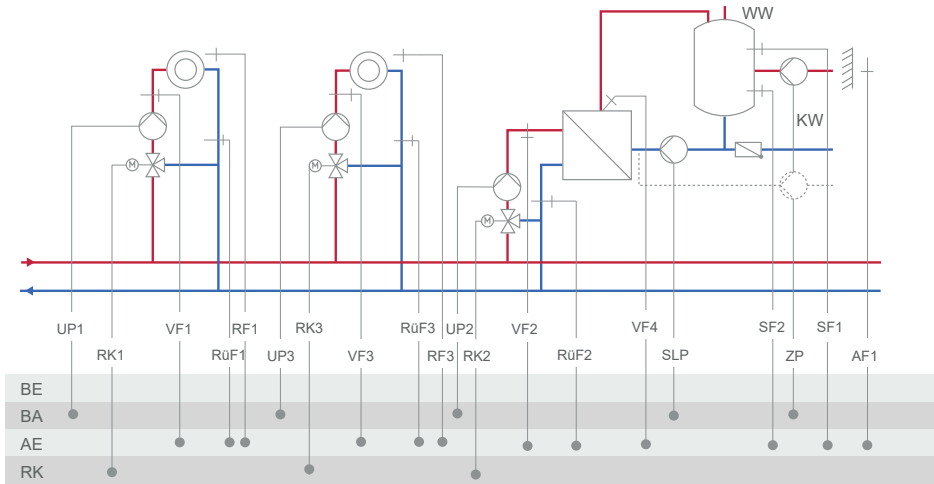

Annex A (configuration instructions)

| System | 21.2-3 |
|---|---|
| | <p>Anlage </p> <p>The diagram shows a schematic of a heating system. It includes two heating units, HK1 and HK3, each with a control valve. A temperature measurement unit, TMU, is connected to the system. The diagram is labeled 'Anlage' and '21.2-3'.</p> |
| <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with R F1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 1 (with R F3) |
| CO4 -> F01 | - 1 (with SF1) |
| CO4 -> F02 | - 1 (with SF2) |
| CO4 -> F03 | - 0 (without R F2) |
| CO4 -> F05 | - 0 (without VF4; in this case, VF2 usually installed at the point of measurement of VF4) |
| CO4 -> F10 | - 0 (DHW circulation return flow in storage tank) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand When CO1 -> F18 - 1 - SLP speed When CO4 -> F21 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 21.9-1

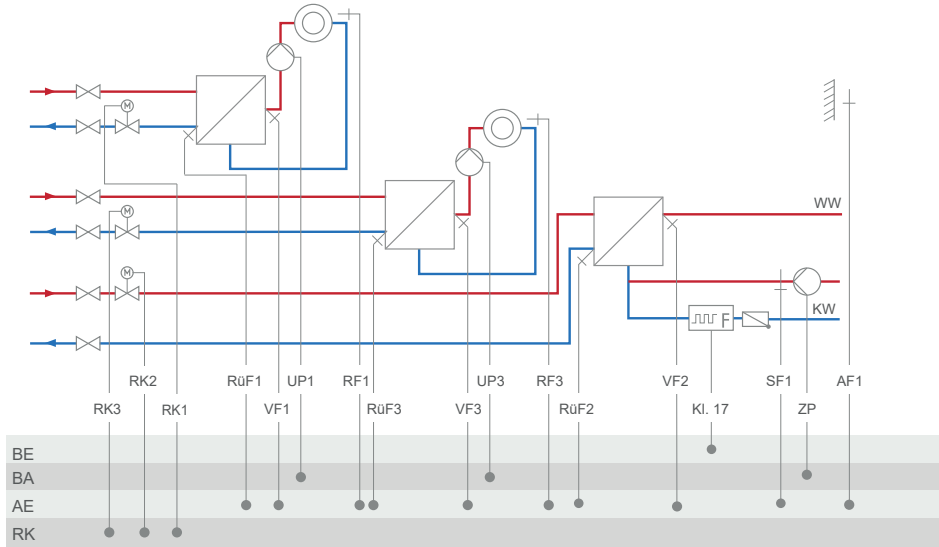


Annex A (configuration instructions)

| System | 21.9-1 |
|---|---|
| | <p>Anlage 21.9-1</p> |
| RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 1 (with RÜF3) |
| CO4 -> F01 | - 0 (without SF1) |
| CO4 -> F03 | - 0 (without RÜF2) |
| CO4 -> F04 | - 0 (without flow rate sensor) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - 10 V supply - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <div style="text-align: right; margin-top: 5px;">Direction = Output</div> |


System Anl 21.9-2

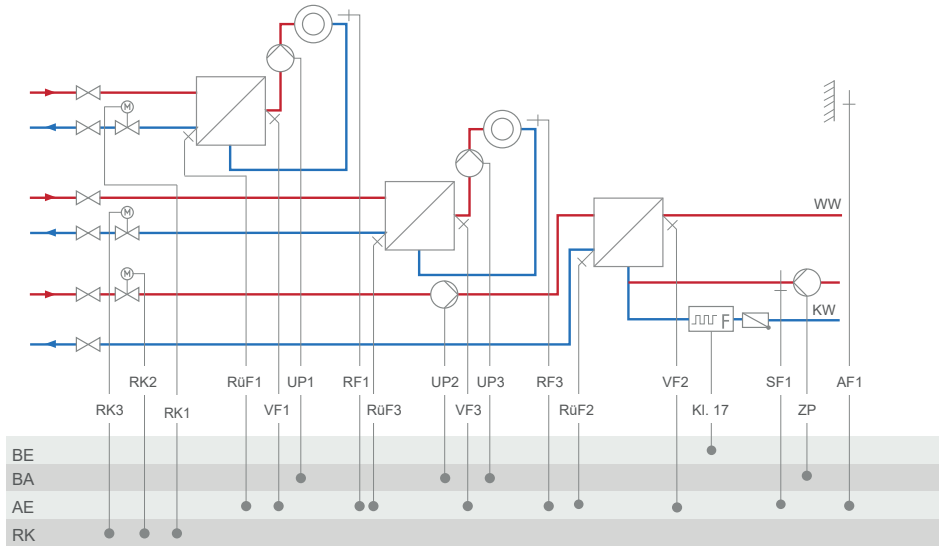

Annex A (configuration instructions)

| System | 21.9-2 |
|---|---|
| | <p>Anlage 21.9-2</p>  |
| RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 | |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RÜF1) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 1 (with RÜF3) |
| CO4 -> F01 | - 0 (without SF1) |
| CO4 -> F03 | - 0 (without RÜF2) |
| CO4 -> F04 | - 0 (without flow rate sensor) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - 10 V supply - External demand When CO1 -> F18 - 1 - ZP speed When CO4 -> F25 - 1 - Outdoor temperature When CO5 -> F23 - 1 <p style="text-align: right;">Direction = Output</p> |


System Anl 25.0-1

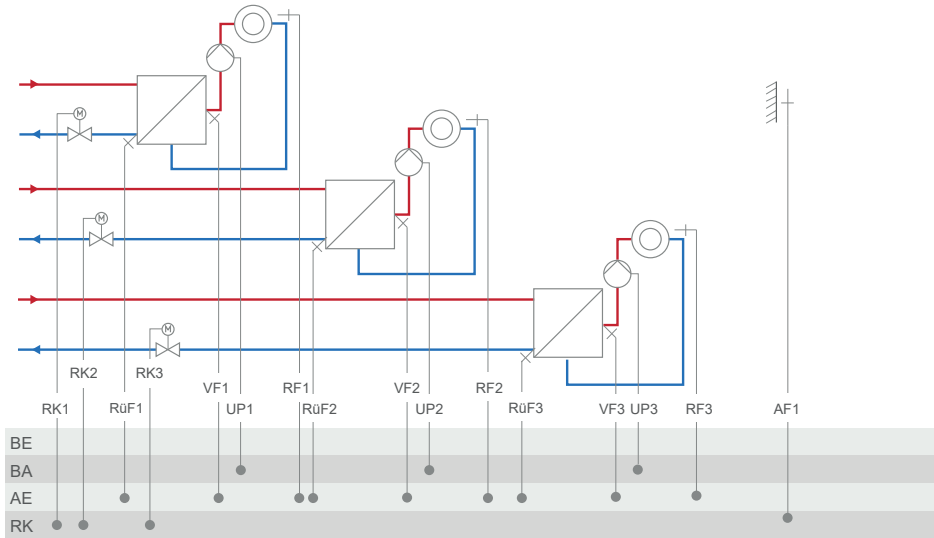

Annex A (configuration instructions)

| System | | 25.0-1 |
|---|--|--|
| | | <p>Anlage 25.0-1</p> |
| <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> <p>RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> | | |
| Default setting | | |
| CO1 -> F01 | - 0 (without RF1) | |
| CO1 -> F02 | - 1 (with AF1) | |
| CO1 -> F03 | - 1 (with RUF1) | |
| CO2 -> F01 | - 0 (without RF2) | |
| CO2 -> F02 | - 1 (with AF1) | |
| CO2 -> F03 | - 1 (with RUF2) | |
| CO3 -> F01 | - 0 (without RF3) | |
| CO3 -> F02 | - 1 (with AF1) | |
| CO3 -> F03 | - 1 (with RUF3) | |
| CO5 -> F07 | - 0 (without error message at terminal 37) | |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> | |


System Anl 25.0-2

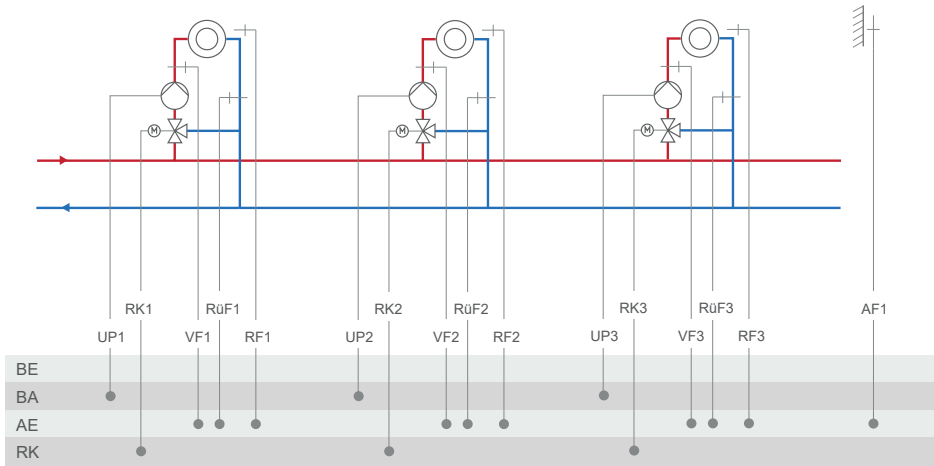

Annex A (configuration instructions)

| System | 25.0-2 |
|---------------------------|---|
| | <p>Anlage 25.0-2</p> |
| | <p>RK2: CO2 -> F02 - 0 = Fixed set point control; CO2 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO2 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2 RK3: CO3 -> F02 - 0 = Fixed set point control; CO3 -> F02 - 1, select AF1 = Outdoor-temperature-compensated control with AF1; CO3 -> F02 - 1, select AF2 = Outdoor-temperature-compensated control with AF2</p> |
| Default setting | |
| CO1 -> F01 | - 0 (without RF1) |
| CO1 -> F02 | - 1 (with AF1) |
| CO1 -> F03 | - 1 (with RUF1) |
| CO2 -> F01 | - 0 (without RF2) |
| CO2 -> F02 | - 1 (with AF1) |
| CO2 -> F03 | - 1 (with RUF2) |
| CO3 -> F01 | - 0 (without RF3) |
| CO3 -> F02 | - 1 (with AF1) |
| CO3 -> F03 | - 1 (with RUF3) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | <p>Function AA1, AA2, AA3, AA4:</p> <ul style="list-style-type: none"> - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand - Outdoor temperature <p style="text-align: right;">When CO1 -> F18 - 1 When CO5 -> F23 - 1 Direction = Output</p> |

System Anl 25.5

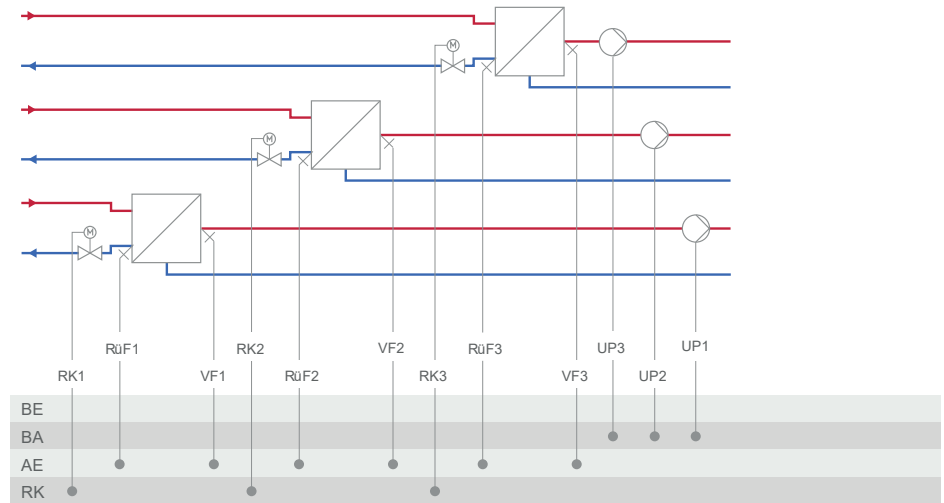


| System | 25.5 |
|---------------------------|--|
| | Anlage 25.5 |
| Default setting | |
| CO1 -> F02 | - 0 (without AF1) |
| CO1 -> F03 | - 1 (with RüF1) |
| CO2 -> F02 | - 0 (without AF1) |
| CO2 -> F03 | - 1 (with RüF2) |
| CO3 -> F02 | - 0 (without AF1) |
| CO3 -> F03 | - 1 (with RüF3) |
| CO5 -> F07 | - 0 (without error message at terminal 37) |
| CO5 -> F34, F35, F36, F37 | Function AA1, AA2, AA3, AA4: - Control signal Y1 (RK1) - Control signal Y2 (RK2) - Control signal Y3 (RK3) - External demand |
| | When CO1 -> F18 - 1 |

16.2 Functions of the heating circuit

Which controller functions are available depends on the selected system code number (Anl).

16.2.1 Outdoor-temperature-compensated control

When outdoor-temperature-compensated control is used, the flow temperature is controlled based on the outdoor temperature. The heating characteristic in the heating controller defines the flow temperature set point as a function of the outdoor temperature (see Fig. 16-2). The outdoor temperature required for outdoor-temperature-compensated control can either be measured at an outdoor sensor, received over the 0 to 10 V input (see section 16.2.1.1) or a connected device bus (see section 16.2.1.2).

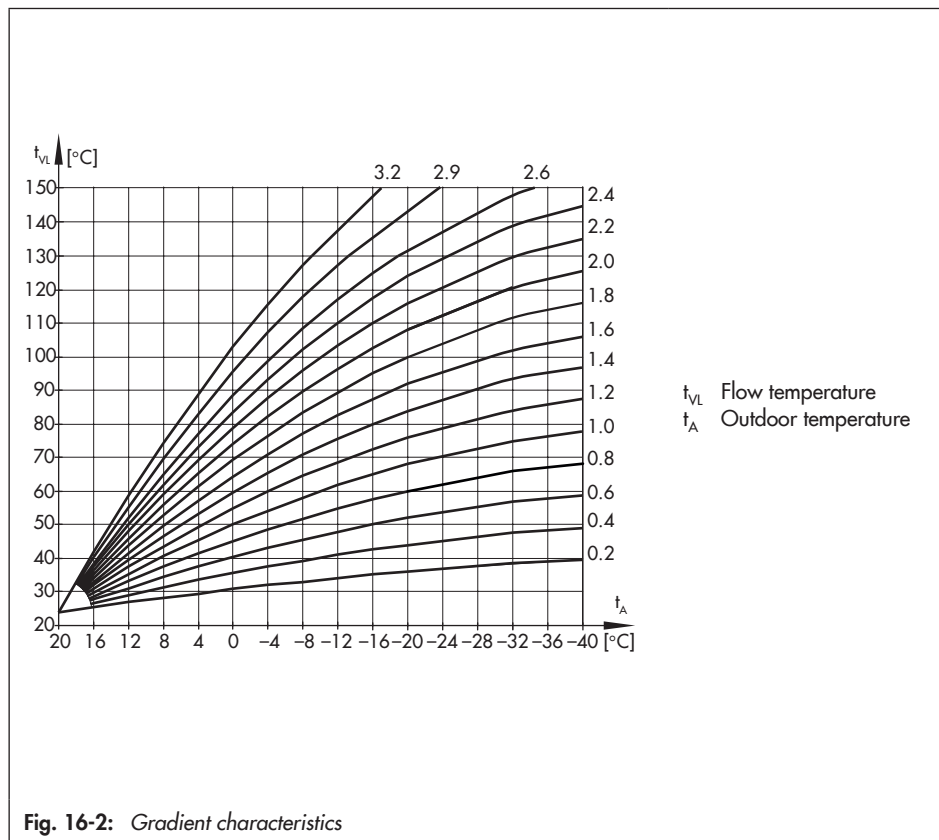

16.2.1.1 Outdoor temperature received or sent as 0 to 10 V signal

The outdoor temperature can be received at AE3 over the 0 to 10 V input.

Alternatively, the temperature measured by the outdoor sensor can be issued at AA1, AA2, AA3 or AA4 as a 0 to 10 V signal. With the setting CO5 -> F23 - 1, Direction 'Output', the output AA1 is assigned for issuing the outdoor temperature signal. The output AA2, AA3 or AA4 can also be assigned instead.

The zero of the 0 to 10 V input and output signals can be shifted, if required.

| Functions | Default | Configuration |
|--|---------|---|
| Outdoor sensor AF1, 2 | 1 | CO1, 2, 3, 11, 12, 13 -> F02 - 1 CO2, 3: select AF1, AF2 |
| Outdoor temperature received or sent as 0 to 10 V signal | 0 | CO5 -> F23 - 1 |
| | Input | Direction: input (receive) |
| | -20 °C | Lower transmission range: -50 to 100 °C |
| AI3 Zero shift | 50 °C | Upper transmission range: -50 to 100 °C |
| | 0 | CO5 -> F33 - 1 |
| Outdoor temperature received or sent as 0 to 10 V signal | 5 % | Zero: 5 to 20 % |
| | 0 | CO5 -> F23 - 1 |
| | Input | Direction: output (send) |
| AA1, AA2, AA3, AA4 reverse | -20 °C | Lower transmission range: -50 to 100 °C |
| | 50 °C | Upper transmission range: -50 to 100 °C |
| AA1, AA2, AA3, AA4 PWM | 0 | CO5 -> F25, F26, F27, F28 - 0 |
| | 0 % | Zero: 0 to 50 % |
| AA1, AA2, AA3, AA4 PWM | 0 | CO5 -> F34, F35, F36, F37 - 0 |
| | | Function: outdoor temperature |

16.2.1.2 Outdoor temperature received or sent over the device bus


The measured outdoor temperature can be provided to other heating controllers over the device bus.

| Functions | Default | Configuration |
|------------------------------|---------|---|
| Outdoor sensor AF1, 2 | 1 | CO1, 2, 3, 11, 12, 13 -> F02 - 1 CO2, 3: select AF1, AF2 |
| Device bus | 0 | CO7 -> F01 - 1, device bus address |
| Receive value AF1 | 0 | CO7 -> F07 - 1, register number |
| Send value AF1 ¹⁾ | 0 | CO7 -> F06 - 1, register number |
| Receive value AF2 | 0 | CO7 -> F09 - 1, register number |
| Send value AF2 ¹⁾ | 0 | CO7 -> F08 - 1, register number |


¹⁾ Send received outdoor temperature as 0 to 10 V signal by device bus with CO5 -> F23 - 1 setting and AE

16.2.1.3 Gradient characteristic


Basically, the following rule applies: a decrease in the outdoor temperature causes the flow temperature to increase in order to keep the room temperature constant. By varying the 'Gradient' and 'Level' parameters, you can adapt the characteristic to your individual requirements:




The gradient needs to be increased if the room temperature drops when it is cold outside.



The gradient needs to be decreased if the room temperature drops when it is cold outside.



The level needs to be increased and the gradient decreased if the room temperature drops when it is mild outside.



The level needs to be decreased and the gradient increased if the room temperature rises when it is mild outside.

Annex A (configuration instructions)

Outside the times-of-use, reduced set points are used for control: the reduced flow set point is calculated as the difference between the adjusted values for 'Day set point' (rated room temperature) and 'Night set point' (reduced room temperature). The 'Max. flow temperature' and 'Min. flow temperature' parameters mark the upper and lower limits of the flow temperature. A separate gradient characteristic can be selected for the limitation of the return flow temperature.

Examples for adjusting the characteristic:

- Old building, radiator design 90/70: Gradient approx. 1.8
- New building, radiator design 70/55: Gradient approx. 1.4
- New building, radiator design 55/45: Gradient approx. 1.0
- Underfloor heating depending on arrangement: Gradient <0.5

i Note

Particularly for control operation without room sensor, the room temperatures set for day ('Day set point') and night ('Night set point') only become effective satisfactorily when the heating characteristic has been adapted to the building/heating surface layout.

| Functions | Default | Configuration |
|--|---|--|
| Four-point characteristic | 0 | CO1, 2, 3, 11, 12, 13 -> F11 - 1 |
| Parameters | Default | Switch position: value range |
| Day set point | 20.0 °C | ☀: 0.0 to 40.0 °C |
| Night set point | 15.0 °C | ☾: 0.0 to 40.0 °C |
| Parameters | Default | Parameters: value range |
| Flow gradient | 1.2 ¹⁾ | PA1, 2, 3, 11, 12, 13 -> P01: 0.2 to 3.2 |
| Level (parallel shift) | 0.0 °C | PA1, 2, 3, 11, 12, 13 -> P02: -30.0 to 30.0 °C |
| Min. flow temperature | 20.0 °C | PA1, 2, 3, 11, 12, 13 -> P06: -5.0 to 150.0 °C |
| Max. flow temperature | 70.0 °C ¹⁾ | PA1, 2, 3, 11, 12, 13 -> P07: 5.0 to 150.0 °C |
| ¹⁾ With CO1, 2, 3, 11, 12, 13 -> F05 - 1 the following applies: | Gradient: 0.2 to 1.0 (0.5) Max. flow temperature: 5.0 to 50.0 °C (50.0 °C) | |

16.2.1.4 Four-point characteristic

The four-point characteristic allows you to define your own heating characteristic. It is defined by four points for the outdoor temperature, flow temperature, reduced flow temperature and return flow temperature. The 'Max. flow temperature' and 'Min. flow temperature' parameters mark the upper and lower limits of the flow temperature.

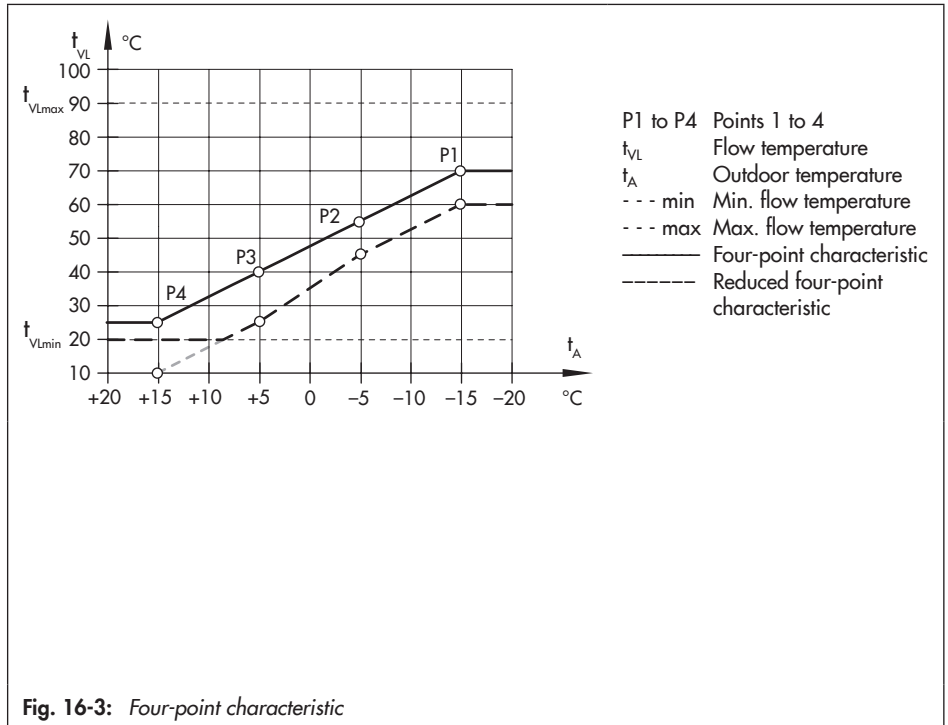


Fig. 16-3: Four-point characteristic

i Note

- The 'Day set point' and 'Night set point' parameters are no longer available when the four-point characteristic has been selected when no additional functions (e.g. **optimization**, **flash adaptation**) have been selected.
- The **four-point characteristic** function can only be activated when the **adaptation** function is not active (CO1, 2, 3, 11, 12, 13 -> F08 - 0).

Annex A (configuration instructions)

| Functions | | Default | Configuration |
|--|---------------|---|---|
| Adaptation | | 0 | CO1, 2, 3, 11, 12, 13 -> F08 - 0 |
| Four-point characteristic | | 0 | CO1, 2, 3, 11, 12, 13 -> F11 - 1 |
| Parameters | | Default | Parameters: value range |
| Outdoor temperature | Point 1 | -15.0 °C | PA1, 2, 3, 11, 12, 13 -> P05: -50.0 to 50.0 °C |
| | Point 2 | -5.0 °C | |
| | Point 3 | 5.0 °C | |
| | Point 4 | 15.0 °C | |
| Flow temperature | Point 1 | 70.0 °C | PA1, 2, 3, 11, 12, 13 -> P05: -5.0 to 150.0 °C |
| | Point 2 | 55.0 °C | |
| | Point 3 | 40.0 °C | |
| | Point 4 | 25.0 °C | |
| Reduced flow temperature | Point 1 | 60.0 °C | PA1, 2, 3, 11, 12, 13 -> P05: -5.0 to 150.0 °C |
| | Point 2 | 40.0 °C | |
| | Point 3 | 20.0 °C | |
| | Point 4 | 20.0 °C | |
| Return flow temperature | Points 1 to 4 | 65.0 °C | PA1, 2, 3, 11, 12, 13 -> P05: 5.0 to 90.0 °C |
| Min. flow temperature | | 20.0 °C | PA1, 2, 3, 11, 12, 13 -> P06: -5.0 to 150.0 °C |
| Max. flow temperature | | 70.0 °C ¹⁾ | PA1, 2, 3, 11, 12, 13 -> P07: 5.0 to 150.0 °C |
| ¹⁾ With CO1, 2, 3, 11, 12, 13 -> F05 - 1 the following applies: | | Max. flow temperature: 5.0 to 50.0 °C (50.0 °C) | |

16.2.2 Fixed set point control

During the times-of-use, the flow temperature can be controlled according to a fixed set point. Outside the times-of-use, the controller regulates to a reduced flow temperature. Set the desired rated flow temperature as 'Day set point' and the reduced flow temperature as 'Night set point'.

| Functions | Default | Configuration |
|-----------------------|---------|---|
| Outdoor sensor | 1 | CO1, 2, 3, 11, 12, 13 -> F02 - 0 |
| Parameters | Default | Switch position: value range |
| Day set point | 50.0 °C | ↓☀: Min. to max. flow temperature |
| Night set point | 30.0 °C | ↓☾: Min. to max. flow temperature |
| Parameters | Default | Parameters: value range |
| Min. flow temperature | 20.0 °C | PA1, 2, 3, 11, 12, 13 -> P06: -5.0 to 150.0 °C |
| Max. flow temperature | 70.0 °C | PA1, 2, 3, 11, 12, 13 -> P07: 5.0 to 150.0 °C |

16.2.3 Underfloor heating/drying of jointless floors

Using function block setting CO1, 2, 3, 11, 12, 13 -> F05 - 1, the respective heating circuit is configured as an underfloor heating circuit. In doing so, the controller at first only limits the value ranges of the heating characteristic gradient and the maximum flow temperature in PA1, 2, 3, 11, 12, 13 parameter levels:

- Value range of the gradient: 0.2 to 1.0
- Value range of the maximum flow temperature: 5 to 50 °C

Furthermore, it is possible to set a **Boost** between 0.0 to 50.0 °C, which is additionally taken into account when there is a heat demand for the underfloor heating circuit of an upstream control circuit.

The **Drying of jointless floors** function can be activated afterwards. The function block parameters (starting with the 'Start temperature') determine the drying process: the first heating up phase starts at the entered 'Start temperature', which has a flow temperature of 25 °C in its default setting. The start temperature is constantly regulated for the days entered in 'Hold (days)'. Afterwards, this temperature is raised by the value entered in 'Temp. rise/day' within 24 hours, i.e. the default setting causes the flow temperature set point to rise to 30 °C 24 hours after the holding phase. If the maximum temperature is reached, it is kept constant for the number of days entered in 'Hold (days)'. The 'Temp. reduction/day' parameter determines the temperature reduction downwards. If the 'Temp. reduction/day' is set to 0, the temperature maintaining phase moves directly to automatic mode. If the function block parameter 'Start temperature' is set to 25 °C and 'Temp. rise/day' to 0.0 °C, the drying functions runs as specified in Part 4 of DIN EN 1264: the drying of jointless floors function starts with a flow temperature of 25 °C, which is kept constant for three days. Afterwards, the controller switches to the maximum adjusted temperature. The further process remains unchanged. The

16.2.4 Night set-back

The night set-back (= difference of the flow target temperature in day and night mode) is calculated in all heating circuits with a gradient characteristic as follows:

$$2x \text{ Heating characteristic gradient } \times (\text{day room temperature} - \text{night room temperature})$$

16.2.4.1 Outdoor temperature for continuous day mode

If a heating circuit is in night mode (automatic mode, ☺), this circuit is switched to day mode whenever the outdoor temperature falls below 'Outdoor temperature for continuous day mode'. The night mode restarts after the outdoor temperature rises above the limit (plus 0.5 °C hysteresis).

This function prevents the building from cooling down excessively outside the times-of-use when low outdoor temperatures occur. The transition towards day mode can be configured to be variable depending on the outdoor temperature.

| Parameters | Default | Parameters: value range |
|---|----------|---|
| Outdoor temperature for continuous day mode | -15.0 °C | PA1, 2, 3, 11, 12, 13 -> P09: -50.0 to 5.0 °C (only when CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 0) |

16.2.4.2 Variable night set-back

With the setting CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 1, the night set-back is variable based on the outdoor temperature. The night set-back is fully effective at outdoor temperatures above the outdoor temperature limit value 'OTL night 100 %'.

The absolute value of the night set-back is linearly reduced to zero in the range between this value and the outdoor temperature limit value 'OTL night 0 %' for continuous day mode.

The absolute value of the night set-back is indicated in the 'Night set points' menu as 'HKx night set-back'. It is also indicated during day mode, but has no effect. With the setting CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 1, the 'Outdoor temperature for continuous day mode' (P09) parameter is not used in the corresponding PA level.

| Functions | Default | Configuration |
|-------------------------|---------|--|
| Variable night set-back | 0 | CO1, CO2, CO3, CO11, CO12, CO13 -> F28 - 1 (only when CO1, CO2, CO3, CO11, CO12, CO13 -> F11 - 0) |
| | 5.0 °C | OTL night 100 %: -50 °C to 20.0 °C |
| | -15 °C | OTL day 0 %: -50 °C to 5.0 °C |

16.2.5 Buffer tank systems

A heating characteristic based on a gradient or four entered points can be set in PA1 for the buffer tanks in systems Anl 3.9, 5.9, 14.1 to 14.3, 15.1 to 15.5, 16.x, 17.x and 18.x. A buffer tank set point for day operation and a buffer tank set point for night operation can be set without outdoor sensors in the customer level. An external demand transmitted from secondary controlled heating circuits, DHW circuit or an external request (by device bus, 0 to 10 V or binary signal) can override the current buffer tank set point. The maximum demand is indicated as the buffer tank set point for SF1. If the temperature falls below the buffer tank set point at SF1, charging of the buffer tank is started. This does not apply to systems Anl 3.9, 5.9 and 18.x. In these systems, the buffer tank set point is only determined by the DHW circuit.

In systems Anl 14.1 to 14.3 and 15.1 to 15.5, the set point of the charging temperature is always 6 °C higher than the buffer tank set point. Each charging of the buffer tank finishes as soon as the temperature at the top buffer tank sensor is +3 °C higher than the buffer tank set point (bottom buffer tank sensor in systems Anl 15.4 and 15.5). If charging of the DHW storage tank is demanded in systems Anl 14.1 to 14.3 and 15.1 to 15.3, it is first checked whether there is enough heat in the buffer tank to charge the DHW storage tank. The DHW storage tank is charged by the district heating system if the temperature in the buffer tank is insufficient for charging. The charging of the DHW storage tank has priority over a charging demand of the buffer tank. The buffer tank is charged once the DHW storage tank charging has been completed. In systems Anl 14.3 and 15.3, a solar circuit with reroutable heat exchanger flow is integrated. If the temperature difference between the collector circuit sensor RÜF2 and one of the storage tank sensors SF3 or SF4 is greater than the value of 'Solar circuit pump ON', the solar circuit pump UP2 is activated and the corresponding storage tank is charged. If both storage tanks can be charged, the DHW storage tank charging has priority. If the temperature difference falls below the value of 'Solar circuit pump OFF' in both storage tank circuits, the solar circuit pump UP2 is deactivated again. Basically, the solar circuit pump is deactivated when the measured temperatures of both storage tank sensors SF3 and

SF4 have reached the 'Max. storage tank temperature' or 'Maximum buffer tank temperature' or when the solar collector temperature rises above 120 °C.

In systems Anl 3.9, 5.9, 16.x, 17.x and 18.x, the set point of the charging temperature is determined by the 'Minimum set point to charge buffer tank' parameter setting in the PA1 level. The automatic adaptation ('AUTO' setting) causes the set point of the charging temperature to always be above the current buffer tank set point by the value entered in 'Charging temperature boost'. Every other value entered in 'Minimum set point to charge buffer tank' is used as the minimum set point for the charging temperature which first starts to be variable at higher buffer tank set points. When a return flow temperature sensor RÜF1 is used, the charging pump SLP (CO1 -> F22 - 1) is first released to avoid cold charging when the temperature measured at RÜF1 has reached the same temperature measured at SF1.

In systems Anl 3.9 and 5.9 this function only applies when the heating circuits RK2 and RK3 are not running. The 'Stop charging of the buffer tank' parameter (PA1 -> P17, default = AUTO) determines under which conditions the charging of the buffer tank is stopped. The automatic adaptation ('AUTO' setting) causes the buffer tank charging to be stopped when the temperature in the buffer tank reaches the value ('Buffer tank set point' + 'Hysteresis of buffer tank'). Every other value entered for 'Stop charging of the buffer tank' is rated as a fixed switch-off temperature for the buffer tank charging. When SF2 (CO1 -> F06 - 1) is configured, SF2 is used to stop the charging of the buffer tank. The CO1 -> F25 - 1 setting causes the buffer tank bottom sensor SF3 to be activated, which can be used to stop buffer tank charging at low outdoor temperatures. In this way, the buffer tank is not completely charged in summer mode with SF2 as a switch-off sensor to keep the return flow temperature low at the end of the buffer tank charging. The storage tank charging pump is not switched off until the lag time (entered 'Valve transit time Ty' for RK1 multiplied by 'Lag time of charging pump') has elapsed. An activated setting CO1 -> F27 - 1 (discharging protection) causes the charging to be stopped when the charging temperature does not reach its set point even though the valve is fully open or it falls below the temperature measured at SF1 and does not rise again. Charging with the valve fully open is stopped after one hour at the latest. In such cases, 'Operation: discharging protection' is displayed with the measured values in HC1 for the next 30 minutes.

The CO1 -> F27 - 1 setting causes a 2 °C higher charging set point to be calculated. The following then applies:

Charging set point = Set point at SF1 + 'Charging temperature boost' + 2 °C

The operation of the feeder pump UP1 in systems Anl 16.0 to 16.5, 16.7 and 16.8 is either determined by the ZP time schedule or prompted by an external demand. For systems with downstream control circuits, either only this external demand or the demand of the downstream control circuits causes the feeder pump UP1 to be activated, depending on the

Annex A (configuration instructions)

CO5 -> F14 setting.

The pump UP2 of the solid fuel boiler circuit in systems Anl 14.1, 14.2, 15.1, 15.2, 16.2, 16.4, 16.5 and 16.7 starts to run when the temperature reaches 'Start temperature for boiler pump' at VF2. The boiler pump is switched off again when the temperature at VF2 falls below the temperature T = 'Start temperature for boiler pump' - 'Boiler pump hysteresis'.

In systems Anl 14.3, 15.3, 16.3, 16.4, 16.6 and 16.7, a solar circuit is integrated, which uses sensor SF3 for control. The collector circuit pump CP is activated when the temperature at the collector sensor RÜF2 is higher than that at storage tank sensor SF3 by the value entered in 'Solar circuit pump ON'. It is deactivated when the temperature difference falls below the value entered in 'Solar circuit pump OFF', when the temperature at the storage tank sensor SF3 reaches 'Max. storage tank temperature' or when the collector temperature rises above 120 °C.

The AA4 output for the heat exchanger charging pump is used to control the DHW temperature in systems Anl 3.9, 5.9, 17.x and 18.x. The output AA1, AA2 or AA3 can also be assigned instead. A PWM signal or a 0 to 10 V signal can be configured that can also be reversed, if required. For operation of the heat exchanger charging pump, the minimum delivery rate and the control parameters to control the DHW temperature can be adjusted with CO4 -> F12 - 1.

The AA1 output is used for adapting the delivery rate of the charging pump SLP based on the temperature. The output AA2, AA3 or AA4 can also be assigned instead. A PWM signal or a 0 to 10 V signal can be configured that can also be reversed, if required. A flow switch can be activated with the CO4 -> F04 - 1 setting. The output UP1 for the changeover valve is activated by configuring the return flow temperature sensor RÜF2. The changeover valve is controlled based on the 'Return flow temperature limit, layering at top' parameter: If the temperature measured at RÜF2 exceeds the adjusted switching point, the output UP1 remains deactivated and the return flow water is layered at the top. After the temperature measured at RÜF2 has fallen below the switching point, the output UP1 is activated and the return flow water is layered at the bottom.

The CO4 -> F14 - 1 setting activates the **Thermal disinfection** function and the input RÜF3 required for this function. It may be necessary for the heating controller to initially ensure at the start of every thermal disinfection that a sufficiently high temperature exists in the buffer tank. Therefore, enough time for the thermal disinfection process must be available.

Alternatively, in systems Anl 3.9, 17.x and 18.x, an electric heating cartridge can be used for the thermal disinfection process. With the CO4 -> F23 - 1 setting the increased heat demand by the DHW circuit during an active thermal disinfection is not passed on to the buffer tank circuit RK1. The measured temperature at SF1 is decisive for the demand for electric

heating at the start of a thermal disinfection process and during the entire process: when the temperature at SF1 is the same or greater than 'Disinfection temperature' (function block parameter in CO4 -> F14) + 'Set point boost' (function block parameter in CO4 -> F14), there is no demand for electric heating. When the temperature at SF1 is below this limit, the binary output BA10 is activated to demand electric heating.

i Note

The buffer tank control circuit is deactivated as described in section 16.2.4.1. When pre-defined gradients of heating characteristic (CO1 -> F11 - 0) are used, night mode is not possible in the buffer tank control circuit. In contrast to an active four-point characteristic (CO1 -> F11 - 1): in this case, a four-point characteristic exists for day and night modes.

| Functions | Default | Configuration |
|--|------------|--|
| Storage tank sensor SF2 | 1 | CO1 -> F06 - 1 |
| Speed control of the charging pump | 0 | CO1 -> F21 - 1 |
| | 40.0 °C | Start speed reduction, limit: 5.0 to 90.0 °C |
| | 50.0 °C | Stop speed reduction, limit: 5.0 to 90.0 °C |
| | 20.0 °C | Minimum speed: 0 to 50 % |
| SLP depending on return flow temperature | 0 | CO1 -> F22 - 1 |
| Buffer tank bottom sensor | 0 | CO1 -> F25 - 1 |
| | 10.0 °C | Buffer tank bottom sensor SF3 active |
| | 10.0 °C | Limit temperature: 0.0 to 50.0 °C |
| Discharging protection | 0 | CO1 -> F27 - 1 |
| Return flow sensor RüF2 | 0 | CO4 -> F03 - 1 |
| Three-step control mode | 1 | CO4 -> F12 - 1 |
| | 20 % | Minimum speed: 5 to 50 % |
| | 2.0 | KP: 0.1 to 50.0 |
| | 120 s/30 s | TN: 1 to 999 s |
| | 0 s | TV: 0 to 999 s |
| Electric heating cartridge | 0 | CO4 -> F23 - 1 |

Annex A (configuration instructions)

| Functions | Default | Configuration |
|----------------------------|---------|--|
| AA1, AA2, AA3, AA4 reverse | 0 | CO5 -> F25, F26, F27, F28 - 1 |
| | 0 % | Zero: 0 to 50 % |
| AA1, AA2, AA3, AA4 PWM | 0 | CO5 -> F34, F35, F36, F37 - 1 Function: SLP speed, 'Y4' |

| Parameters | Default | Parameters: value range |
|--|---------|-----------------------------|
| Minimum set point to charge buffer tank | AUTO | PA1 -> P16: AUTO to 90.0 °C |
| Stop charging of the buffer tank | AUTO | PA1 -> P17: AUTO to 90.0 °C |
| Charging temperature boost | 6.0 °C | PA1 -> P18: 0.0 to 50.0 °C |
| Lag time of charging pump | 1.0 | PA1 -> P19: 0.0 to 10.0 |
| Solar circuit pump ON | 10.0 °C | PA4 -> P10: 1.0 to 30.0 °C |
| Solar circuit pump OFF | 3.0 °C | PA4 -> P11: 0.0 to 30.0 °C |
| Max. storage tank temperature | 80.0 °C | PA4 -> P12: 20.0 to 90.0 °C |
| Maximum buffer tank temperature | 80.0 °C | PA4 -> P13: 20.0 to 90.0 °C |
| Return flow temperature limit, layering at top | 25.0 °C | PA4 -> P21: 5.0 to 90.0 °C |
| Start temperature for boiler pump | 60.0 °C | PA5 -> P01: 20.0 to 90.0 °C |
| Boiler pump hysteresis | 5.0 °C | PA5 -> P02: 0.0 to 30.0 °C |

16.2.6 Summer mode

Summer mode is activated depending on the mean daytime temperature (measured between 7.00 h and 22.00 h) during the adjusted summer time period. If the mean daytime temperature exceeds the 'Boost' on the number of successive days set in 'No. days until activation', summer mode is activated on the following day. This means that the valves in all heating circuits are closed and the circulation pumps are switched off after $t = 2 \times$ valve transit time. If the mean daytime temperature falls below the 'Limit' on the number of successive days set in 'No. days until deactivation', summer mode is deactivated on the following day.

| Functions | Default | Configuration |
|-------------|---------------|-------------------------------------|
| Summer mode | 0 | CO5 -> F04 - 1 |
| | 01.06 - 30.09 | Time: Adjustable as required |
| | 2 | No. days until activation: 1 to 3 |
| | 1 | No. days until deactivation: 1 to 3 |
| | 18.0 °C | Limit: 0.0 to 30.0 °C |

i Note

Summer mode only becomes effective when the controller is in automatic mode (☉).

16.2.7 Delayed outdoor temperature adaptation

The calculated outdoor temperature is used to determine the flow temperature set point. The heat response is delayed when the outdoor temperature either increases or decreases or both. If the outdoor temperature varies by, for example 12 °C within a very short period of time, the calculated outdoor temperature is adapted to the actual outdoor temperature in small steps using a delay of 3 °C/h over a time period of $t = \frac{12\text{ °C}}{3\text{ °C/h}} = 4\text{ h}$.

i Note

The delayed outdoor temperature adaptation helps avoid unnecessary overloads of central heating stations in combination with either overheated buildings occurring, for example due to warm winds or temporarily insufficient heating due to the outdoor sensor being exposed to direct sunshine. In the operating level, the outdoor temperature blinks on the display while delayed outdoor temperature adaptation is active. A small hour glass appears next to the thermometer on the display when this function is active. The calculated outdoor temperature is displayed.

After a controller restart, this function takes effect after a delay of 1 to 2 minutes.

| Functions | Default | Configuration |
|---|-------------|--|
| Delayed outdoor temperature adaptation (decreasing) | 0 | CO5 -> F05 - 1 Delay/h: 0.2 to 6.0 °C |
| Delayed outdoor temperature adaptation (increasing) | 0 3.0 °C | CO5 -> F06 - 1 Delay/h: 0.2 to 6.0 °C |

16.2.8 Remote operation

Apart from measuring the room temperature, the Types 5257-5¹⁾ and Type 5257-51 Room Panels (Pt1000 sensor) as well as Type 5244¹⁾ Room Panel (PTC sensor) provide the following opportunities of influencing the control process:

- | | |
|-------------------------------|------------------|
| Selecting the operating mode: | ☉ Automatic mode |
| | ⚙ Day mode |
| | ☾ Night mode |

Annex A (configuration instructions)

Set point correction: During rated operation, the room temperature set point can be increased or reduced by up to 5 °C using a continuously adjustable rotary knob.

With an activated room sensor, the measured room temperature is displayed when the remote operation is connected and activated. Nevertheless, it is not used for control when either the **optimization**, **adaptation** or **flash adaptation** function is activated.

Alternatively, the TROVIS 5570 ¹⁾ Room Panel can be connected over meter bus (see section 16.4.15).

¹⁾ No longer available

| Functions | Default | Configuration |
|-------------|---------|----------------------------------|
| Room sensor | 0 | CO1, 2, 3, 11, 12, 13 -> F01 - 1 |

The following needs to be additionally configured if a TROVIS 5570 Room Panel is to be used:

| | | |
|-------------------------------|---|------------------------------------|
| Device bus | 0 | CO7 -> F01 - 1, device bus address |
| TROVIS 5570 Room Panel in RK1 | 0 | CO7 -> F03 - 1, device bus address |
| TROVIS 5570 Room Panel in RK2 | 0 | CO7 -> F04 - 1, device bus address |
| TROVIS 5570 Room Panel in RK3 | 0 | CO7 -> F05 - 1, device bus address |

Note

Room panels cannot be used for the heating circuits RK11, RK12 and RK13.

16.2.9 Optimization

This function requires the use of a room sensor. Depending on the building characteristics, the heating controller determines and adapts the required advance heating time (maximum 8 hours) to ensure that the desired 'Day set point' (rated room temperature) has been reached in the reference room when the time-of-use starts. During the advance heating period, the controller heats with the max. flow temperature. This temperature is built up in steps of 10 °C. As soon as the 'Day set point' has been reached, outdoor-temperature-compensated control is activated.

Depending on the room sensor, the heating controller switches off the heating system up to one hour before the time-of-use ends. The heating controller chooses the deactivation time such that the room temperature does not drop significantly below the desired value until the time-of-use ends.

During the advance heating period and the premature deactivation of the heating system, the  or  icon blinks on the display.

Outside the times-of-use, the heating controller monitors the 'Night set point' (reduced room temperature). When the temperature falls below the night set point, the controller heats with the max. flow temperature until the measured room temperature exceeds the adjusted value by 1 °C.

i Note

- Direct sunshine can cause the room temperature to increase and thus result in the premature deactivation of the heating system.
- When the room temperature decreases while the heating system is shortly outside its times-of-use, this can prematurely cause the controller to heat up to the 'Day set point'.

| Functions | Default | Configuration |
|-----------------|---------|----------------------------------|
| Room sensor | 0 | CO1, 2, 3, 11, 12, 13 -> F01 - 1 |
| Outdoor sensor | 1 | CO1, 2, 3, 11, 12, 13 -> F02 - 1 |
| Optimization | 0 | CO1, 2, 3, 11, 12, 13 -> F07 - 1 |
| Parameters | Default | Switch position: value range |
| Day set point | 20.0 °C | ☀: 0.0 to 40.0 °C |
| Night set point | 15.0 °C | 🌙: 0.0 to 40.0 °C |

16.2.10 Flash adaptation

To ensure that the controller reacts immediately to room temperature deviations during rated and reduced operation, the function block setting CO1, 2, 3, 11, 12, 13 -> F09 - 1 needs to be made. The heating is then always switched off as soon as the room temperature exceeds the 'Day set point' or 'Night set point' by 2 °C.

Heating first starts again when the room has cooled off and the room temperature is 1 °C above the set point. The flow temperature set point is corrected if the 'Cycle time' or 'Gain KP' are set to a value other than 0. The 'Cycle time' determines the intervals at which the flow temperature set point is corrected by 1 °C. A 'KP (gain)' set to a value other than 0 causes a direct increase/decrease in flow temperature set point when a sudden deviation in room temperature arises. A 'KP (gain)' setting of 10.0 is recommended.

i Note

- Cooling loads, such as drafts or open windows, affect the control process.
- Rooms may be temporarily overheated after the cooling load has been eliminated.

| Functions | Default | Configuration |
|------------------|--------------------|--|
| Room sensor | 0 | CO1, 2, 3, 11, 12, 13 -> F01 - 1 |
| Outdoor sensor | 1 | CO1, 2, 3, 11, 12, 13 -> F02 - 1 |
| Flash adaptation | 0 20 min 0.0 | CO1, 2, 3, 11, 12, 13 -> F09 - 1 Cycle time: 0 to 100 min KP (gain): 0.0 to 25.0 |
| Parameters | Default | Switch position: value range |
| Day set point | 20.0 °C | ☀: 0.0 to 40.0 °C |
| Night set point | 15.0 °C | ☾: 0.0 to 40.0 °C |

16.2.10.1 Flash adaptation without outdoor sensor (based on room temperature)

The flow temperature control starts with 'Day set point' for flow in rated operation or with 'Night set point' for flow in reduced operation as no set points calculated using characteristics exist without an outdoor sensor. The 'Cycle time' determines the intervals at which the flow temperature set point is corrected by 1 °C. The heating is then always switched off as soon as the room temperature exceeds the 'Day set point' or 'Night set point' by 2 °C. Heating first starts again when the room has cooled off and the room temperature is 1 °C above the set point. A 'KP (gain)' set to a value other than 0 causes a direct increase/decrease in flow temperature set point when a sudden deviation in room temperature arises. A 'KP (gain)' setting of 10.0 is recommended.

| Functions | Default | Configuration |
|------------------------|--------------------|--|
| Room sensor | 0 | CO1, 2, 3, 11, 12, 13 -> F01 - 1 |
| Outdoor sensor | 1 | CO1, 2, 3, 11, 12, 13 -> F02 - 0 |
| Flash adaptation | 0 20 min 0.0 | CO1, 2, 3, 11, 12, 13 -> F09 - 1 Cycle time: 1 to 100 min KP (gain): 0.0 to 25.0 |
| Parameters | Default | Switch position: value range |
| Day set point | 20.0 °C | ☀: 0.0 to 40.0 °C |
| Night set point | 15.0 °C | ☾: 0.0 to 40.0 °C |
| Parameters | Default | Parameters: value range |
| Flow set point (day) | 50.0 °C | PA1, 2, 3, 11, 12, 13 -> P03: 5.0 to 150.0 °C |
| Flow set point (night) | 30.0 °C | PA1, 2, 3, 11, 12, 13 -> P04: 5.0 to 150.0 °C |

16.2.11 Adaptation

The heating controller is capable of automatically adapting the heating characteristic to the building characteristics. A gradient characteristic must be set in this case (CO1, 2, 3, 11, 12, 13 -> F11 - 0). The reference room, where the room sensor is located, represents the entire building and is monitored to ensure that the room temperature set point ('Day set point') is maintained. When the mean measured room temperature in rated operation deviates from the adjusted set point, the heating characteristic is modified accordingly for the following time-of-use. The corrected value is displayed in PA1, 2, 3, 11, 12, 13 > P01 (Gradient, flow).

| Functions | Default | Configuration |
|---------------------------|---------|----------------------------------|
| Room sensor | 0 | CO1, 2, 3, 11, 12, 13 -> F01 - 1 |
| Outdoor sensor | 1 | CO1, 2, 3, 11, 12, 13 -> F02 - 1 |
| Adaptation | 0 | CO1, 2, 3, 11, 12, 13 -> F08 - 1 |
| Four-point characteristic | 0 | CO1, 2, 3, 11, 12, 13 -> F11 - 0 |
| Parameters | Default | Switch position: value range |
| Day set point | 20.0 °C | ☀: 0.0 to 40.0 °C |
| Night set point | 15.0 °C | 🌙: 0.0 to 40.0 °C |

i Note

*If the **Flash adaptation** function is already configured with a small cycle time, the **Adaptation** function should not be configured as well.*

16.2.12 Cooling control

Cooling control with outdoor sensor

When the cooling control function is activated in a control circuit with outdoor sensor, the four-point characteristic of the corresponding control circuit is automatically activated and the operating direction of the control output is reversed. In PA1, PA2 and/or PA3 the four points for the course of the set point based on the outdoor temperatures can be adjusted separately for day and night mode. The 'Base point for return flow temperature' that can be adjusted with an active return flow sensor determines the point at which a minimum limitation of the return flow temperature starts: if the measured return flow temperature falls below this value, the flow temperature set point is raised. The four return flow temperature values in the four-point characteristic function have no effect.

Annex A (configuration instructions)

| Functions | Default | Configuration |
|---------------------------|---------|----------------------|
| Outdoor sensor | 1 | CO1, 2, 3 -> F02 - 1 |
| Cooling control | 0 | CO1, 2, 3 -> F04 - 1 |
| Four-point characteristic | 0 | CO1, 2, 3 -> F11 - 1 |

| Parameters | Default | Parameters: value range |
|---|---------|----------------------------------|
| Outdoor temperature | Point 1 | 5.0 °C |
| | Point 2 | 15.0 °C |
| | Point 3 | 25.0 °C |
| | Point 4 | 35.0 °C |
| Flow temperature | Point 1 | 20.0 °C |
| | Point 2 | 15.0 °C |
| | Point 3 | 10.0 °C |
| | Point 4 | 5.0 °C |
| Reduced flow temperature | Point 1 | 30.0 °C |
| | Point 2 | 25.0 °C |
| | Point 3 | 20.0 °C |
| | Point 4 | 15.0 °C |
| Base point for return flow temperature: | 65.0 °C | PA1, 2, 3 -> P13: 5.0 to 90.0 °C |

i Note

The limiting factors KP of the **Return flow sensor** (CO1, 2, 3 -> F03) functions apply during cooling control as well.

Cooling control without outdoor sensor

When the cooling control function is activated in a control circuit without outdoor sensor, only the adjustment limits for the day and night set points at the rotary switch as well as the 'Base point for return flow temperature' can be adjusted in PA1 and/or PA2.

| Functions | Default | Configuration |
|-----------------|---------|----------------------|
| Outdoor sensor | 1 | CO1, 2, 3 -> F02 - 0 |
| Cooling control | 0 | CO1, 2, 3 -> F04 - 1 |

| Parameters | Default | Switch position: value range |
|------------------------|---------|------------------------------|
| Flow set point (day) | 20.0 °C | ↓☀: -5.0 to 150.0 °C |
| Flow set point (night) | 30.0 °C | ↓☾: -5.0 to 150.0 °C |

| Parameters | Default | Parameters: value range |
|---|---------|------------------------------------|
| Min. flow temperature | 20.0 °C | PA1, 2, 3 -> P06: -5.0 to 150.0 °C |
| Max. flow temperature | 70.0 °C | PA1, 2, 3 -> P07: 5.0 to 150.0 °C |
| Base point for return flow temperature: | 65.0 °C | PA1, 2, 3 -> P13: 5.0 to 90.0 °C |

i Note

- The limiting factors **KP** of the **Return flow sensor** (CO1, 2, 3 -> F03) functions apply during cooling control as well.
- The request for a signal by downstream control circuits or externally (when a pre-control circuit is used) is based on the maximum selection. Therefore, systems (e.g. system Anl 5.0) or heating controllers connected over a device bus are not suitable for transmitting the signal for required cooling. The 'Set point boost (pre-control circuit)' parameter can only generate higher and not lower set points in the pre-control circuit.

16.2.13 Differential temperature control


In systems Anl 1.0 and 16.0, the differential temperature control causes the delivery rate of pump UP1 to be adapted depending on the difference between the secondary flow temperature and the secondary return flow temperature. In system Anl 1.0 the sensor input RÜF2 is automatically activated for this purpose with the setting CO1 -> F23 - 1. In system Anl 16.0, the sensor inputs VF2 and RÜF2 are automatically activated. The KP (influence factor) determines how strongly the heating controller responds when the temperature deviates from the set point of the differential temperature control. The output AA1 is used for the differential temperature control. The output AA2, AA3 or AA4 can also be assigned instead. A PWM signal or a 0 to 10 V signal can be configured that can also be reversed, if required.

| Functions | Default | Configuration |
|----------------------------------|---------|---|
| Differential temperature control | 0 | CO1 -> F23 - 1 |
| | 20.0 °C | Set point of differential temperature control: 0.0 to 50.0 °C |
| | 1.0 | |
| | 20 % | KP (influence factor): 0.1 to 10.0 Minimum speed: 0 to 100 % |
| AA1, AA2, AA3, AA4 reverse | 0 | CO5 -> F25, F26, F27, F28 - 1 |
| | 0 % | Zero: 0 to 50 % |
| AA1, AA2, AA3, AA4 PWM | | CO5 -> F34, F35, F36, F37 - 1 Function: differential temperature control |

16.3 Functions of the DHW circuit

16.3.1 DHW heating in the storage tank system

Start storage tank charging

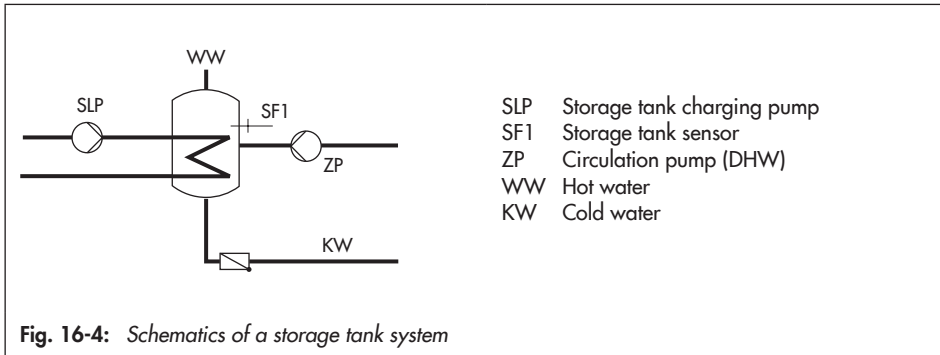

The heating controller begins charging the storage tank when the water temperature measured at storage tank sensor 1 falls below the 'DHW temperature set point' by 0.1 °C. If the flow temperature in the system exceeds the desired charging temperature, the heating controller tries to reduce the flow temperature in the heating circuit for up to three minutes before the storage tank charging pump is activated. When there is no heating operation or when the flow temperature in the system is lower, the storage tank charging pump is switched on immediately. If the function CO4 -> F15 - 1 (**SLP ON depending on return flow temperature**) is activated, the primary valve is opened without simultaneously operating the storage tank charging pump. The storage tank charging pump is first switched on when the primary return flow temperature has reached the temperature currently measured at storage tank sensor 1. This function enables storage tank charging when the heating system is switched off, e.g. in summer mode, without cooling down the storage tank first by filling it with cold flow water. The storage tank charging pump does not start operation before a sufficiently high temperature has been reached at the heat exchanger. An activated setting CO4 -> F27 - 1 (discharging protection) causes the charging to be stopped when the charging temperature does not reach its set point even though the valve is fully open or it falls below the temperature measured at SF1 and does not rise again. Charging with the valve fully open is stopped after one hour at the latest. In such cases, 'Operation: discharging protection' is displayed with the measured values in the DHW circuit for the next 30 minutes.

i Note

The 'DHW temperature set point' is to be regarded in relation to the charging temperature if a storage tank thermostat is used.

Time-controlled switchover of storage tank sensors

By configuring a second storage tank sensor 2, it is possible to determine by setting the function block CO4 -> F19 - 1 that the storage tank sensor 1 is used for day mode in the DHW circuit and storage tank sensor 2 for night mode. As a result, different storage tank volumes can be kept at a constant temperature according to a time schedule and also at different temperatures if the 'DHW temperature set points' for day and night differ from one another.

Stop storage tank charging

The heating controller stops charging the storage tank when the water temperature measured at storage tank sensor 1 has reached the temperature $T = \text{'DHW temperature'} + \text{'Hysteresis'}$. When there is no heating operation or when the flow temperature demand in the system is lower, the corresponding valve is closed. The storage tank charging pump is switched off after $t = \text{'Lag time of storage tank charging pump'} \times \text{'Valve transit time'}$.

With the default settings, the temperature in the storage tank is increased by 5 °C to reach 65 °C when the storage tank temperature falls below 60 °C. The charging temperature is calculated from the DHW temperature (60 °C) plus the 'Charging temperature boost' (10 °C), which equals 70 °C. When the storage tank has been charged, the heating valve is closed and the charging pump continues to run for the time $t = P06 \times \text{Valve transit time}$. Outside the times-of-use, the storage tank is only charged when the temperature falls below 40 °C ('Night set point for DHW temperature'). In this case, the tank is charged with a charging temperature of 50 °C until 45 °C is reached in the tank.

| Functions | Default | Configuration |
|--|---------|--|
| Storage tank sensor SF1 | 1 | CO4 -> F01 - 1 |
| Storage tank sensor SF2 | 0 | CO4 -> F02 (-1 when CO4 -> F19 - 1) |
| SLP depending on return flow temperature | 0 | CO4 -> F15 |
| Switchover | 0 | CO4 -> F19 (-1 only when CO4 -> F02 - 1) |
| Discharging protection | 0 | CO4 -> F27 - 1 |

Annex A (configuration instructions)

| Parameters | Default | Switch position: value range |
|---|---------|--|
| Day set point for DHW temperature and charging temperature when CO4 > F01 - 0 | 60.0 °C | ☀: Min. to max. adjustable DHW set point |
| Night set point for DHW temperature | 40.0 °C | ☾: Min. to max. adjustable DHW set point |
| Parameters | Default | Parameters: value range |
| Min. adjustable DHW set point ¹⁾ | 40.0 °C | PA4 -> P01: 5.0 to 90.0 °C |
| Max. adjustable DHW set point ¹⁾ | 60.0 °C | PA4 -> P02: 5.0 to 90.0 °C |
| Hysteresis ²⁾ | 5.0 °C | PA4 -> P03: 0.0 to 30.0 °C |
| Charging temperature boost ³⁾ | 10.0 °C | PA4 -> P04: 1.0 to 50.0 °C |
| Lag time for storage tank charging pump | 1.0 | PA4 -> P19 x Valve transit time: 0.0 to 10.0 |


¹⁾ Parameters serve as limitation of the adjustment range for the DHW temperature to be set at the rotary switch

²⁾ Deactivation value T = DHW temperature + 'Hysteresis'

³⁾ Charging temperature T = DHW temperature + 'Charging temperature boost'

16.3.1.1 DHW circuit additionally controlled by a globe valve

In systems An1 7.1, 8.1, 9.1, 9.5, 11.1, 12.1, 13.1 and 21.1, the following versions with globe valve can be configured instead of the three-way valve control in the DHW circuit:

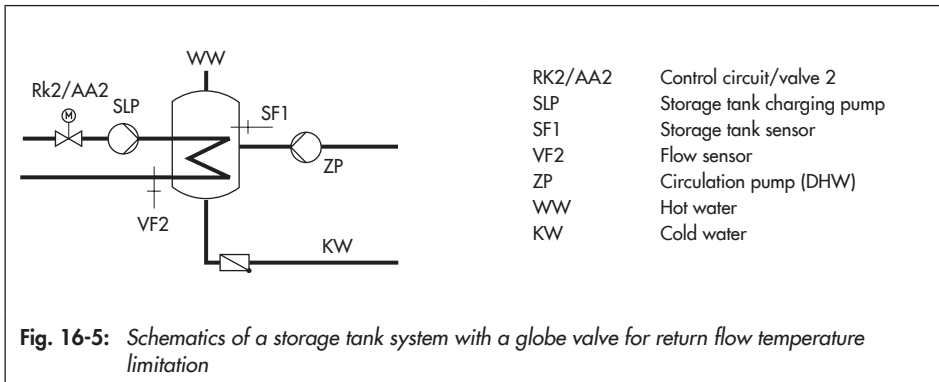


Globe valve and flow sensor VF2 are used exclusively for return flow temperature limitation in the schematics shown above. The pre-control circuit provides at least the same flow temperature as in the standard schematic version which is calculated from DHW temperature set point + Charging temperature boost + Boost set point of pre-control circuit.

The functions and parameters of the **DHW heating in the storage tank system** are upgraded by the following settings:

| Functions | Default | Configuration |
|------------------------------|---------|-----------------------------|
| Return flow control | 0 | CO4 -> F20 - 1 |
| Parameters | Default | Parameters: value range |
| Max. return flow temperature | 65.0 °C | PA4 -> P07: 20.0 to 90.0 °C |

16.3.2 DHW heating in the storage tank charging system

Start storage tank charging

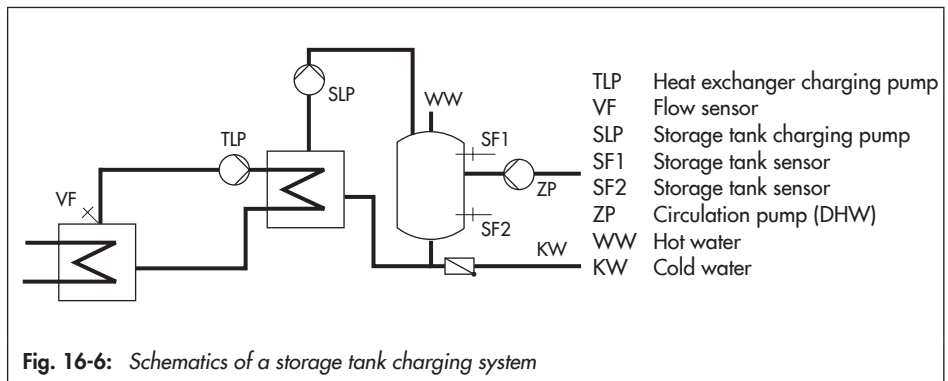

The heating controller begins charging the storage tank when the water temperature measured at storage tank sensor SF1 falls below the 'DHW temperature set point' by 0.1 °C. If the flow temperature in the system exceeds the desired charging temperature, the heating controller tries to reduce the flow temperature in the heating circuit for up to three minutes before the storage tank charging pump is activated. When there is no heating operation or when the flow temperature in the system is lower, the exchanger charging pump is switched on immediately. If the temperature currently measured at storage tank sensor 1 is reached at the flow sensor VF, the storage tank charging pump is switched on. An activated setting CO4 -> F27 - 1 (discharging protection) causes the charging to be stopped when the charging temperature does not reach its set point even though the valve is fully open or it falls below the temperature measured at SF1 and does not rise again. Charging with the valve fully open is stopped after one hour at the latest. In such cases, 'Operation: discharging protection' is displayed with the measured values in the DHW circuit for the next 30 min-

Annex A (configuration instructions)

utes. If a storage tank thermostat is used, the storage tank charging pump is switched on when the temperature $T = \text{Charging temperature} - 5\text{ °C}$ is reached at the flow sensor VF.

i Note

The 'DHW temperature set point' is to be regarded in relation to the charging temperature if a storage tank thermostat is used.

When the flow sensor VF4 is activated, the set point in the heat exchanger circuit is influenced by the system deviation in the storage tank charging circuit upon activation of the storage tank charging pump: if the temperature measured at flow sensor VF4 is lower than the desired 'Charging temperature', the set point in the heat exchanger circuit is increased in steps of 1 °C.

When the set point in the heat exchanger charging circuit reaches the 'Max. charging temperature', the set point is no longer increased. An error message (Max. charging temp.) is generated.

i Note

The set point in the heat exchanger circuit which is valid at the end of the charging cycle will be used again at the beginning of the next cycle.

If times-of-use have been programmed for DHW heating, the 'DHW temperature set point' adjusted at the rotary switch is applied during these times-of-use. Outside the times-of-use, the night set point for DHW temperature is used. This function does not apply when a storage tank thermostat is used.

Time-controlled switchover of storage tank sensors

By configuring a second storage tank sensor 2, it is possible to determine by setting the function block CO4 -> F19 - 1 that the storage tank sensor 1 is used for day mode in the DHW circuit and storage tank sensor 2 for night mode. As a result, different storage tank volumes can be kept at a constant temperature according to a time schedule and also at different temperatures if the 'DHW temperature set points' for day and night differ from one another.

Stop storage tank charging

The heating controller stops charging the storage tank when the water temperature measured at storage tank sensor 2 has reached the temperature $T = \text{'DHW temperature'} + \text{'Hysteresis'}$. To do so, the heat exchanger charging pump is immediately switched off. When there is no heating operation or when the flow temperature demand in the system is lower, the corre-

sponding valve is closed. The storage tank charging pump is switched off after the time has elapsed $t = PO6 \times$ valve transit time.

| Functions | Default | Configuration |
|---|---------|--|
| Storage tank sensor SF1 | | CO4 -> F01 - 1 |
| Storage tank sensor SF2 | | CO4 -> F02 - 1 |
| Flow sensor | 0 | CO4 -> F05 |
| Switchover | 0 | CO4 -> F19 |
| Discharging protection | 0 | CO4 -> F27 - 1 |
| Parameters | Default | Switch position: value range |
| Day set point for DHW temperature and charging temperature when CO4 > F01 - 0 | 60.0 °C | ☼: Min. to max. adjustable DHW set point |
| Night set point for DHW temperature | 40.0 °C | ☾: Min. to max. adjustable DHW set point |
| Min. adjustable DHW set point ¹⁾ | 40.0 °C | PA4 -> P01: 5.0 to 90.0 °C |
| Max. adjustable DHW set point ¹⁾ | 60.0 °C | PA4 -> P02: 5.0 to 90.0 °C |
| Hysteresis ²⁾ | 5.0 °C | PA4 -> P03: 1.0 to 30.0 °C |
| Charging temperature boost ¹⁾ | 10.0 °C | PA4 -> P04: 0.0 to 50.0 °C |
| Max. charging temperature | 80.0 °C | PA4 -> P05: 20.0 to 150.0 °C (only with VF4) |
| Lag time for storage tank charging pump | 1.0 | PA4 -> P06: 0.0 to 10.0 |

¹⁾ Parameters serve as limitation of the adjustment range for the DHW temperature to be set at the rotary switch

²⁾ Deactivation value $T = \text{DHW temperature} + \text{'Hysteresis'}$

³⁾ Charging temperature $T = \text{DHW temperature} + \text{'Charging temperature boost'}$


16.3.2.1 Cold charging protection

In system Anl 1.1(-1), the **cold charging protection** function causes a storage tank charging to be started first when the primary flow temperature is sufficiently high enough. The CO4 -> F22 - 1 setting automatically activates the FG2 input to measure the primary flow temperature. If the measured primary flow temperature is lower than the measured storage tank temperature (e.g. due to a supply line that has cooled down at the start of a storage tank charging), the heating circuit valve is moved to the adjusted position at first. The storage tank charging is not released in absolute priority operation until the primary flow temperature has risen enough as a result. Parallel operation must be additionally configured if it is required.

Annex A (configuration instructions)

| Functions | Default | Configuration |
|--------------------------|------------------------|---|
| Cold charging protection | 0 10 % | CO4 -> F22 - 1 Valve position: 1 to 100 % |
| Parallel pump operation | 0 10 min 40.0 °C | CO4 -> F06 - 1 Stop: 0 to 10 min Temperature limit: 20.0 to 90.0 °C |

16.3.3 DHW heating in instantaneous heating system

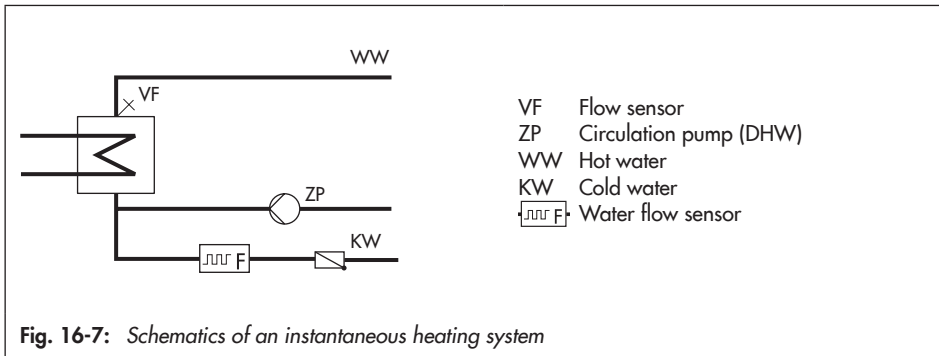

Without flow rate sensor or flow switch, the control of the required DHW temperature at the flow sensor VF is only active during times-of-use of the circulation pump ZP. The water flow sensor or flow switch allows the heating controller to recognize when DHW tapping starts and stops. Control of the required DHW temperature can be made to be active only during DHW tapping by deleting all times-of-use of the circulation pump. If the control with flow rate sensor is configured, the attenuation in the DHW circuit (CO4 -> F13 - 1) is automatically activated and the temperature set to 8 °C.

The control of the required DHW temperature at the flow sensor VF is only active during times-of-use of the circulation pump ZP.

If a water flow sensor is connected (see Fig. 16-7), make sure that the function '10 V supply' is configured with the CO5 -> F34, 35, 36 or 37 setting.

i Note

After entering the key number 1999, the status information, e.g. operating point, valve controller (influence of the PI component on the valve position) and valve sensor (influence of the manipulated variable on the valve position), is displayed in the extended operating level as a percent after the sectional display of the DHW circuit.

| Functions | Default | Configuration |
|-------------------------------------|-------------|---|
| Flow rate sensor | 0 Analog | CO4 -> F04 - 1 Select: Analog (flow rate sensor), Binary (flow switch) |
| AA1, AA2, AA3, AA4 PWM | 0 | CO4 -> F34, F35, F36, F37 - 0 Function: 10 V supply |
| Parameters | Default | Switch position: value range |
| Day set point for DHW temperature | 60.0 °C | ☀: Min. to max. adjustable DHW set point |
| Night set point for DHW temperature | 40.0 °C | 🌙: Min. to max. adjustable DHW set point |
| Parameters | Default | Parameters: value range |
| Min. adjustable DHW set point | 40.0 °C | PA4 -> P01: 5.0 to 90.0 °C |
| Max. adjustable DHW set point | 60.0 °C | PA4 -> P02: 5.0 to 90.0 °C |

16.3.4 Domestic hot water heating with solar system

The systems An1 1.3, 1.4, 1.7, 1.8, 2.3, 2.4, 3.3, 3.4, 4.3, 10.3, 11.3 and 11.4 are fitted with a solar system for DHW heating. In these systems, the difference between the temperatures measured at storage sensor SF3 and the sensor at the solar collector VF3 is determined. The 'Solar circuit pump ON' parameter determines the minimum temperature difference between sensors VF3 and SF3 required to activate the solar circuit pump. If the temperature difference falls below the value of 'Solar circuit pump OFF', the solar circuit pump is switched off. Basically, the solar circuit pump is also switched off when either the water temperature measured at sensor SF3 has reached the 'Max. storage tank temperature' or when the solar collector temperature rises above 120 °C.

i Note

The times-of-use of the DHW circuit do not affect the operation of the solar system.

Annex A (configuration instructions)

After the key number 1999 has been entered, the operating hours of the solar pump are displayed in extended operating level (see the 'Operation' section).

| Parameters | Default | Parameters: value range |
|-------------------------------|---------|-----------------------------|
| Solar circuit pump ON | 10.0 °C | PA4 -> P10: 1.0 to 30.0 °C |
| Solar circuit pump OFF | 3.0 °C | PA4 -> P11: 0.0 to 30.0 °C |
| Max. storage tank temperature | 80.0 °C | PA4 -> P12: 20.0 to 90.0 °C |

16.3.5 Intermediate heating

This function can only be activated in systems Anl 2.x, 4.1 to 4.5, 6.1, 8.x, 9.5 and 9.6.

With the setting CO4 -> F07 - 1, heating operation of the UP1 heating circuit is reactivated for a period of ten minutes after 20 minutes of priority operation (heating deactivated during DHW heating). By setting CO4 -> F07 - 0, storage tank charging is given unlimited priority over the heating operation in the UP1 heating circuit.

| Functions | Default | Configuration |
|----------------------|---------|----------------|
| Intermediate heating | 1 | CO4 -> F07 - 1 |

16.3.6 Parallel pump operation

This function can only be activated in systems Anl 1.1-1, 2.x, 4.1 to 4.5, 6.1, 8.x, 9.5 and 9.6.

When CO4 -> F06 - 1, the circulation pump UP1 remains activated during DHW heating.

This does not include operating situations during which the current flow temperature demand of the pump circuit is lower than the adjusted 'Temperature limit'. In this case, the controller applies priority operation, if necessary with intermediate heating. Once a parallel pump operation cycle has been activated and the time period set in 'Stop' has elapsed, system deviations greater than 5 °C cause the controller to suspend parallel operation for 10 minutes and to apply priority operation.

Setting 'Stop' to 0 min leads to a parallel operation once initiated remaining regardless of a deviation.

| Functions | Default | Configuration |
|-------------------------|---------|------------------------------------|
| Parallel pump operation | 0 | CO4 -> F06 - 1 |
| | 10 min | Stop: 0 to 10 min |
| | 40.0 °C | Temperature limit: 20.0 to 90.0 °C |

16.3.7 Circulation pump during storage tank charging

With the setting CO4 -> F11 - 1, the circulation pump (DHW) continues operation according to the programmed time schedule even during storage tank charging. With the setting CO4 -> F11 - 0, the circulation pump is switched off as soon as the storage tank charging pump is activated. The circulation pump starts to operate again according to the time schedule when the storage tank charging pump has been switched off again.

| Functions | Default | Configuration |
|--|---------|---------------|
| Operation of circulation pump (DHW) during storage tank charging | 0 | CO4 -> F11 |

16.3.8 Priority circuit

In many district heating systems with primary DHW heating, the allotted amount of water cannot meet DHW heating and heating operation demands when they are required at the same time. As a result, the capacity required for DHW heating needs to be taken from the heating system when great heating loads occur; and this, until DHW demand has been concluded. Nevertheless, heating operation is not to be interrupted simply. Only the amount of energy required for DHW heating is to be deducted. This can be achieved by using the priority functions: reverse control and set-back operation.

16.3.8.1 Reverse control

In all systems with DHW heating and at least one heating circuit with a control valve, DHW heating can be given priority by applying reverse control. With the setting CO4 -> F08 - 1, the temperature is monitored at sensor VFx.

In systems without sensor VFx in the DHW circuit (e.g. Anl 4.5, 11.0, 12.0, 13.0 and 21.0), the temperature is monitored directly at storage tank sensor 1. If system deviations still occur after the time set in 'Start' has elapsed, the set point of the heating circuit with the control valve is gradually reduced each minute until the flow temperature set point has reached 5 °C at the minimum. How strongly the heating controller responds is determined by the 'Influence factor KP'.

When 'Start' is set to 0, the priority operation is started regardless of the time and temperature in the system. The control valves of the corresponding heating circuits are closed.

Annex A (configuration instructions)

| Functions | Default | Configuration |
|---------------------|-------------------|---|
| Priority (reverse) | 0 2 min 1.0 | CO4 -> F08 - 1 Start: 0 to 10 min KP (influence factor): 0.1 to 10.0 Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3 |
| Priority (set-back) | 0 | CO4 -> F09 - 0 |

16.3.8.2 Set-back operation

In all systems with DHW heating and at least one heating circuit with a control valve, DHW heating can be given priority by applying set-back operation. With the setting CO4 -> F09 - 1, the temperature is monitored at sensor VFx in the DHW circuit.

In systems without sensor VFx in the DHW circuit (e.g. systems An1 4.5, 11.0, 12.0, 13.0 and 21.0), the temperature is monitored directly at storage tank sensor 1. If system deviations still occur after the time set in Start has elapsed, the selected heating circuits with the control valve are set to reduced operation.

When 'Start' is set to 0, the priority operation is started in all heating circuits regardless of the time and temperature in the system.

| Functions | Default | Configuration |
|---------------------|------------|---|
| Priority (reverse) | 0 | CO4 -> F08 - 0 |
| Priority (set-back) | 0 2 min | CO4 -> F09 - 1 Start: 0 to 10 min Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3 |

16.3.9 Forced charging of DHW storage tank

To provide the full network performance for room heating when the time-of-use of the heating circuits begins, any storage tanks are charged one hour before the time-of-use of the heating circuits starts. For the individual heating controller, this means that storage tank charging is activated when the water temperature in the storage tank falls below the adjusted deactivation value of $T = \text{'DHW temperature'} + \text{'Hysteresis'}$.

The forced charging of the storage tank does not take place when the DHW circuit is not used at the beginning of the time-of-use set for the heating circuit(s).

i Note

This function is not available when a storage tank thermostat is used.

16.3.10 Thermal disinfection of DHW storage tank

In all systems with DHW heating, a thermal disinfection is performed on a selected day of the week or daily.

- In systems with DHW storage tank, it is heated up, taking into account the Charging temperature boost parameter (or Set point boost, depending on the system) to the adjusted Disinfection temperature. Disinfection takes place within the adjusted time period ('Time').
- In systems with DHW heating in instantaneous heating system, the function remains active taking into account the Boost parameter until the circulation pipe, measured at storage tank sensor SF1, has reached the adjusted Disinfection temperature, provided disinfection has not been terminated prematurely at the end of the adjusted time period (Time).
- In systems with storage tank charging system, the CO4 -> F24 -1 setting can be used to activate the sensor RUF2 instead of SF1 or SF2 to switch off the thermal disinfection.

The 'Duration' determines how long the disinfection temperature must be maintained within the adjusted time period to rate the process successful. If the Duration is set to a value other than 0, no intermediate heating operation takes place during thermal disinfection.

When the 'Disinfection temperature' has not been reached before the end of the thermal disinfection cycle, it is indicated correspondingly on the display. This error message can also be generated prematurely if the remaining time until the disinfection temperature is reached is shorter than the adjusted 'Duration'. The indication is automatically reset when the disinfection temperature is properly reached during the following thermal disinfection cycle.

Thermal disinfection for preventing legionella infection causes:

- Excessively high return flow temperatures during the disinfection cycle (return flow temperature limitation suspended)
- Excessively high DHW temperatures after thermal disinfection has been concluded
- Possibly lime scale, which can have a negative effect on heat exchanger performance.

i Note

This function is not available when a storage tank thermostat is used.

The return flow temperature limitation in the primary control circuit is deactivated also while thermal disinfection is active in a secondary controller in controllers linked with each other over a device bus.

i Note

The forced operation of the circulation pump (DHW) starts while thermal disinfection is active.

| Functions | Default | Configuration |
|--|---|--|
| Storage tank sensor SF1 | 1 | CO4 -> F01 - 1 |
| Thermal disinfection | 0 Wednesday 00:00 04:00 70.0 °C 10.0 °C 0 min ON | CO4 -> F14 - 1 Monday, Tuesday, ..., daily Start: adjustable as required in steps of 15 minutes End: adjustable as required in steps of 15 minutes Disinfection temperature: 60.0 to 90.0 °C Set point boost: 0.0 to 50.0 °C ¹⁾ Duration: 0 to 255 min Active when BI = ON, OFF (start of disinfection with terminal BI17) ²⁾ |
| Bottom sensor for thermal disinfection | 0 | CO4 -> F24 - 1: only when CO4 -> F14 - 1 Sensor RüF2 as switch-off sensor active |
| ¹⁾ Systems Anl 1.9, 3.9, 5.9, 11.0, 11.3, 11.5, 11.9, 12.0, 12.9, 13.0, 13.9, 17.x, 18.x, 21.0 and 21.9 only ²⁾ BI17 only functions when the time is set to 00:00 - 00:00 h | | |

16.4 System-wide functions

16.4.1 Automatic summer/standard time switchover

The time is automatically changed on the last Sunday in March at 2.00 h and on the last Sunday in October at 3.00 h.

| Functions | Default | Configuration |
|-------------|---------|----------------|
| Summer time | 1 | CO5 -> F08 - 1 |

i Note

The automatic summer/standard time switchover can also be programmed in the Time/date menu (see the 'Operation' section).

16.4.2 Frost protection

Frost protection measures are taken when the outdoor temperature falls below 'Limit'. The switching differential to cancel the frost protection measures is always 1 °C.

Restricted frost protection: frost protection measures are taken only when all heating circuits in the system are in stand-by mode. The circulation pumps are automatically switched on and their flow temperature set points are adjusted to 10 °C. The circulation pump in the DHW circuit is automatically switched on only when the stand-by mode has been adjusted at the rotary switch in all heating circuits. Nevertheless, the storage tank is always recharged to 10 °C if the storage tank temperature falls below 5 °C.

Frost protection with highest priority: the heating circuit circulation pumps are always switched on automatically. The flow temperature set points of all heating circuits currently in stand-by mode are set to +10 °C. In the DHW circuit, the circulation pump is always activated. If the storage tank temperature falls below +5 °C, the storage tank is recharged to +10 °C.

| Functions | Default | Configuration |
|------------------|---------|---|
| Frost protection | | CO5 -> F09 - 0: Restricted frost protection |
| | | CO5 -> F09 - 1: Highest priority for frost protection |
| | 3.0 °C | Limit: -15.0 to 3.0 °C |

Note

Frost protection operation of a pump, a heating circuit or the DHW circuit is only active when the ❄️ frost protection icon is displayed.

NOTICE

Possible damage caused by frost.

In stand-by mode (⊖), the flow temperature set points of all heating circuits are set to +10 °C when the flow temperature falls below +5 °C. Control is deactivated again five minutes after the flow temperature reaches +10 °C. Frost protection monitoring does not take place when the cooling control is configured.

16.4.3 Forced pump operation

When the heating circuit pumps have not been activated for 24 hours, forced operation of the pumps is started between 12.02 h and 12.03 h. This is done to avoid that the pumps get stuck when they are not operated for long periods of time. In the DHW circuit, the circulation pump is operated between 12.04 h and 12.05 h, the other pumps between 12.05 h and 12.06 h.

16.4.4 Return flow temperature limitation

The temperature difference between the flow and return flow in a network indicates how well the energy is used: the greater the difference, the higher the efficiency. A return flow sensor is sufficient to evaluate the temperature difference when the flow temperatures are pre-defined. The return flow temperature can be limited either to a value depending on the outdoor temperature (variable) or to a fixed set point. When the temperature measured at return flow sensor RÜF exceeds the current return flow temperature limit, the set point of the flow temperature (flow temperature of the heating system, charging temperature) is reduced. This causes the primary flow rate to be reduced and the return flow temperature to drop. In systems Anl 2.x, 3.1 to 3.4, 4.1 to 4.4, 5.1, 5.2, 6.1, 7.x, 8.x and 9.x, the 'Max. return flow temperature' parameter (PA4 level) is used for limitation in the primary circuit during DHW heating if it is greater than the parameter valid for the primary circuit. The 'KP (limiting factor)' determines how strongly the heating controller responds when the limit values are exceeded in either direction (PI algorithm).

If just the proportional component is to be implemented, set CO5 -> F16 - 1. This allows the integral-action component in the return flow temperature limitation algorithm of all control

circuits of the heating controller to be deactivated. The set point reading (flow temperature of the heating, charging temperature) blinks to indicate that a return flow limitation is active in the control circuit concerned.

i Note

When outdoor-temperature-compensated control with gradient characteristic is used, the return flow temperature is limited to a fixed value by equating the 'Base point for return flow temperature' and 'Max. return flow temperature' (PA1, 2, 3, 11, 12, 13 -> P13 and P14) parameters.

| Functions | Default | Configuration |
|---|---------|-------------------------------------|
| Return flow sensor RüF1/2/3 | | CO1, 2, 3, 4, 11, 12, 13 -> F03 - 1 |
| | 1.0 | KP (limiting factor): 0.1 to 10.0 |
| Return flow temperature limitation with P 0 algorithm ¹⁾ | 0 | CO5 -> F16 |
| ¹⁾ If the heating controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked. | | |

| Parameters | Default | Parameters: value range |
|---|---------|--|
| Return flow gradient | 1.2 | PA1, 2, 3, 11, 12, 13 -> P11: 0.2 to 3.2 |
| Return flow level | 0.0 °C | PA1, 2, 3, 11, 12, 13 -> P12: -30.0 to 30.0 °C |
| Base point for return flow temperature: | 65.0 °C | PA1, 2, 3, 11, 12, 13 -> P13: 5.0 to 90.0 °C |
| Max. return flow temperature | 65.0 °C | PA1, 2, 3, 11, 12, 13 -> P14: 5.0 to 90.0 °C |
| Max. return flow temperature | 65.0 °C | PA4 -> P07: 5.0 to 90.0 °C |

or:

| Parameters | Default | Parameters: value range |
|--|---------|--|
| Return flow temperature, points 1 to 4 | 65.0 °C | PA1, 2, 3, 11, 12, 13 -> P05: 5.0 to 90.0 °C |

i Note

To ensure that the preset return flow temperature limit can be met, make sure that the heating characteristic is not adjusted to ascend too steeply, the speed of the circulation pumps is not set too high and the heating systems have been balanced.

16.4.5 Condensate accumulation control

Activate the **damping** function to start up condensate accumulation plants, in particular to avoid problematic excess temperatures. The heating controller response to set point deviations which cause the primary valve to open is attenuated. The heating controller response to set point deviations which cause the control valve to close remains unaffected.

i Note

The condensate accumulation control function can only be activated when the control circuit concerned is controlled using a PI algorithm (three-step control).

| Functions | Default | Configuration |
|--------------|-------------|--|
| Control mode | 1 | CO1, 2, 3, 4, 11, 12, 13 -> F12 - 1 |
| Damping | 0 3.0 °C | CO1, 2, 3, 4, 11, 12, 13 -> F13 - 1 Max. system deviation: 3.0 to 10.0 °C |

16.4.6 Three-step control

The flow temperature can be controlled using a PI algorithm. The valve reacts to pulses that the heating controller sends when a system deviation occurs. The length of the first pulse, in particular, depends on the extent of the system deviation and the selected 'KP (gain)' (the pulse length increases as KP increases). The pulse and pause lengths change continuously until the system deviation has been eliminated. The pause length between the single pulses is greatly influenced by the 'Tn (reset time)' (the pause length increases as TN increases). The 'TY (valve transit time)' specifies the time required by the valve to travel through the range of 0 to 100 %.

| Functions | Default | Configuration |
|--------------|---------|--|
| Control mode | 1 | CO1, 2, 3, 4, 11, 12, 13 -> F12 - 1 |
| | 2.0 | KP (gain): 0.1 to 50.0 |
| | 120 s | Tn (reset time): 1 to 999 s |
| | 0 s | TV (derivative-action time): do not change the value. |
| | 35 s | TY (valve transit time): 15, 20, 25, ... , 240 s |

16.4.7 On/off control

The flow temperature can be controlled, for example by activating and deactivating a boiler. The heating controller switches on the boiler when the flow temperature falls below the set point by $T = 0.5 \times \text{'Hysteresis'}$. When the set point is exceeded by $T = 0.5 \times \text{'Hysteresis'}$, the boiler is switched off again. The greater the value you choose for 'Hysteresis', the less frequent switching on and off will be. By setting the 'Minimum ON time', an activated boiler remains switched on during this period regardless of the flow temperature fluctuations. Similarly, a deactivated boiler will remain switched off regardless of the flow temperature fluctuations if the 'Min. OFF time' has been specified.

| Functions | Default | Configuration |
|--------------|---------|-------------------------------------|
| Control mode | 1 | CO1, 2, 3, 4, 11, 12, 13 -> F12 - 0 |
| | 5.0 °C | Hysteresis: 1.0 to 30.0 °C |
| | 2 min | Min. ON time: 0 to 10 min |
| | 2 min | Min. OFF time: 0 to 10 min |

16.4.8 Continuous control

The flow temperature can be controlled using a PID algorithm. The valve receives an analog 0 to 10 V signal from the heating controller. When a system deviation occurs, 'KP (gain)' immediately causes the 0 to 10 V signal to change (the greater the KP, the greater the change). The integral component becomes effective with time: 'Tn (reset time)' represents the time which elapses until the integral component has changed the output signal to the same extent as the immediate change performed by the proportional component (the greater Tn is, the slower the rate of change will be). Due to the derivative component, any change of the system deviation is incorporated into the output signal with a certain gain (the greater TV is, the stronger the change will be).

| Functions | Default | Configuration |
|--------------|---------|--|
| Control mode | 1 | CO1, 2, 3, 11, 12, 13 -> F12 - 1 |
| | 2.0 | KP (gain): 0.1 to 50.0 |
| | 120 s | Tn (reset time): 1 to 999 s |
| | 0 s | TV (derivative-action time): 0 to 999 s |
| | 35 s | TY (valve transit time): 15, 20, 25, ... , 240 s |

16.4.9 Releasing a control circuit/heating controller with binary input

The release of an individual control circuit or the heating controller with the binary input only becomes effective when the respective control circuit is in automatic mode (☺ icon). The released control circuit always works in automatic mode; the deactivated control circuit behaves as if it were transferred to stand-by mode. It remains active, however, in any case for processing an external demand. The control circuit can be released by the binary input when the binary input is either a make contact ('Active when BI' = OFF) or a break contact ('Active when BI' = ON).

i Note

- In systems with downstream heating circuit without a valve (system Anl 2.x, 4.x), BI1 only influences the operation of this heating circuit when **Release control circuit** is configured, while the operation of the entire heating controller (including the control circuits of the connected TROVIS I/O expansion modules; excluding the processing of external demand) is influenced when **Release controller** is configured.
- In system Anl 3.0, BI1 influences the operation of the entire heating controller (except for processing an external demand) when **'Release control circuit'** is configured.
- In buffer tank systems Anl 15.x and 16.x, BI15 influences only the operation of the buffer tank charging circuit when **Release control circuit** is configured.

| Functions | Default | Configuration |
|--------------------|---------|--|
| Enable | 0 | CO1, 2, 3 -> F14 - 1 ¹⁾ |
| Release controller | 0 | CO5 -> F15 - 1 ¹⁾ |
| | ON | ¹⁾ Active when BI = ON, OFF |

16.4.10 Speed control of the charging pump

This function allows the delivery rate of the charging pump in systems with buffer tank (CO1 -> F21 - 1) and in systems with DHW storage tank (CO4 -> F21 - 1) to be varied based on the temperature. When this function is activated, the input SF2 is automatically activated. In combination with CO1 -> F06 - 0 or CO4 -> F02 - 0, this input is only used for speed control and not to stop the storage tank charging. If CO1 -> F26 - 1 or CO4 -> F26 - 1 is also configured, another sensor can be determined for speed control in these function blocks. 'RüF2' is set by default as the function block parameter. Sensors in the selection list that are already assigned to a function and would consequently be used twice as a result are

marked by an exclamation mark in front of the sensor designation. The sensor assigned in F26 - 1 is designated as 'SLP sensor' in the operating level.

The speed signal is issued at output AA1. The output AA2, AA3 or AA4 can also be assigned instead. A PWM signal or a 0 to 10 V signal can be configured that can also be reversed, if required.

All storage tank charging actions start with the minimum delivery rate of the charging pumps. As soon as the charging temperature is nearly reached, the delivery rate of the charging pump is increased and the valve controls the flow rate. If the charging temperature drops 5 °C below its associated set point, the delivery rate is reduced again. At the latest when the temperature at the sensor for speed control has reached the 'Start' value to reduce the delivery rate, the linear reduction of the delivery rate based on the temperature at the sensor for speed control starts. If the temperature at the sensor for speed control reaches the 'Stop' value to reduce the delivery rate, the charging pump runs again at the minimum delivery rate. Following the lag time, the charging pump is finally deactivated when the storage is fully charged.

| Functions | Default | Configuration |
|------------------------------------|---------|--|
| Speed control of the charging pump | 0 | CO1 -> F21 - 1 or CO4 -> F21 - 1 |
| | 40.0 °C | Start speed reduction, limit: 5.0 to 90.0 °C |
| | 50.0 °C | Stop speed reduction, limit: 5.0 to 90.0 °C |
| | 20 % | Minimum speed: 0 to 50 % |
| SLP temperature sensor | 0 | CO1 -> F26 - 1 or CO4 -> F26 - 1 |
| | RüF2 | Sensor: AF1 to SF3 |
| AA1, AA2, AA3, AA4 reverse | 0 | CO5 -> F25, F26, F27, F28 - 1 |
| | 0 % | Zero: 0 to 50 % |
| AA1, AA2, AA3, AA4 PWM | 0 | CO5 -> F34, F35, F36, F37 - 1 Function: SLP speed |

16.4.11 Processing an external demand

The heating controller can process binary or analog requests for an externally required signal by a more complex secondary system. A binary request can only be processed when the input SF3 or FG3 is not assigned. Processing of external demand by device bus can also be configured.

i Note

Overheating may occur in the heating circuits of the primary controller without control valve.

Annex A (configuration instructions)

Excessive charging temperatures in DHW circuits without control valve controlled by the primary controller are excluded when the default settings of the controller are used: while storage tank charging is active, no flow temperature higher than the charging temperature is used by the primary controller. If the **Priority for external demand** function is activated, the external demand is also processed during storage tank charging. The heating circuits can be configured in such a way that they only process external demand. The possible settings for each heating circuit do not apply with this configuration as only the external demand is processed with associated UP as feeder pump.

| Functions | Default | Configuration |
|------------------------------|---------|----------------|
| Priority for external demand | 0 | CO4 -> F16 - 1 |
| Demand only | 0 | CO1 -> F24 - 1 |
| | 0 | CO2 -> F24 - 1 |
| | 0 | CO3 -> F24 - 1 |

Binary demand processing

Regardless of the operating mode set for control circuit, except for manual mode, the controller regulates the flow temperature in the heating circuit concerned when either the binary input (terminals 17/18) is a make contact ('Active when BI' = OFF) or a break contact ('Active when BI' = ON) in control circuit HC1 to at least the adjusted flow temperature adjusted in PA1 -> P10 ('Minimum flow temperature set point HC for binary demand processing').

| Functions | Default | Configuration |
|------------------------------|---------|--------------------------|
| Demand processing, 0 to 10 V | 0 | CO1, 2, 3 -> F16 - 0 |
| Binary demand processing | 0 | CO1 -> F17 - 1 |
| | ON | Active when BI = ON, OFF |

| Parameters | Default | Parameters: value range |
|--|---------|-----------------------------|
| Minimum flow temperature set point HC for binary demand processing | 40.0 °C | PA1 -> P10: 5.0 to 150.0 °C |

Demand processing, 0 to 10 V

Regardless of the operating mode set for the control circuit affected (except for pre-control loop in stand-by and manual mode), the controller regulates the flow temperature at least to the temperature corresponding with the 0 to 10 V signal at the assigned 0 to 10 V input.

Several 0 to 10 V inputs can be assigned to a control circuit. Alternatively, one 0 to 10 V input can have an effect on more than one control circuit. The function block parameters 'Lower transmission range' and 'Upper transmission range' can be set for each 0 to 10 V input separately in CO5 -> F31 - 0 to CO5 -> F33 - 0 to define the 0 to 10 V signal to represent

the corresponding temperature demand at the various 0 to 10 V inputs. If an input is to become active at a certain voltage signal level, the zero shift must also be activated in the corresponding function block and the percent of zero determined. For example, a demand for a flow temperature of 40 to 90 °C to be processed at AE1 using a 2 to 10 V signal requires the following settings: CO5 -> F31 - 1, 'Zero' = 20 %, 'Lower transmission range' = 40 °C and 'Upper transmission range' = 90 °C.

When the processing of external demand using a 0 to 10 V signal is activated, the demanded flow temperatures over the individual analog inputs are displayed after confirming the system scheme.

| Functions | Default | Configuration |
|---------------------------------------|---------|--|
| Demand processing, 0 to 10 V | 0 | CO1 -> F16 - 1 |
| | 3 | Analog input 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 |
| | 0 | CO2 -> F16 - 1 |
| | 2 | Analog input 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 |
| | 0 | CO3 -> F16 - 1 |
| Binary demand processing | 1 | Analog input 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 |
| | 0 | CO1 -> F17 - 0 |
| AI1 Zero shift | 0 | CO5 -> F31 - 1 |
| | 5 % | Zero: 5 to 20 % |
| | 0 °C | Lower transmission range: 0 to 150 °C |
| | 120 °C | Upper transmission range: 0 to 150 °C |
| AI2 Zero shift | 0 | CO5 -> F32 - 1 |
| | 5 % | Zero: 5 to 20 % |
| | 0 °C | Lower transmission range: 0 to 150 °C |
| | 120 °C | Upper transmission range: 0 to 150 °C |
| AI3 Zero shift | 0 | CO5 -> F33 - 1 |
| | 5 % | Zero: 5 to 20 % |
| | 0 °C | Lower transmission range: 0 to 150 °C |
| | 120 °C | Upper transmission range: 0 to 150 °C |
| Parameters | Default | Parameters: value range |
| Set point boost (pre-control circuit) | 5.0 °C | PA1, 2 or 3 -> P15: 0.0 to 50.0 °C |

16.4.12 External demand using a 0 to 10 V signal

The heating controller can request a demand for the maximum flow set point (with boost, if need be) by issuing an analog 0 to 10 V signal for external demand. The output AA1 is used in this case. The output AA2, AA3 or AA4 can also be assigned instead.

Annex A (configuration instructions)

Analog, binary signals or requests processed over the device bus are integrated into the analog request for an external demand.

| Functions | Default | Configuration |
|------------------------|-----------------------------------|---|
| External demand | 0 0.0 °C 120.0 °C 0.0 °C | CO1 -> F18 - 1 Lower transmission range: 0.0 to 150.0 °C Upper transmission range: 0.0 to 150.0 °C Boost: 0.0 to 30.0 °C |
| AA1, AA2, AA3, AA4 PWM | 0 | CO5 -> F34, F35, F36, F37 - 0 Function: external demand |

16.4.13 Capacity limitation in RK1

The capacity can be limited based on a pulse signal to 800 pulse/h at terminals 17/18. This only applies to systems which do not use input SF3/FG3. Three different operating situations exist:

- A system with simultaneous room and DHW heating requires maximum energy.
- A system with a fully charged storage tank that is only used for room heating requires less energy.
- A system that suspends room heating during DHW heating requires less energy.

As a result, three different maximum limit values can be adjusted:

- Max. limit value to determine the absolute upper limit
- 'Max. limit (heating)' to operate room heating only
- Max. limit (DHW) to operate DHW heating only

In all systems without DHW heating or without heating circuit, only the Max. limit value for the capacity can be specified. If the 'Max. limit' or 'Max. limit (heating)' parameter is set to 'OT', a four-point characteristic configured in CO1 -> F11 - 1 allows the input of four capacity limits for outdoor-temperature-compensated capacity limitation in addition to the outdoor, flow and return flow temperature values.

All limits are adjusted as pulses per hour (pulses/h). As the reading for the current pulse rate P in pulse/h (→ extended operating level, key number 1999) is calculated based on the time interval between incoming pulses, the heating controller naturally cannot react immediately to every sudden capacity change in the system.

The flow set point of the control circuit RK1 is reduced when the pulse rate reaches the currently valid maximum limit. The Limiting factor determines how strongly the controller responds.

Example to determine the limit:

If a capacity of 30 kW is to be limited, the following limit must be set in a heat meter, which issues one pulse per kilowatt hour:

$$P = \frac{30 \text{ kW}}{1 \text{ kWh/pulse}} = 30 \text{ pulses/h}$$

i Note

If the heating controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

| Functions | Default | Configuration |
|--|---|---|
| Capacity limitation in RK1 ¹⁾ | 0 15 pulses/h 15 pulses/h 15 pulses/h 1.0 | CO5 -> F10 - 1 Maximum limit: OT to 800 m ³ /h Max. limit (heating) ²⁾ : OT to 800 pulses/h Max. limit (DHW) ²⁾ : 1 to 800 pulses/h Limiting factor: 0.1 to 10.0 |
| Capacity limitation in RK1 by meter bus | 0 | CO6 -> F12 - 0 |

¹⁾ Not in system Anl 1.9
²⁾ Not in systems Anl 1.0, 1.5-1.8, 3.0, 3.5, 3.9, 4.0, 5.9, 7.x, 10.x, 11.x, 12.x, 13.x, 14.x, 15.x, 16.x, 17.x, 18.x, 21.x and 25.x

16.4.14 Creep feed rate limitation with a binary input

It is possible to report to the heating controller when the creep feed rate has fallen below a certain level by using a limit switch of the primary valve connected at the input BI13 or to RÜF1. Either the open ('Active when BI = Off) or closed binary input BI13 ('Active when BI = ON) can be configured to indicate that the creep feed rate has fallen below a certain level. Only the closed binary input at RÜF1 can be processed. Shortly after the alert, the heating controller closes the valve RK1. As soon as the flow temperature falls below the set point by more than 5 °C after the valve has been closed, control operation is started again.

| Functions | Default | Configuration |
|--|-------------------|---|
| Creep feed rate limitation ¹⁾ | 0 Binary ON | CO5 -> F12 - 1 Switching mode: Binary (terminals 13/19), analog (RüF1) Active when BI = ON, OFF |

¹⁾ Not for system Anl 1.9

16.4.15 Device bus

The device bus allows the connection of up to 32 participants (Series 55xx Controllers). Terminal 29/30 is used in the TROVIS 5578-E Heating and District Heating Controller for this purpose. No attention must be paid to the polarity of the device bus wiring.

A resistor with 200 Ω (± 10 %, 0.25 W) must be installed as a bus termination at the last bus device.

Activate the device bus and specify the device bus address for each device. Note that the device bus address 1 is to be set for just one heating controller (ideally the first bus device in the system) and that all device bus addresses must be unique. The heating controller with device bus address 1 implements the required bus bias voltage for the system. Once the controllers have been connected and set accordingly, additional functions can be configured. These partly application-specific functions include:

- Requesting and processing an external demand (see section 16.4.15.1)
- Sending and receiving outdoor temperatures (see section 16.4.15.2)
- Synchronizing the clock (see section 16.4.15.3)
- Priority over all controllers (see section 16.4.15.4)
- Display error messages issued by the device bus (see section 16.4.15.5)
- Activating TROVIS I/O expansion modules (see section 16.4.16)

16.4.15.1 Requesting and processing an external demand

In general, the heating controller which controls the primary valve or boiler (= primary controller) in a system of linked controllers will process the demand of all subsequent controllers (= secondary controllers). As a result, the primary controller must be configured to receive this demand. Usually, the secondary controllers are configured such that they send their maximum flow set point to the primary controller.

In special cases, however, it might happen that only the set point of one control circuit is to be sent. The appropriate function blocks to do so are also available for selection. After the selected function blocks have been activated, you must specify a register number. The follow-

ing applies: in a system of linked heating controllers which are hydraulically supplied by a primary controller, all heating controllers (primary and secondary controllers) must have the same register number setting for the 'Demand register'.

A heating controller which is configured to receive a demand in register no. 5 will not process a demand sent to register no. 6. The primary controller compares the received requested demands and its own requested demand and supplies the system with the required flow temperature (if necessary, increased by the 'Set point boost (pre-control circuit)').

i Note

Overheating may occur in the heating circuits of the primary controller without control valve.

The heating circuits can be configured in such a way that they only process external demand. The possible settings for each heating circuit do not apply with this configuration as only the external demand is processed with associated UP as feeder pump.

Primary controller:

| Functions | Default | Configuration |
|---------------------------------------|---------|---------------------------------------|
| Device bus | 0 | CO7 -> F01 - 1, device bus address |
| Receive external demand in RK1 | 0 | CO7 -> F15 - 1 ¹⁾ |
| Receive external demand in RK2 | 0 | CO7 -> F17 - 1 ¹⁾ |
| Receive external demand in RK3 | 0 | CO7 -> F18 - 1 ¹⁾ |
| Demand only | 0 | CO1 -> F24 - 1 |
| | 0 | CO2 -> F24 - 1 |
| | 0 | CO3 -> F24 - 1 |
| | 5 | ¹⁾ Register number/5 to 64 |
| Parameters | Default | Parameters: value range |
| Set point boost (pre-control circuit) | 5.0 °C | PA1, 2, 3 -> P15: 0.0 to 50.0 °C |

Secondary controller:

| Functions | Default | Configuration |
|------------------|---------|---------------------------------------|
| Device bus | 0 | CO7 -> F01 - 1, device bus address |
| Send demand RK1 | 0 | CO7 -> F10 - 1 ¹⁾ |
| Send demand RK2 | 0 | CO7 -> F11 - 1 ¹⁾ |
| Send demand RK3 | 0 | CO7 -> F12 - 1 ¹⁾ |
| Send demand DHW | 0 | CO7 -> F13 - 1 ¹⁾ |
| Send max. demand | 0 | CO7 -> F14 - 1 ¹⁾ |
| | 5 | ¹⁾ Register number/5 to 64 |

i Note

The register number specifies the location where the flow set points are saved in the primary controller. As a result, the register number set in the secondary controller in CO7 -> F10 to F14 must be the same as the register number set in CO7 -> F15 in the primary controller.

Excessive charging temperatures in DHW circuits without control valve controlled by the primary controller are excluded when the default settings of the controller are used: while storage tank charging is active, no flow temperature higher than the charging temperature is used by the primary controller. Nevertheless, if the **Priority for external demand** function is activated, the external demand is also processed during storage tank charging.

| Functions | Default | Configuration |
|------------------------------|---------|----------------|
| Priority for external demand | 0 | CO4 -> F16 - 1 |

16.4.15.2 Sending and receiving outdoor temperatures

Heating controllers equipped with one (two) outdoor sensor(s) can be configured to supply other heating controllers with the measured outdoor temperature(s) over the device bus. This enables outdoor-temperature-compensated control even in systems which do not have their own outdoor sensor.

| Functions | Default | Configuration |
|-------------|---------|--------------------------------------|
| Device bus | 0 | CO7 -> F01 - 1, device bus address |
| Send AF1 | 0 | CO7 -> F06 - 1 ¹⁾ |
| Receive AF1 | 0 | CO7 -> F07 - 1 ¹⁾ |
| Send AF2 | 0 | CO7 -> F08 - 1 ²⁾ |
| Receive AF2 | 0 | CO7 -> F09 - 1 ²⁾ |
| | 1 | ¹⁾ Register number/1 to 4 |
| | 2 | ²⁾ Register number/1 to 4 |

i Note

The register number for the outdoor temperature AF1 or AF2 must be the same for the sending and the receiving controller.

16.4.15.3 Synchronizing the clock

One heating controller in a system of linked heating controllers should perform the 'Clock synchronization' function. This heating controller sends its system time once every 24 hours to all other controllers over the device bus.

Regardless of this function, the system time of all controllers is adapted immediately when the time setting of one controller is changed.

| Functions | Default | Configuration |
|-----------------------|---------|------------------------------------|
| Device bus | 0 | CO7 -> F01 - 1, device bus address |
| Clock synchronization | 0 | CO7 -> F02 - 1 |

16.4.15.4 Priority over all controllers and return flow limitation

When heating controllers are linked with each other over a device bus, the heating circuits of other controllers can be shut down while DHW heating is active. It is also possible to configure the return flow temperature limitation in the primary circuit so that it is raised to the value adjusted for the maximum return flow temperature (or for point 1 of the return flow temperature in a four-point characteristic). Heating controllers configured to trigger this function must generate the 'DHW heating active' message. 'Receive release RK_' must be configured for the heating circuits concerned in the controllers whose heating circuit(s) are to be shut down when this DHW heating is active. The same register number must be specified if only one DHW circuit is to affect one or more heating circuits. If several DHW circuits exist in the sys-

Annex A (configuration instructions)

tem, it is possible to select the heating circuits that are only to react to one or other active DHW heating by assigning different register numbers. If a secondary heating circuit with valve is to be shut down, the valve of this circuit is closed while its circulation pump remains activated.

If a secondary heating circuit without valve is to shut down, just its circulation pump and not the primary circuit (RK1) is shut down, for example in systems An1 2.x by configuring 'Receive release RK1'.

| Functions | Default | Configuration |
|-------------------------------|---------|---------------------------------------|
| Device bus | 0 | CO7 -> F01 - 1, device bus address |
| Send 'DHW heating active' | 0 | CO7 -> F20 - 1 ¹⁾ |
| Raise return flow temperature | 0 | CO7 -> F19 - 1 ¹⁾ |
| Receive release RK1 | 0 | CO7 -> F21 - 1 ¹⁾ |
| Receive release RK2 | 0 | CO7 -> F22 - 1 ¹⁾ |
| Receive release RK3 | 0 | CO7 -> F23 - 1 ¹⁾ |
| | 32 | ¹⁾ Register number/5 to 64 |

16.4.15.5 Display error messages issued by the device bus

The setting CO7 -> F16 - 1 causes the heating controller to react to the error messages from the device bus by generating the 'External err' error message as long as the faults of the other device bus participants exist.

| Functions | Default | Configuration |
|----------------|---------|----------------|
| Receive errors | 0 | CO7 -> F16 - 1 |

16.4.16 Activating TROVIS I/O expansion modules

The function blocks F31 to F33 allows one additional heating circuit to be added to a system. One TROVIS I/O expansion module is required per heating circuit. The CO7 -> F31 - 1 setting activates the expansion module for heating circuit 11, CO7 -> F32 - 1 activates the expansion module for heating circuit 12 and CO7 -> F33 activates the expansion module for heating circuit 13 as well as all the associated levels and settings in the controller. Depending on which kind of communication is used, the additionally configured heating circuit works either in the primary circuit, i.e. parallel to the control circuit 1 of the configured main system, or linked to the control circuit 1 (HC1) of the configured main system. As a result, two new plant schemes can be configured per TROVIS I/O module for each main system. Heating circuits connected to HC1 automatically send their flow temperature demand to HC1.

| Functions | Default | Configuration |
|-----------|---------|---|
| Ext-HC11 | 0 | CO7 -> F31 - 1: |
| | 11 | TROVIS I/O for heating circuit 11 active |
| | To HC1 | Device bus address: 11 to 19 Connected/primary circuit, to HC1 |
| Ext-HC12 | 0 | CO7 -> F32 - 1: |
| | 12 | TROVIS I/O for heating circuit 12 active |
| | To HC1 | Device bus address: 11 to 19 Connected/primary circuit, to HC1 |
| Ext-HC13 | 0 | CO7 -> F33 - 1: |
| | 13 | TROVIS I/O for heating circuit 13 active |
| | To HC1 | Device bus address: 11 to 19 Connected/primary circuit, to HC1 |

i Note

The default setting for the device bus address (33) must be changed in CO7 -> F01 - 1 when extension modules are used (see section 16.4.15).

16.4.17 Connecting potentiometers for valve position input

The FG1 to FG3 inputs can be used to connect potentiometers, for example to input valve positions when a resistance room sensor is not configured in the control circuit concerned. The use of TROVIS 5570 Room Panel is possible. The measured values (in the measuring ranges from 0 to 2000 Ω) are displayed as measured value 13 (FG1), 14 (FG2) and 15 (FG3). They are also available as Modbus data points.

| Functions | Default | Configuration |
|-----------------------|---------|-----------------------------------|
| Room sensor RF1, 2, 3 | | CO1, 2, 3 -> F01 - 0 |
| | | Exceptions: |
| | | CO1 -> F01 - 1 and CO7 -> F03 - 1 |
| | | CO2 -> F01 - 1 and CO7 -> F04 - 1 |
| | 0 | CO3 -> F01 - 1 and CO7 -> F05 - 1 |

16.4.18 Locking manual level

To protect the heating system, this function can be used to lock the manual level. When this function has been activated, automatic mode is started when the rotary switch is set to in-automatic mode.

| Functions | Default | Configuration |
|-------------------|---------|----------------|
| Lock manual level | 0 | CO5 -> F21 - 1 |

16.4.19 Locking the rotary switch

When this function has been activated, the heating controller remains in automatic mode regardless of the rotary switch position. The rotary switch can no longer be used to adjust the controller settings. It is still possible to enter the key number.

| Functions | Default | Configuration |
|--------------------|---------|----------------|
| Lock rotary switch | 0 | CO5 -> F22 - 1 |

16.4.20 Feeder pump operation

In system Anl 3.0, 5.0, 7.x, 9.1, 9.2, 12.x, 15.1, 16.1, 16.5, 16.7 and 16.8, the feeder pump UP1 only starts to operate in the default setting when a flow temperature demand of a secondary controller exists. If CO5 -> F14 - 1 is configured, this is also the case when the controller's own secondary circuit requires heat.

| Functions | Default | Configuration |
|---------------|---------|----------------|
| Operation UP1 | 0 | CO5 -> F14 - 1 |

16.4.21 Speed control of the circulation pump (DHW)

The delivery rate of the circulation pump (DHW) can be controlled based on the circulation return flow temperature. With the setting CO4 -> F25 - 1, the output AA3 is assigned for issuing the speed signal. The output AA1, AA2 or AA4 can also be assigned instead. A PWM signal or a 0 to 10 V signal can be configured that can also be reversed, if required. The input RÜF4/AF2 is used to measure the circulation return flow temperature.

| Functions | Default | Configuration |
|--|---------|----------------|
| Speed control of circulation pump (DHW) | 0 | CO4 -> F25 - 1 |
| Return flow temperature of circulation pump (DHW) Target | 55 °C | 5 to 90 °C |
| KP (gain) | 1.0 | 0.1 to 50 |

| Functions | Default | Configuration |
|----------------------------|---------|---|
| Tn (reset time) | 300 s | 30 to 2000 s |
| Minimum speed | 10 % | 5 to 50 % |
| AA1, AA2, AA3, AA4 reverse | 0 | CO5 -> F25, F26, F27, F28 - 1 Zero: 0 to 50 % |
| AA1, AA2, AA3, AA4 PWM | 0 | CO5 -> F34, F35, F36, F37 - 1 Function: ZP speed |

16.4.22 External demand for heat due to insufficient heat supply

An external heat source can be demanded using a 0 to 10 V output. The function block for a request for external demand CO1 -> F18 - 1 is automatically set. The function block parameters allow the transmission range to be determined. When a system deviation in RK1 greater than 10 °C lasts longer than 30 minutes, a voltage signal corresponding to the actual demand is issued. At the same time, the RK1 valve is forced to close. After 30 minutes, the external demand for heat is canceled and the control signal output in RK1 is enabled again.

| Functions | Default | Configuration |
|--------------------------|-----------------------------------|---|
| Demand for external heat | 0 | CO1 -> F20 - 1 |
| External demand | 0 0.0 °C 120.0 °C 0.0 °C | CO1 -> F18 - 1 Lower transmission range: 0.0 to 150.0 °C Upper transmission range: 0.0 to 150.0 °C Boost: 0.0 to 30.0 °C |
| AA1, AA2, AA3, AA4 PWM | 0 | CO5 -> F34, F35, F36, F37 - 0 Function: external demand |

16.5 Communication

The TROVIS 5578-E Heating and District Heating Controller has an Ethernet interface for Modbus-TCP/IP communication and connection to SAM DISTRICT ENERGY using an Internet router. At the same time, it is also possible to use the galvanically isolated RS-485 interface for Modbus RTU communication.

16.5.1 Ethernet interface

The RJ-45 Ethernet port is located on the left side of the controller housing. The Ethernet interfaces is deactivated by default. It becomes automatically active when either Modbus-TCP/IP communication or communication with the SAM DISTRICT ENERGY web application is activated. Dynamic assignment of the IP address (DHCP) is set by default. Additionally, AES encryption is activated for Modbus-TCP/IP communication. Connection to the SAM DISTRICT ENERGY portal is automatically established after the IP address is read when an Internet connection is available. The MAC address of the heating controller is used to register it (specified on the controller housing, starting with 00:E0:99:Fx:xx:xx). For reasons of data security, the heating controller must be registered in the web portal within six hours after the controller has been started. Restarting the heating controller resets this time and allows the controller to be registered after a timeout. The cloud icon at the bottom right of the display (start screen) indicates that connection to SAM DISTRICT ENERGY is established. An exclamation mark appears in the cloud icon if the connection is interrupted. An icon depicting a small bus system appears at the bottom middle of the display (start screen) as soon as any Modbus connection is detected. The number underneath the icon indicates how many Modbus connections exist.

16.5.2 RS-485 interface for Modbus RTU communication.

The galvanically isolated RS-485 interface is configured for Modbus RTU communication by default with the CO6 -> F01 - 1 setting.

It is possible to additionally activate device bus operation (CO7 -> F01 - 1) in TROVIS 5578-1113, however, only when the device bus units and the Modbus master support its intermittent operation. The use of a standard Modbus master connected to the RS-485 interface does not allow simultaneous operation over Modbus RTU and device bus in this controller version. Therefore, we recommend deactivating the Modbus RTU function (CO6 -> F01 - 0) in older controller models to ensure uninterrupted device bus communication.

Sending and receiving activities of the RS-485 interfaces are indicated by an illuminated red/green tip on the rotary switch while the display is not illuminated (controller not being operated).

i Note

CO6 -> F01 - 0 only deactivates the Modbus RTU function and not the Modbus-TCP/IP function.

| Functions | Default | Configuration |
|----------------------------|---------------------|--|
| Modbus RTU | 1 | CO6 -> F01 - 1 |
| 16-bit address | 0 | CO6 -> F02 |
| Monitoring | 0 | CO6 -> F07 |
| Manual IP address | 0 | CO6 -> F25 - 1 |
| | 192.168.55.2 | IP address: 0 to 255 (in blocks) |
| | 255.255.255.0 | Subnet: 0 to 255 (in blocks) |
| | 192.168.55.1 | Gateway: 0 to 255 (in blocks) |
| (only when CO6 -> F26 - 1) | 8.8.8.8 | DNS-Server: 0 to 255 (in blocks) |
| SAM DISTRICT ENERGY | 0 | CO6 -> F26 - 1 |
| Modbus TCP/IP | 0 | CO6 -> F27 - 1 |
| | 502 | Port configurable as required |
| Encryption | After-sales Service | CO6 -> F28 - 1 |
| (only when CO6 -> F27 - 1) | | AES key: freely combinable from the list of letters, number and special characters; max. 49 characters |

| Parameters | Default | Parameters: value range |
|--------------------------------|---------|---|
| Modbus station address (8 bit) | 255 | PA6 -> P01: 1 to 246 with CO6 -> F02 - 1: 1 to 32000 |
| Baud rate | 19200 | PA6 -> P02: 9600, 19200 |

Communication parameter settings

- Modbus station address (8 bit)

This address is used to identify the heating controller in bus mode. In a system, each controller needs to be assigned a unique address.

16.5.3 RS-485 interface for forwarding Modbus-TCP/IP communication

The CO6 -> F31 - 1 setting allows Modbus TCP/IP requests to be forwarded to other Series 5500 Controllers using Modbus RTU communication over RS-485 interface. The multiplex mode with synchronization is activated with the CO7 -> F01 - 1 setting in TROVIS 5578-1113. Modbus and device bus can be transmitted over the same RS-485 bus in this mode. The adjustable refreshing rate allows the cycle time of the device bus to be changed. Select the AUTO setting if the TCP/IP forwarding is activated to several controllers in a network over a common RS-485 bus (only when CO7 -> F01 - 1; essential due to the necessary synchronization even when no device bus communication is required).

| Functions | Default | Configuration |
|------------|---------|-------------------------------|
| Forwarding | 0 | CO6 -> F31 - 1 |
| | 5 s | Refreshing rate: AUTO to 30 s |

16.5.4 Meter bus

The TROVIS 5578-E Heating and District Heating Controller is fitted with an M-Bus interface for up to three M-Bus units. For systems with three control circuits, a flow rate and/or capacity limitation can be configured in every control circuit based on the measured data of the heat meters HM 1 to HM 3.

i Note

Details on the use of the different heat or water meters can be found in the technical documentation TV-SK 4000179038.

16.5.4.1 Activating the meter bus

To successfully transfer data from the heat meter, the heat meter must use a standardized protocol in accordance with EN 1434-3. It is not possible to provide a general list of the exact data that can be accessed. Contact SAMSON to find out exact details concerning certain meter models. All necessary function block parameters to set up the communication with heat meters are available in CO6 -> F10. The meter bus address, model code and reading mode must be specified for the heat meters HM 1 to HM 3. A meter bus address must be unique and correspond with the address set in the heat meter. If the preset meter bus address is unknown, a single heat meter connected to the controller can be assigned the meter bus address 254. The address 255 deactivates the communication with the respective heat meter.

The model to be set for the heat meter can be found in TV-SK 4000179038. In general, the default setting of 1434 can be used for most devices. The meters can be read either automatically every 24 hours (approx.), continuously or when the coils (= Modbus data points) assigned to the heat meters HM1 to HM3 are overwritten with the value 1 over Modbus.

A tariff schedule 'HM' can be set for HM1 with '1434' and 'Cont.' settings which assess the consumption data are assigned to a high tariff or a low tariff.

| Meter | |
|---------------|-------------|
| Z1 (Adr. 154) | Connected |
| Z2 (Adr. 255) | Deactivated |
| Z3 (Adr. 255) | Deactivated |

The additional "meter" page is displayed with connection status for meters 1 to 3 in the "extended operating level" mode when the meter bus is activated. When 'Connected' status is displayed, the following data for each meter can be read by pressing the rotary pushbutton:

| Meter 1 | p.1/2 |
|----------------|-----------------------|
| Flow rate | 0.00 l/h |
| Volume | 2213.0 m ³ |
| Capacity | 0.00 kW |
| Energy | 0.90 MWh |
| Flow | 76.39 °C |

- Flow rate
- Volume
- Capacity
- Energy
- Flow temperature (Flow)

| Meter 1 | p.2/2 |
|----------------|--------------|
| Return flow | 37.48 °C |
| ID no. | 1154 |
| Address | 154 |

- Return flow temperature (Return flow)
- Meter ID
- Meter bus address (Address, sent by meter)

| Functions | Default | Configuration |
|-----------|------------|---|
| Meter bus | 0 | CO6 -> F10 - 1 |
| | 255 | HM 1...3 address: 0 to 255 |
| | 1434 | HM1...3 model: 1434, Multical3, Apator, SLS/WSF |
| | Continuous | HM1...3 mode: 24 h, Continuous, Coil |
| | Tar-A | Tariff: Tar-A, Tar-E (tariff schedule ON, OFF; only for HM1 with '1434' and 'Continuous' settings) Tar-E: the consumption data are assigned to a high tariff or a low tariff depending on the time schedule programmed in the customer level. Three time periods can be entered per day of the week (not vacations or public holidays): 1-7 daily, 1 = Monday, 2 = Tuesday, ..., 7 = Sunday |

16.5.4.2 Flow rate and/or capacity limitation with meter bus

The refreshing rate of the measured variable (flow rate and/or capacity) must be less than five seconds to ensure that the limitation can be performed properly. Note that some makes, particularly battery-operated heat meters, respond with communication pauses when they are read too frequently. Others might run out of energy early.

- A system with simultaneous room and DHW heating requires maximum energy.
- A system with a fully charged storage tank that is only used for room heating requires less energy.
- A system that suspends room heating during DHW heating requires less energy.

As a result, three different maximum limit values for RK1 can be adjusted in all systems with only one control valve and DHW heating on the secondary side:

- Max. limit value to determine the absolute upper limit
- Max. limit value for heating to operate room heating only
- Max. limit value for DHW to operate DHW heating only

If the 'Max. limit' or 'Max. limit (heating)' parameter for HC1 is set to 'OT', a four-point characteristic configured in CO1 -> F11 - 1 allows the input of four flow rate or capacity limits for outdoor-temperature-compensated flow rate or capacity limitation in addition to the outdoor, flow and return flow temperature values.

In all systems with two or three control valves, separate maximum limits can be adjusted for the flow rate and capacity.

Flow limitation

All necessary function block parameters to set up the flow rate limitation are available in CO6 -> F11 or CO6 -> F13 and CO6 -> F15 for the second and third control circuit. One after the other, the system's max. limit or max. limit for heating and the max. limit for DHW for systems with only one primary control valve and secondary DHW heating have to be set. The 'Limiting factor' determines how strongly the heating controller responds when the limit values are exceeded in either direction.

When the flow rate limitation is activated, the respective measuring and limit values are displayed in the extended operating level after confirming the plant scheme.

i Note

If the heating controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

| Functions | Default | Configuration |
|-----------------------------|-----------------------|---|
| Meter bus | 0 | CO6 -> F10 - 1 |
| | 255 | HM 1...3 address: 0 to 255 |
| | 1434 | HM1...3 model: 1434, Multical3, Apator, SLS/WSF |
| | Continuous | HM1...3 mode: 24 h, Continuous, Coil |
| Flow rate limitation in RK1 | 0 | CO6 -> F11 - 1 |
| | 1.5 m ³ /h | Max. limit: OT to 650 m ³ /h |
| | 1.5 m ³ /h | Max. limit (heating): OT to 650 m ³ /h |
| | 1.5 m ³ /h | Max. limit (DHW): 0.01 to 650 m ³ /h |
| | 1.0 | Limiting factor: 0.1 to 10.0 |
| Flow rate limitation in RK2 | 0 | CO6 -> F13 - 1 |
| | 1.5 | Max. limit: 0.01 to 650 m ³ /h |
| | 1.0 | Limiting factor: 0.1 to 10.0 |
| Flow rate limitation in RK3 | 0 | CO6 -> F15 - 1 |
| | 1.5 | Max. limit: 0.01 to 650 m ³ /h |
| | 1.0 | Limiting factor: 0.1 to 10.0 |

Capacity limitation

All necessary function block parameters to set up the capacity limitation are available in CO6 -> F12 or CO6 -> F14 and CO6 -> F16 for the second and third control circuit. One after the other, the system's max. limit or max. limit for heating and the max. limit for DHW for systems with only one primary control valve and secondary DHW heating have to be set. The 'Limiting factor' determines how strongly the heating controller responds when the limit values are exceeded in either direction.

When the capacity limitation is activated, the respective measuring and limit values are displayed in the extended operating level (see the 'Operation' section) after confirming the plant scheme.

i Note

If the heating controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

| Functions | Default | Configuration |
|----------------------------|------------|---|
| Meter bus | 0 | |
| | 255 | CO6 -> F10 - 1 |
| | 1434 | HM 1...3 address: 0 to 255 HM1...3 model: 1434, Multical3, Apator, SLS/WSF |
| | Continuous | HM1...3 mode: 24 h, Continuous, Coil |
| Capacity limitation in RK1 | 0 | CO6 -> F12 - 1 |
| | 1.5 kW | Max. limit: OT to 6500 kW |
| | 1.5 kW | Max. limit (heating): OT to 6500 kW |
| | 1.5 kW | Max. limit (DHW): 0.1 to 6500 kW |
| | 1.0 | Limiting factor: 0.1 to 10.0 |
| Capacity limitation in RK2 | 0 | CO6 -> F14 - 1 |
| | 1.5 kW | Max. limit: 0.1 to 6500 kW |
| | 1.0 | Limiting factor: 0.1 to 10.0 |
| Capacity limitation in RK3 | 0 | CO6 -> F16 - 1 |
| | 1.5 kW | Max. limit: 0.1 to 6500 kW |
| | 1.0 | Limiting factor: 0.1 to 10.0 |

16.5.5 Return flow temperature limitation based on capacity

A capacity limit can be determined for control circuit based on the measured capacity value of the heat meter 1 (HM1). The return flow temperature in control circuit 1 is limited according the settings entered in PA1 as long as the measured capacity value is below the determined capacity limit. When the measured capacity value exceeds the capacity limit, a return flow temperature limit adjustable separately for control circuit 1 takes effect.

| Functions | Default | Configuration |
|---|---------|---|
| RK1 Return flow temperature limitation based on capacity | 0 | CO6 -> F17 - 1: new maximum return flow limit at a capacity higher than the max. limit (only when CO6 -> F10 - 1 and activated HM1) |
| | 1.5 kW | Max. limit: 0.1 to 6500 kW |
| | 55 °C | Max. return flow temperature: 5.0 to 90.0 °C |

16.5.6 Bluetooth® interface

The TROVIS 5578-E Heating and District Heating Controller (serial number 020216 and higher) is fitted with a Bluetooth® interface to allow communication via the TROVIS 55Pro app on smart devices with Android or iOS operating system. The controller firmware 2.54 or higher is required to use the Bluetooth® interface.

Android version 8.0 or higher is required to use the app downloaded from the Google Play Store (see Fig. 16-8).

iOS version 15 or higher is required to use the app downloaded from the Apple Store (see Fig. 16-9).



Fig. 16-8: QR code · Android



Fig. 16-9: QR code · iOS

The TROVIS 55Pro app allows users to arrange all the data points of a controller considered to be important in customized tables on various levels. Data points can also be edited on the dashboard. The Trend-Viewer on the app shows color-coded charts of the operating data saved in the controller over the past 14 days in a minute resolution. The optional data log viewer software tool installed on a computer allows a LGV file to be created for further analysis of the logged data. When the controller configuration is read out, a TROVIS-VIEW file is created on the smart device. Writing the controller configuration causes an existing TRO file to be transferred to the controller.

i Note

A memory module, mini module, data logging and USB Converter 3 at the RJ-45 Ethernet port (at the bottom left of the controller housing, see section 16.5.1) cannot be used.

Establishing communication between the app and controller



Turn the rotary switch to  (operating level).

- * Press and hold for 5 s.
- * Confirm 'Activate'.



Bluetooth® is activated in the controller for the next 15 minutes.

If required:

- * Confirm '+15 min'.

Activation of Bluetooth® is extended by 15 minutes.

or

- ⌂ Select 'Exit'.

- * Confirm 'Exit'.

Bluetooth® is immediately deactivated.

- Start the TROVIS 55Pro app.
- Select 'Add Bluetooth device' in the app (top right menu).
- Select the detected controller.
- If necessary, edit and save the name of the controller.

Communication is established.

16.6 Function block lists

CO1: RK1 · Heating circuit 1 (not system Anl 1.9) ¹⁾

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--------------------|----|---|---|
| 01 | Room sensor | 0 | Not systems Anl 1.5– 1.8, 3.x, 5.x, 7.x, 9.x, 12.x, 14.x, 15.x, 16.x, 17.x, 18.x | CO1 -> F01 - 1: Room sensor RF1, temperature reading and FG1 input for Types 5244, 5257-5 and 5257-51 Room Panels active |
| 02 | Outdoor sensor | 0 | 1.5–1.8, 3.5, 7.x, 10.5, 25.5 | CO1 -> F02 - 1: Outdoor sensor AF1, outdoor-temperature-compensated control active |
| | | 1 | 1.0–1.3, 2.x, 3.0–3.4, 3.9, 4.x–9.x, 10.0–10.3, 11.x–16.x, 17.x, 18.x, 21.x, 25.0 | |
| 03 | Return flow sensor | 0 | 1.1–1.4, 10.1–10.3, 21.1 | CO1 -> F03 - 1: Return flow sensor RüF1; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0) |
| | | 1 | 1.0, 1.5, 1.6– 1.8, 2.x–9.x, 10.0, 10.5, 11.x– 16.x, 17.x, 18.x, 21.0, 21.2, 21.9, 25.x | |
| 04 | Cooling control | 0 | Not systems Anl 1.9, 3.9, 5.9, 16.x, 17.x, 18.x | CO1 -> F04 - 1: Cooling control (only when CO1 -> F11 - 1) The cooling control function causes a reversal of the operating direction and a minimum limitation of the return flow temperature in RK1. |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---------------------------|----|---|--|
| 05 | Underfloor heating | 0 | Not systems Anl 1.5-1.8, 3.x, 5.0-5.2, 7.x, 9.x, 12.x, 14.x, 15.x, 16.x, 17.x, 18.x | CO1 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20.0 to 60.0 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction |
| 06 | Storage tank sensor SF2 | 1 | 3.9, 5.9, 16.x, 17.x, 18.x | CO1 -> F06 - 1: Activate SF2 to switch off charging of the buffer tank |
| 07 | Optimization | 0 | Not systems Anl 1.5-1.8, 3.x, 5.x, 7.x, 9.x, 12.x, 14.x, 15.x, 16.x, 17.x, | CO1 -> F07 - 1: Optimization of heating times (only when CO1 > F01 - 1 and CO1 -> F02 - 1) |
| 08 | Adaptation | 0 | 18.x | CO1 -> F08 - 1: Heating characteristic adaptation (only when CO1 -> F01 - 1, CO1 -> F02 - 1 and CO1 -> F11 - 0) |
| 09 | Flash adaptation | 0 | | CO1 -> F09 - 1: Flash adaptation of flow temperature (only when CO1 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0) |
| 11 | Four-point characteristic | 0 | Not Anl 1.5-1.8, 7.x | CO1 -> F11 - 1: Four-point characteristic (only when CO1 -> F08 - 0) CO1 -> F11 - 0: Gradient characteristic |
| 12 | Three-step control mode | 1 | All ¹⁾ | CO1 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25, ..., 240 s (35 s) CO1 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min) |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---|----|----------------------------|---|
| 13 | Damping | 0 | All ¹⁾ | CO1 -> F13 - 1: OPEN signal damping (only when CO1 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) |
| 14 | Release | 0 | All ¹⁾ | CO1 -> F14 - 1: Release RK1 at BI15; FG1 has no function Function block parameters: Active when BI = ON, OFF (ON) |
| 16 | Demand processing, 0 to 10 V | 0 | All ¹⁾ | CO1 -> F16 - 1: Demand processing, 0 to 10 V Function block parameters: Analog input: 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 (3) |
| 17 | Binary demand processing to terminals 17/18 | 0 | Not for systems with SF3 | CO1 -> F17 - 1: Binary demand processing Function block parameters: Active when BI = OFF, ON (ON) |
| 18 | External demand using a 0 to 10 V signal | 0 | All ¹⁾ | CO1 -> F18 - 1: external demand using a 0 to 10 V signal The output is determined in the CO5 -> F34 to F37 setting with the 'Function: external demand' (default: AA1). The maximum flow set point (with boost, if applicable) is demanded as a 0 to 10 V signal. Function block parameters: Lower transmission range: 0.0 to 150.0 °C (0.0 °C) Upper transmission range: 0.0 to 150.0 °C (120.0 °C) Boost: 0.0 to 30.0 °C (0.0 °C) |
| 20 | Demand for external heat | 0 | All ¹⁾ | CO1 -> F20 - 1: External demand for heat due to insufficient heat supply |
| 21 | Speed control of the charging pump | 0 | 3.9, 5.9, 16.x, 17.x, 18.x | CO1 -> F21 - 1: Temperature-based adaptation of the delivery rate of the charging pump The output is determined in the CO5 -> F34 to F37 setting with the 'Function: SLP speed' (default: AA1). Function block parameters: Start speed reduction, limit: 5.0 to 90.0 °C (40.0 °C) Stop speed reduction, limit: 5.0 to 90.0 °C (50.0 °C) Minimum speed: 0 to 50 % (20 %) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--|----|--|---|
| 22 | SLP depending on return flow temperature | 0 | 3.9, 5.9, 16.x, 17.x, 18.x | CO1 -> F22 - 1: Storage tank charging pump not ON unless return flow hot |
| 23 | Differential temperature control | 0 | 1.0, 16.0 | CO1 -> F23 - 1: Activation of differential temperature control The output is determined in the CO5 -> F34 to F37 setting with the 'Function: Differential temperature control' (default: AA1). Function block parameters: Set point of differential temperature control: 0.0 to 50.0 °C (20.0 °C) KP (influence factor): 0.1 to 10.0 (1.0) Minimum speed: 0 to 100 % (20 %) |
| 24 | Demand only | 0 | All ¹⁾ | CO1 -> F24 - 1: RK1 works as a feeder circuit. RK1 only processes external demand for heating; UP1 runs depending on demand |
| 25 | Buffer tank bottom sensor | 0 | 3.9,5.9, 16.x, 17.x, 18.x | CO1 -> F25 - 1: Buffer tank bottom sensor SF3 active Function block parameters: Temperature limit: 0.0 to 50.0 °C (10 °C) |
| 26 | SLP temperature sensor | 0 | 3.9, 5.9, 16.x, 17.x, 18.x | CO1 -> F26 - 1: Different sensor for the speed control of the charging pump Function block parameters: Sensor: AF1 to SF3 (RüF2) |
| 27 | Discharging protection | 0 | 3.9, 5.9, 15.4, 15.5, 16.x, 17.x, 18.x | CO1 -> F27 - 1: discharging protection active |
| 28 | Variable night set-back | 0 | Not systems Anl 1.5, 1.6, 1.7, 1.8, 3.x, 5.x, 7.x, 9.1, 9.2, 10.5, 12.x, 14.x, 15.x, 16.x, 17.x, 18.x, 25.5 | CO1 -> F28 - 1: variable night set-back (only when CO1 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to 20.0 °C (5.0 °C) OTL day 0 %: -50.0 to 5.0 °C (-15.0 °C) |

F Function block number, WE Default setting, Anl System code number

CO2: RK2 · Heating circuit 2

(systems Anl 3.1–3.4, 3.9, 4.x, 5.x, 6.0, 10.x, 16.1, 16.6, 16.8, 17.x, 18.x, 25.0, 25.5)¹⁾

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--------------------|----|---|--|
| 01 | Room sensor | 0 | All ¹⁾ | CO2 -> F01 - 1: Room sensor RF2, temperature reading and FG2 input for Types 5244, 5257-5 and 5257-51 Room Panels active |
| 02 | Outdoor sensor | 1 | All ¹⁾ | CO2 -> F02 - 1: with outdoor sensor, outdoor-temperature-compensated control active Function block parameters: Select AF1, AF2 |
| 03 | Return flow sensor | 0 | 4.x–5.2, 6.x, 10.1–10.3, 16.x | CO2 -> F03 - 1: Return flow sensor RüF2; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0) |
| | | 1 | 3.0–3.5, 10.0, 10.5, 25.x | |
| 04 | Cooling control | 0 | Not systems Anl 3.9, 5.9, 16.x, 17.x, 18.x | CO2 -> F04 - 1: Cooling control The cooling control function causes a reversal of the operating direction and a minimum limitation of the return flow temperature in RK2. |
| 05 | Underfloor heating | 0 | All ¹⁾ | CO2 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction |
| 07 | Optimization | 0 | All ¹⁾ | CO2 -> F07 - 1: Optimization of heating times (only when CO2 > F01 - 1 and CO1(2) -> F02 - 1) |
| 08 | Adaptation | 0 | All ¹⁾ | CO2 -> F08 - 1: Heating characteristic adaptation (only when CO2 -> F01 - 1, CO1(2) -> F02 - 1 and CO2 -> F11 - 0) |
| 09 | Flash adaptation | 0 | All ¹⁾ | CO2 -> F09 - 1: Flash adaptation of flow temperature (only when CO2 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|------------------------------|----|-------------------------------|--|
| 11 | Four-point characteristic | 0 | Not Anl 3.5, 10.5, 25.5 | CO2 -> F11 - 1: Four-point characteristic (only when CO2 -> F08 - 0) CO2 -> F11 - 0: Gradient characteristic |
| 12 | Three-step control mode | 1 | All ¹⁾ | CO2 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25, ..., 240 s (35 s) CO2 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min) |
| 13 | Damping | 0 | All ¹⁾ | CO2 -> F13 - 1: OPEN signal damping (only when CO2 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) |
| 14 | Release | 0 | All ¹⁾ | CO2 -> F14 - 1: Release RK2 at BI16; FG2 has no function Function block parameters: Active when BI = ON, OFF (ON) |
| 16 | Demand processing, 0 to 10 V | 0 | All ¹⁾ | CO2 -> F16 - 1: Demand processing in RK2 Function block parameters: Analog input: 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 (2) |
| 24 | Demand only | 0 | All ¹⁾ | CO2 -> F24 - 1: RK2 works as a feeder circuit. RK2 only processes external demand for heating; UP2 runs depending on demand |
| 28 | Variable night set-back | 0 | Not Anl 3.5, 10.5, 25.5 | CO2 -> F28 - 1: variable night set-back (only when CO2 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to 20.0 °C (5.0 °C) OTL day 0 %: -50.0 to 5.0 °C (-15.0 °C) |

F Function block number, WE Default setting, Anl System code number

Annex A (configuration instructions)

CO3: RK3 · Heating circuit 3

(systems Anl 5.x, 6.x, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 17.8, 21.x, 25.x)¹⁾

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--------------------|----|---|--|
| 01 | Room sensor | 0 | All ¹⁾ | CO3 -> F01 - 1: Room sensor RF3, temperature reading and FG3 input for Types 5244, 5257-5 and 5257-51 Room Panels active |
| 02 | Outdoor sensor | 1 | All ¹⁾ | CO3 -> F02 - 1: with outdoor sensor, outdoor-temperature-compensated control active Function block parameters: Select AF1, AF2 |
| 03 | Return flow sensor | 0 | 5.0-5.2, 6.x, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 21.1, 21.9 | CO3 -> F03 - 1: Return flow sensor RfF2; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0) |
| | | 1 | 21.2, 25.x | |
| 04 | Cooling control | 0 | Not systems Anl 5.9, 15.x, 16.x, 17.x | CO3 -> F04 - 1: Cooling control The cooling control function causes a reversal of the operating direction and a minimum limitation of the return flow temperature in RK3. |
| 05 | Underfloor heating | 0 | All ¹⁾ | CO3 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction |
| 07 | Optimization | 0 | All ¹⁾ | CO3 -> F07 - 1: Optimization of heating times (only when CO3 > F01 - 1 and CO1(3) -> F02 - 1) |
| 08 | Adaptation | 0 | All ¹⁾ | CO3 -> F08 - 1: Heating characteristic adaptation (only when CO3 -> F01 - 1, CO1(3) -> F02 - 1 and CO3 -> F11 - 0) |
| 09 | Flash adaptation | 0 | All ¹⁾ | CO3 -> F09 - 1: Flash adaptation of flow temperature (only when CO3 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|------------------------------|----|--------------------------|--|
| 11 | Four-point characteristic | 0 | Not Anl 25.5 | CO3 -> F11 - 1: Four-point characteristic (only when CO3 -> F08 - 0) CO3 -> F11 - 0: Gradient characteristic |
| 12 | Three-step control mode | 1 | All ¹⁾ | CO3 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25, ..., 240 s (35 s) CO3 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min) |
| 13 | Damping | 0 | All ¹⁾ | CO3 -> F13 - 1: OPEN signal damping (only when CO3 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) |
| 14 | Release | 0 | Not for systems with SF3 | CO3 -> F14 - 1: Release RK3 at BI17; FG3 has no function Function block parameters: Active when BI = ON, OFF (ON) |
| 16 | Demand processing, 0 to 10 V | 0 | All ¹⁾ | CO3 -> F16 - 1: Demand processing in RK3 Function block parameters: Analog input: 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 (1) |
| 24 | Demand only | 0 | All ¹⁾ | CO3 -> F24 - 1: RK3 works as a feeder circuit. RK3 only processes external demand for heating; UP3 runs depending on demand |
| 28 | Variable night set-back | | Not Anl 25.5 | CO3 -> F28 - 1: variable night set-back (only when CO3 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to 20.0 °C (5.0 °C) OTL day 0 %: -50.0 to 5.0 °C (-15.0 °C) |

F Function block number, WE Default setting, Anl System code number

Annex A (configuration instructions)

CO4: DHW circuit (systems Anl 1.1–1.9, 2.x, 3.1–3.4, 3.9, 4.1–4.5, 5.1, 5.2, 5.9, 7.x, 8.x, 9.x, 10.1–10.3, 11.x, 12.x, 13.x, 14.x, 15.x, 17.x, 18.x, 21.x) ¹⁾

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--|----|---------------------------------------|--|
| 01 | Storage tank sensor SF1 Not systems Anl 3.9, 5.9, 11.0, 11.3, 11.5, 12.0, 13.0, 17.x, 18.x, 21.0 | 1 | ¹⁾ | CO4 -> F01 - 1: Storage tank sensor SF1 CO4 -> F01 - 0: Storage tank thermostat (only when CO4 -> F02 - 0) ¹⁾ Default = 1: Systems Anl 1.1–1.8, 2.x, 3.1–3.4, 4.1–4.5, 5.1, 5.2, 7.x–9.x, 10.1–10.3, 11.1, 11.2, 11.4, 11.6, 12.1, 13.1, 13.2, 14.x, 15.x, 21.1, 21.2 ²⁾ Default = 0: Systems Anl 1.9, 11.9, 12.9, 13.9, 21.9 |
| | | 0 | ²⁾ | |
| 02 | Storage tank sensor SF2 Not Anl 1.9, 11.0, 11.3, 11.9, 12.0, 12.9, 13.0, 13.9, 14.3, 15.3, 21.0, 21.9 | 0 | ¹⁾ | CO4 -> F02 - 1: Storage tank sensor SF2 (only when CO4 -> F01 - 1) ¹⁾ Default = 1: 1.1, 1.3, 1.4, 1.5, 1.7, 1.8-2, 2.0, 2.1, 3.1, 3.3, 3.4, 4.1, 4.3, 4.5, 5.1, 7.1, 8.1, 9.1, 9.5, 10.1, 10.3, 11.1, 11.4, 11.5, 11.9, 12.1, 13.1, 14.1, 15.0, 15.1, 21.1 ²⁾ Default = 0: 1.2, 1.6, 1.8-1, 1.8-3, 1.9, 2.2, 2.3, 2.4, 3.2, 4.2, 5.2, 7.2, 8.2, 9.2, 9.6, 10.2, 11.0, 11.2, 11.3, 11.6, 12.0, 12.2, 12.9, 13.0, 13.2, 13.9, 14.2, 14.3, 15.2, 15.3, 21.0, 21.2, 21.9 |
| | | 1 | ²⁾ | |
| 03 | Return flow sensor RÜF2 | 0 | 1.9, 7.x, 8.x, 11.x, 12.x, 13.x, 21.x | CO4 -> F03 - 1: return flow sensor RÜF2; limitation function active Function block parameter: KP (limiting factor): 0.1 to 10.0 (1.0) |
| | | | 3.9, 5.9, 17.x, 18.x | CO4 -> F03 - 1: return flow sensor RÜF2 or RÜF4 when RÜF2 is activated for HK2; output UP1 to layer the return flow depending on the temperature active |
| 04 | Flow rate sensor | 0 | 1.9, 11.9, 12.9, 13.9, 21.9 | CO4 -> F04 - 1: Flow rate sensor active Function block parameter: Select: Analog/Binary (Analog) ¹⁾ ¹⁾ Analog = flow rate sensor (1400-9246) Binary = flow switch at terminals 17/18 In systems Anl 3.9, 5.9, 17.x and 18.x, only a flow switch can be configured. |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---|----|--|---|
| 05 | Flow sensor | 0 | 1.1-1.4, 1.6, 1.8, 1.9, 2.2, 2.4, 3.2, 3.4, 4.2, 5.2, 7.2, 8.2, 9.2, 9.6, 10.1- 10.3, 11.2, 11.9, 12.2, 12.9, 13.2, 13.9, 21.2, 21.9 | CO4 -> F05 - 1: Flow sensor VF4 (to measure storage tank charging temperature) |
| 06 | Parallel pump operation | 1 | 8.x, 9.5, 9.6 | CO4 -> F06 - 1: Parallel pump operation Function block parameters: Stop: 0 to 10 min (10 min) Temperature limit: 20.0 to 90.0 °C (40.0 °C) |
| | | 0 | 2.1-2.4, 4.1-4.5 | CO4 -> F06 - 0: UP1 switched off during DHW heating |
| 07 | Intermediate heating | 1 | 2.x, 4.1-4.5 | CO4 -> F07 - 1: after 20 minutes of DHW heating, heating operation in UP1 circuit reactivated for 10 minutes |
| | | 0 | 8.x, 9.5, 9.6 | CO4 -> F07 - 0: storage tank charging is given unlimited priority concerning UP1 circuit |
| 08 | Priority (reverse) | 0 | 1.1-1.4, 3.1-3.4, 4.1-4.5, 5.1, 5.2, 9.x, 10.1- 10.3, 11.x, 12.x, 13.x, 15.0, 15.4, 15.5, 21.x | CO4 -> F08 - 1: Priority by reverse control (only when CO4 -> F09 - 0) Function block parameters: Start: 0 to 10 min (2 min) KP (influence factor): 0.1 to 10.0 (1.0) Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3 |
| 09 | Priority (set-back) | 0 | | CO4 -> F09 - 1: Priority through set-back operation (only when CO4 -> F08 - 0) Function block parameters: Start: 0 to 10 min (2 min) Control circuit: HC1, HC2, HC3, HC1+HC2, HC1+HC3 |
| 10 | Circulation pump (DHW) integrated into heat exchanger | 0 | 1.6, 1.8, 3.2, 3.4, 5.2, 7.2, 9.2, 11.2, 11.4, 12.2, 13.2, 21.2 | CO4 -> F10 - 1: Control of DHW circuit active while circulation pump (ZP) is running |
| | | 1 | 11.6, 13.6 | |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--|----|---|---|
| 11 | Operation of circulation pump (DHW) during storage tank charging | 0 | Not Anl 1.9, 11.0, 11.3, 11.9, 12.0, 12.9, 13.0, 13.9, 21.0, 21.9 | CO4 -> F11 - 1: Circulation pump (ZP) runs according to time schedule during storage tank charging CO4 -> F11 - 0: Circulation pump (ZP) switched off during storage tank charging |
| 12 | Control mode | 1 | 1.9, 3.9, 5.9, 7.x, 8.x, 9.x, 11.x, 12.x, 13.x, 17.x, 18.x, 21.x | CO4 -> F12 - 1: Three-step control Function block parameters: Minimum speed: 5 to 50 % (20 %) (systems Anl 3.9, 5.9, 17.x, 18.x only) KP (gain): 0.1 to 50.0 (2.0; systems Anl 1.9, 11.9, 12.9, 13.9, 21.9: 0.6) Tn (reset time): 1 to 999 s (120 s, systems Anl 3.9, 5.9, 17.x 18.x: 30 s; systems Anl 1.9, 11.9, 12.9, 13.9, 21.9: 12 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15 to 240 s (35 s; systems Anl 1.9, 11.9, 12.9, 13.9, 21.9: 20 s, not systems Anl 3.9, 5.9, 17.x, 18.x) CO4 -> F12 - 0: On/off control (not systems Anl 3.9, 5.9, 17.x, 18.x); in this case, F12 - 0 = F12 - 1 applies Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min) |
| 13 | Damping | 0 | All ¹⁾ | CO4 -> F13 - 1: OPEN signal damping (only when CO4 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) |
| | | 1 | | CO4 -> F13 - 1: OPEN signal damping (only when CO4 -> F04 - 1, analog setting) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (8.0 °C) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--|----|---|---|
| 14 | Thermal disinfection | 0 | Not systems Anl 3.9, 5.9, 17.x, 18.x | CO4 -> F14 - 1: Thermal disinfection (only when CO4 -> F01 - 1) Function block parameters: Day of week: Monday, Tuesday, ..., daily (Wednesday) Time: Adjustable as required in steps of 15 minutes (00:00 – 04:00) Disinfection temperature: 60.0 to 90.0 °C (70.0 °C) Set point boost: 0.0 to 50.0 °C (10.0 °C) (systems Anl 1.9, 3.9, 5.9, 11.0, 11.3, 11.5, 11.9, 12.0, 12.9, 13.0, 13.9, 17.x, 18.x, 21.0, 21.9 only) Duration: 0 to 255 min (0 min) When Start time = Stop time Select: Active when BI = OFF, ON (ON) |
| | | | 3.9, 5.9, 17.x, 18.x | CO4 -> F14 - 1: Thermal disinfection using return flow sensor (circulation) RÜF3 |
| 15 | SLP depending on return flow temperature | 0 | 1.5, 1.7, 2.0, 2.1, 2.3, 3.1, 3.3, 4.1, 4.3, 5.1, 11.1 | CO4 -> F15 - 1: storage tank charging pump not ON unless return flow hot (for systems Anl 1.5, 1.7, 2.0, 2.1, 2.3, 4.1, 4.3, 5.1 only when CO1 -> F03 - 1; for system Anl 11.1 only when CO4 -> F03 - 1) |
| 16 | Priority for external demand | 0 | 1.5-1.8, 2.x, 3.1-3.4, 4.1-4.3, 5.x, 15.0, 15.4, 15.5 | CO4 -> F16 - 1: Priority for external demand Note: a high external demand causes excessive charging temperatures in DHW circuits without control valve. |
| | | 1 | 7.x-9.x | The default setting cannot be changed in systems Anl 7.x to 9.x. |
| 19 | Switchover | 0 | Not systems Anl 1.9, 3.9, 5.9, 11.0, 11.3, 11.5, 11.9, 12.0, 12.9, 13.0, 13.9, 17.x, 18.x, 21.0, 21.9 | CO4 -> F19 - 1: Switchover SF1, SF2 according to a time schedule. SF1 applies for day mode and SF2 for night mode (only when CO4 -> F02 - 1) |
| 20 | Return flow control | 0 | 7.1, 8.1, 9.1, 9.5, 11.1, 12.1, 13.1, 21.1 | CO4 -> F20 - 1: DHW circuit additionally controlled by a globe valve |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--|----|--|---|
| 21 | Speed control of the charging pump | 0 | 1.5-1.8, 2.x, 3.1-3.4, 4.1-4.3, 5.1, 5.2, 7.x, 8.x, 9.x, 10.1-10.3, 11.1, 11.2, 11.4, 11.6, 12.1, 12.2, 13.1, 13.2, 21.1, 21.2 | CO4 -> F21 - 1: Temperature-based adaptation of the delivery rate of the charging pump The output is determined in the CO5 -> F34 to F37 setting with the 'Function: SLP speed' (default: AA1). Function block parameters: Start speed reduction, limit: 5.0 to 90.0 °C (40.0 °C) Stop speed reduction, limit: 5.0 to 90.0 °C (50.0 °C) Min. speed signal: 0 to 50 % (20 %) |
| 22 | Cold charging protection | 0 | 1.1 | CO4 -> F22 - 1: Storage tank charging started when the primary flow temperature is high enough Function block parameters: Valve position: 1 to 100 % |
| 23 | Electric heating cartridge | 0 | Systems Anl 3.9, 17.1, 18.1 | CO4 -> F23 - 1: The output BO10 to release the electric heating is activated based on the temperature at SF1 for thermal disinfection (only when CO4 -> F14 - 1) |
| 24 | Bottom sensor for thermal disinfection | 0 | 1.2, 1.4, 1.6, 1.8, 2.2, 2.4, 3.2, 3.4, 4.2, 5.2, 7.2, 8.2, 9.2, 9.6, 10.2, 11.2, 11.4, 11.6, 12.2, 13.2, 13.6, 14.2, 15.2, 21.2 | CO4 -> F24 - 1: only when CO4 -> F14 - 1 Sensor RüF2 as switch-off sensor active |
| 25 | ZP speed | 0 | All | CO4 -> F25 - 1: speed control Temperature sensor RüF4/AF2 active The output is determined in the CO5 -> F34 to F37 setting with the 'Function: ZP speed' (default: AA3). Function block parameters: Return flow set point: 5.0 to 90.0 °C (55 °C) KP (gain): 0.1 to 50.0 (1.0) Tn (reset time): 30 to 2000 s (300 s) Minimum speed: 5 to 50 % (10 %) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|------------------------|----|---|---|
| 26 | SLP temperature sensor | 0 | All | CO4 -> F26 - 1: Different sensor for the speed control of the charging pump Function block parameters: Sensor: AF1 to SF3 (RüF2) |
| 27 | Discharging protection | | Not Anl 1.1-1.4, 1.9, 3.9, 5.9, 10.1-10.3, 11.0, 11.3, 11.9, 12.0, 12.9, 13.0, 13.9, 14.x, 15.x, 17.x, 18.x, 21.0, 21.9 | CO4 -> F27 - 1: discharging protection active |

F Function block number, WE Default setting, Anl System code number


CO5: System-wide functions (all systems)

If the heating controller indicates CO5 -> F00 - 1, any access to the return flow, flow rate and capacity settings is locked.

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---|----|--|---|
| 01 | Sensor type | 1 | All | CO5 -> F01 - 1, F02 - 0: Pt 1000 |
| 02 | | | | CO5 -> F01 - 0, F02 - 0: PTC |
| 03 | | | | CO5 -> F01 - 1, F02 - 1: Ni 1000 |
| 04 | Summer mode | 0 | Not systems Anl 1.5, 1.6, 1.9, 3.5, 10.5, 25.5 | CO5 -> F04 - 1: Summer mode Function block parameters: Date: adjustable as required (01.06. - 30.09.) No. days until activation: 1 to 3 (2) No. days until deactivation: 1 to 3 (1) Limit: 0.0 to 30.0 °C (18.0 °C) |
| 05 | Delayed outdoor temperature adaptation (decreasing) | 0 | Not Anl 1.9 | CO5 -> F05 - 1: Delayed outdoor temperature adaptation as the temperature falls Function block parameters: Delay/h: 0.2 to 6.0 °C (3.0 °C) |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---|----|--|---|
| 06 | Delayed outdoor temperature adaptation (increasing) | 0 | Not Anl 1.9 | CO5 -> F06 - 1: Delayed outdoor temperature adaptation as the temperature rises Function block parameters: Delay/h: 0.2 to 6.0 °C (3.0 °C) |
| 07 | Error message | 0 | Not systems Anl 5.1, 5.2, 5.9, 6.1, 9.x, 12.1, 12.2-x, 13.1, 13.2, 13.6, 15.1, 15.2, 15.3, 17.8, 21.1, 21.2 | CO5 -> F07 - 1: Terminal for error message: see plant scheme table Function block parameters: Relay contact = NO contact, NC contact (NO contact) |
| 08 | Summer time | 0 | All | CO5 -> F08 - 1: Summer/standard time switchover |
| 09 | Frost protection | 1 | Not systems Anl 1.5, 1.6, 1.9, 3.5, 10.5, 25.5 | CO5 -> F09 - 1: Highest priority for frost protection Function block parameters: Limit: -15.0 to 3.0 °C (3.0 °C) CO5 -> F09 - 0: Restricted frost protection Function block parameters: Limit: -15.0 to 3.0 °C (3.0 °C) |
| | | 0 | 1.5, 1.6, 1.9, 3.5, 10.5, 25.5 | |
| 10 | Capacity limitation at terminals 17/18 | 0 | Not for systems with SF3, not system Anl 1.9 | CO5 -> F10 - 1: Capacity limitation in RK1 with pulses (only when CO6 -> F12 - 0) Function block parameters: Max. limit: OT to 800 pulses/h (15 pulses/h) Max. limit (heating) ¹⁾ : OT to 800 pulses/h (15 pulses/h) Max. limit (DHW) ¹⁾ : 1 to 800 pulses/h (15 pulses/h) Limiting factor: 0.1 to 10.0 (1.0) ¹⁾ Not systems Anl 1.0, 1.5-1.8, 3.0, 3.5, 3.9, 4.0, 5.9, 7.x, 10.x, 11.x, 12.x, 13.x, 14.x, 15.x, 16.x, 17.x, 18.x, 21.x, 25.x |
| 12 | Creep feed rate limitation | 0 | Not Anl 1.9 | CO5 -> F12 - 1: Creep feed rate limitation Function block parameters: Switching mode: Binary at terminals 13/19, analog at input RÜF1 (binary) Active when BI = ON, OFF (ON) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--|----|---|---|
| 14 | Operation UP1 | 0 | 3.0, 5.0, 7.x, 9.1, 9.2, 12.x, 15.1, 16.1, 16.5, 16.7, 16.8 | CO5 -> F14 - 1: Feeder pump UP1 operation to cover own demand Note: the feeder pump UP1 also starts to operate to cover the demand of RK2/RK3 |
| 15 | Release | 0 | All | CO5 -> F15 - 1: Release controller at BI15, FG1 has no function Function block parameters: Active when BI = ON, OFF (ON) |
| 16 | Return flow temperature limitation (proportional controller) | 0 | All | CO5 -> F16 - 1: Return flow temperature limitation with P algorithm |
| 19 | Monitoring | 0 | All | CO5 -> F19 - 1: Temperature monitoring |
| 20 | Sensor calibration | 1 | All | CO5 -> F20 - 1: Set all sensor calibration values CO5 -> F20 - 0: Delete all sensor calibration values |
| 21 | Lock manual level | 0 | All | CO5 -> F21 - 1: Lock rotary switch In  switch position, the controller runs in automatic mode |
| 22 | Lock rotary switch | 0 | All | CO5 -> F22 - 1: Lock rotary switch Key number input is still possible. |
| 23 | OT with 0-10 V | 0 | All | CO5 -> F23 - 1: Outdoor temperature received (at AE3) or sent as 0 to 10 V signal The output is determined in the CO5 -> F34 to F37 setting with the 'Function: outdoor temperature' (default: AA1). Function block parameters: Direction: Input, Output (Input) Lower transmission range: -50.0 to 100.0 °C (-20.0 °C) Upper transmission range: -50.0 to 100.0 °C (50.0 °C) |
| 24 | 0-10 V input | 0 | All | CO5 -> F24 - 1: The measured values of the selected analog inputs are displayed in 'Special values'. Function block parameters: Analog input: 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 (3) |
| 25 | AA1 reverse | 0 | All | CO5 -> F25 - 0: 0 V/0 % = Valve CLOSED/pump OFF CO5 -> F25 - 1: 0 V/0 % = Valve OPEN/pump with max. delivery rate Function block parameters: Zero: 0 to 50 % (0 %) |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|-------------|----|-----|---|
| 26 | AA2 reverse | 0 | All | CO5 -> F26 - 0: 0 V/0 % = Valve CLOSED/pump OFF CO5 -> F26 - 1: 0 V/0 % = Valve OPEN/pump with max. delivery rate Function block parameters: Zero: 0 to 50 % (0 %) |
| 27 | AA3 reverse | 0 | All | CO5 -> F27 - 0: 0 V/0 % = Valve CLOSED/pump OFF CO5 -> F27 - 1: 0 V/0 % = Valve OPEN/pump with max. delivery rate Function block parameters: Zero: 0 to 50 % (0 %) |
| 28 | AA4 reverse | 0 | All | CO5' -> F28 - 0: 0 V/0 % = Valve CLOSED/pump OFF CO5 -> F28 - 1: 0 V/0 % = Valve OPEN/pump with max. delivery rate Function block parameters: Zero: 0 to 50 % (0 %) |
| 31 | AE1 zero | 0 | All | CO5 -> F31 - 0 Function block parameters: Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C) CO5 -> F31 - 1 Function block parameters: Zero: 5 to 20 % (5 %) Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C) |
| 32 | AE2 zero | 0 | All | CO5 -> F32 - 0 Function block parameters: Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C) CO5 -> F32 - 1 Function block parameters: Zero: 5 to 20 % (5 %) Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|----------|----|---|---|
| 33 | AE3 zero | 0 | All | CO5 -> F33 - 0 Function block parameters: Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C) CO5 -> F33 - 1 Function block parameters: Zero: 5 to 20 % (5 %) Lower transmission range: 0 to 150 °C (0 °C) Upper transmission range: 0 to 150 °C (120 °C) |
| 34 | AA1 PWM | 0 | All | CO5 -> F34 - 0: 0 to 10 V, continuous-action signal CO5 -> F34 - 1: PWM signal Function: Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (Y1) |
| 35 | AA2 PWM | 0 | All | CO5 -> F35 - 0: 0 to 10 V, continuous-action signal CO5 -> F35 - 1: PWM signal Function: Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (Y2) |
| 36 | AA3 PWM | 0 | All | CO5 -> F36 - 0: 0 to 10 V, continuous-action signal CO5 -> F36 - 1: PWM signal Function: Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (Y3) |
| 37 | AA4 PWM | 0 | Not systems Anl 3.9, 5.9, 17.x, 18.x | CO5 -> F37 - 0: 0 to 10 V, continuous-action signal Function: Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (10 V supply) |
| | | 1 | Systems Anl 3.9, 5.9, 17.x, 18.x | CO5 -> F37 - 1: PWM signal Function: Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature (10 V supply) |

F Function block number, WE Default setting, Anl System code number

Annex A (configuration instructions)

CO6: Modbus (all systems)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|-----------------------------|----|-------------|--|
| 01 | Modbus | 1 | All | CO6 -> F01 - 1: Modbus RTU active |
| 02 | 16-bit address | 0 | All | CO6 -> F02 - 1: Modbus 16-bit addressing (only with CO6 -> F01 - 1) CO6 -> F02 - 0: Modbus 8-bit addressing |
| 07 | Monitoring | 0 | All | CO6 -> F07 - 1: Control system monitoring > Resets all level bits to "autonomous" when there is no communication (only when CO6 -> F01 - 1) |
| 10 | Meter bus | 0 | All | CO6 -> F10 - 1: Meter bus active Function block parameters: HM 1...3 address/0 to 255 (255) HM1...3 model: 1434, Multical3, Apator, SLS/WSF (1434) HM1...3 mode: 24h, Cont., Coil (Cont.) For HM1 with '1434' and 'Continuous' settings, additionally: Additionally: Select: Tariff: Tar-A, Tar-E (Tar-A, tariff schedule OFF) |
| 11 | Flow rate limitation in RK1 | 0 | Not Anl 1.9 | CO6 -> F11 - 1: Flow rate limitation (only when CO6 -> F10 - 1 and HM1 is activated) Function block parameters: Max. limit: OT to 650 m ³ /h (1.5 m ³ /h) Max. limit (heating) ¹⁾ : OT to 650 m ³ /h (1.5 m ³ /h) Max. limit (DHW) ¹⁾ : 0.01 to 650 m ³ /h (1.5 m ³ /h) Limiting factor: 0.1 to 10 (1) |
| 12 | Capacity limitation in RK1 | 0 | Not Anl 1.9 | CO6 -> F12 - 1: Capacity limitation (only when CO6 -> F10 - 1 and HM1 is activated) Function block parameters: Max. limit: OT to 6500 kW (1.5 kW) Max. limit (heating) ¹⁾ : OT to 6500 kW (1.5 kW) Max. limit (DHW) ¹⁾ : 0.1 to 6500 kW (1.5 kW) Limiting factor: 0.1 to 10 (1) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--|----|--|--|
| 13 | Flow rate limitation in RK2 | 0 | 3.0–3.4, 3.9, 4.x, 5.9, 7.x, 8.x, 10.x, 11.x, 12.x, 13.x, 15.x, 16.1, 16.6, 16.8, 17.x, 18.x, 21.x, 25.x | CO6 -> F13 - 1: Flow rate limitation (only when CO6 -> F10 - 1 and HM2 is activated) Function block parameters: Max. limit: 0.01 to 650 m ³ /h (1.5 m ³ /h) Limiting factor: 0.1 to 10 (1) |
| 14 | Capacity limitation in RK2 | 0 | | CO6 -> F14 - 1: Capacity limitation (only when CO6 -> F10 - 1 and HM2 is activated) Function block parameters: Max. limit: 0.1 to 6500 kW (1.5 kW) Limiting factor: 0.1 to 10 (1) |
| 15 | Flow rate limitation in RK3 | 0 | 5.9, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 17.8, 21.x, 25.x | CO6 -> F15 - 1: Flow rate limitation (only when CO6 -> F10 - 1 and HM3 is activated) Function block parameters: Max. limit: 0.01 to 650 m ³ /h (1.5 m ³ /h) Limiting factor: 0.1 to 10 (1) |
| 16 | Capacity limitation in RK3 | 0 | | CO6 -> F16 - 1: Capacity limitation (only when CO6 -> F10 - 1 and HM3 is activated) Function block parameters: Max. limit: 0.1 to 6500 kW (1.5 kW) Limiting factor: 0.1 to 10 (1) |
| 17 | Return flow temperature limitation based on capacity | 0 | All | CO6 -> F17 - 1: new maximum return flow limit at a capacity higher than the max. limit (only when CO6 -> F10 - 1 and activated HM1) Function block parameters: Max. limit: 0.1 to 6500 kW (1.5 kW) Max. return flow temperature: 5.0 to 90 °C (55 °C) |
| 20 | Modbus without building automation system | 0 | All | CO6 -> F20 - 1: Various Modbus specifications do not have any effect on the collective level/building automation system reading |
| 25 | Manual IP address | 0 | All | CO6 -> F25 - 0: DHCP active CO6 -> F25 - 1: IP address can be selected manually Function block parameters: IP address: 0 to 255 (in blocks) (192.168.55.2) Subnet: 0 to 255 (in blocks) (255.255.255.0) Gateway: 0 to 255 (in blocks) (192.168.55.1) DNS-Server: 0 to 255 (in blocks) (8.8.8.8) (only when CO6 -> F26 - 1) |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|--|---------------------|----|-----|--|
| 26 | SAM DISTRICT ENERGY | 0 | All | CO6 -> F26 - 1: Connection to SAM DISTRICT ENERGY web portal |
| 27 | Modbus TCP/IP | 0 | All | CO6 -> F27 - 1: Modbus TCP/IP active Function block parameters: Port configurable as required (502) |
| 28 | Encryption | 0 | All | CO6 -> F28 - 1: AES encryption active Function block parameters: A maximum of 49 characters freely combinable from the list of letters, number and special characters (after-sales service) When CO6 -> F27 - 1 |
| | | 1 | | CO6 -> F28 - 1: AES encryption active (only when CO6 -> F27 - 1) Function block parameters: A maximum of 49 characters freely combinable from the list of letters, number and special characters (after-sales service) |
| 31 | Forwarding | 0 | All | CO6 -> F31 - 1: Modbus TCP/IP access to controller on RS-485 interface active Function block parameters: Refreshing rate: AUTO to 30 s (5 s); determines the cycle time of the device bus. AUTO setting only when TCP/IP forwarding is activated several times on a RS-485 bus. |
| ¹⁾ Not systems Anl 1.0, 1.5-1.8, 3.0, 3.5, 3.9, 4.0, 5.9, 7.x, 10.x, 11.x, 12.x, 13.x, 14.x, 15.x, 16.x, 17.x, 18.x, 21.x, 25.x | | | | |

F Function block number, WE Default setting, Anl System code number

CO7: Device bus (all systems)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|-----------------------|----|-----|---|
| 01 | Device bus | 0 | All | CO7 -> F01 - 1: Device bus active Function block parameters: Device bus address/Auto ¹⁾ , 1 to 32 (32) ¹⁾ Auto = Automatic search for a free device bus address in the system |
| 02 | Clock synchronization | 0 | All | CO7 -> F02 - 1: controller sends its system time to all device bus participants once every 24 hours |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--------------------|----|--|--|
| 03 | Room panel RK1 | 0 | 1.0–1.4, 2.x, 4.x, 6.x, 9.5, 9.6, 10.x, 11.x, 13.x, 21.x, 25.x | CO7 -> F03 - 1: communication with TROVIS 5570 for RK1 active, CO1 -> F01 - 1 automatically set Function block parameters: Device bus address/Auto ¹⁾ , 1 to 32 (32) ¹⁾ Auto = Automatic search for a room panel set to detection mode |
| 04 | Room panel RK2 | 0 | 3.0–3.4, 3.9, 4.x, 5.x, 6.x, 10.x, 16.1, 16.6, 16.8, 17.x, 18.x, 25.x | CO7 -> F04 - 1: communication with TROVIS 5570 for RK2 active, CO2 -> F01 - 1 automatically set Function block parameters: Device bus address/Auto ¹⁾ , 1 to 32 (32) ¹⁾ Auto = Automatic search for a room panel set to detection mode |
| 05 | Room panel RK3 | 0 | 5.x, 6.x, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 17.8, 21.x, 25.x | CO7 -> F05 - 1: communication with TROVIS 5570 for RK3 active, CO3 -> F01 - 1 automatically set Function block parameters: Device bus address/Auto ¹⁾ , 1 to 32 (32) ¹⁾ Auto = Automatic search for a room panel set to detection mode |
| 06 | Send AF1 | 0 | All | CO7 -> F06 - 1: Function block parameters: Register number/1 to 4 (1) |
| 07 | Receive AF1 | 0 | All | CO7 -> F07 - 1: Function block parameters: Register number/1 to 4 (1) |
| 08 | Send AF2 | 0 | All | CO7 -> F08 - 1: Analysis active Function block parameters: Register number/1 to 4 (2) |
| 09 | Receive AF2 | 0 | Not Anl 1.9 | CO7 -> F09 - 1: Function block parameters: Register number/1 to 4 (2) |
| 10 | Send demand RK1 | 0 | All | CO7 -> F10 - 1: Send demand Function block parameters: Register number/5 to 64 (5) |
| 11 | Send demand RK2 | 0 | All | CO7 -> F11 - 1: Function block parameters: Register number/5 to 64 (5) |
| 12 | Send demand RK3 | 0 | All | CO7 -> F12 - 1: Function block parameters: Register number/5 to 64 (5) |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--------------------------------|----|---|---|
| 13 | Send demand DHW | 0 | All | CO7 -> F13 - 1: 'Charging temperature boost' (P04) is generated in the PA4 level Function block parameters: Register number/5 to 64 (5) |
| 14 | Send max. demand | 0 | All | CO7 -> F14 - 1: the controller already determines internally the maximum flow set point of its circuit and sends it this value to the primary controllers Function block parameters: Register number/5 to 64 (5) |
| 15 | Receive external demand in RK1 | 0 | All | CO7 -> F15 - 1: External demand processing in RK1 Function block parameters: Register number/5 to 64 (5) |
| 16 | Receive errors | 0 | All | CO7 -> F16 - 1: the controller generates the 'External' message as long as the faults of the other device bus participants exist. |
| 17 | Receive external demand in RK2 | 0 | All | CO7 -> F17 - 1: External demand processing in RK2 Function block parameters: Register number/5 to 64 (5) |
| 18 | Receive external demand in RK3 | 0 | All | CO7 -> F18 - 1: External demand processing in RK3 Function block parameters: Register number/5 to 64 (5) |
| 19 | Raise return flow temperature | 0 | All | CO7 -> F19 - 1: Return flow temperature limit in RK1 raised when 'DHW heating active' message is received over the device bus Function block parameters: Register number/5 to 64 (32) |
| 20 | Send 'DHW heating active' | 0 | All | CO7 -> F20 - 1: Function block parameters: Register number/5 to 64 (32) |
| 21 | Receive release RK1 | 0 | All | CO7 -> F21 - 1: Function block parameters: Register number/5 to 64 (32) |
| 22 | Receive release RK2 | 0 | 3.1-3.4, 3.9, 4.x, 5.x, 6.x, 10.x, 16.1, 16.6, 16.8, 17.x, 18.x, 25.x | CO7 -> F22 - 1: Function block parameters: Register number/5 to 64 (32) |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----------|---------------------|-----------|--|--|
| 23 | Receive release RK3 | 0 | 5.x, 6.x, 9.x, 12.x, 13.x, 15.x, 16.5, 16.7, 16.8, 17.8, 21.x, 25.x | CO7 -> F23 - 1: Function block parameters: Register number/5 to 64 (32) |
| 31 | Ext-HC11 | 0 | All | CO7 -> F31 - 1: TROVIS I/O for heating circuit 11 active Function block parameters: Device bus address: 11 to 19 (11) Connected/primary circuit, to HC1 (to HC1) |
| 32 | Ext-HC12 | 0 | All | CO7 -> F32 - 1: TROVIS I/O for heating circuit 12 active Function block parameters: Device bus address: 11 to 19 (12) Connected/primary circuit, to HC1 (to HC1) |
| 33 | Ext-HC13 | 0 | All | CO7 -> F33 - 1: TROVIS I/O for heating circuit 13 active Function block parameters: Device bus address: 11 to 19 (13) Connected/primary circuit, to HC1 (to HC1) |

F Function block number, WE Default setting, Anl System code number

CO8: Initialization of BI1 and BI2 (all systems)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----------|-----------------|-----------|------------|--|
| 01 | Analysis of BI1 | 0 | All | CO8 -> F01 - 1: Analysis active Function block parameter: ¹⁾ |
| 02 | Analysis of BI2 | 0 | All | CO8 -> F02 - 1: Analysis active Function block parameter: ¹⁾ |
| 03 | Analysis of BI3 | 0 | All | CO8 -> F03 - 1: Analysis active Function block parameter: ¹⁾ |
| 04 | Analysis of BI4 | 0 | All | CO8 -> F04 - 1: Analysis active Function block parameter: ¹⁾ |
| 05 | Analysis of BI5 | 0 | All | CO8 -> F05 - 1: Analysis active Function block parameter: ¹⁾ |
| 06 | Analysis of BI6 | 0 | All | CO8 -> F06 - 1: Analysis active Function block parameter: ¹⁾ |
| 09 | Analysis of BI9 | 0 | All | CO8 -> F09 - 1: Analysis active Function block parameter: ¹⁾ |

Annex A (configuration instructions)

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|---|------------------|-----------|------------|--|
| 10 | Analysis of BI10 | 0 | All | CO8 -> F10 - 1: Analysis active Function block parameter: ¹⁾ |
| 11 | Analysis of BI11 | 0 | All | CO8 -> F11 - 1: Analysis active Function block parameter: ¹⁾ |
| 12 | Analysis of BI12 | 0 | All | CO8 -> F12 - 1: Analysis active Function block parameter: ¹⁾ |
| 13 | Analysis of BI13 | 0 | All | CO8 -> F13 - 1: Analysis active Function block parameter: ¹⁾ |
| 15 | Analysis of BI15 | 0 | All | CO8 -> F15 - 1: Analysis active Function block parameter: ¹⁾ |
| 16 | Analysis of BI16 | 0 | All | CO8 -> F16 - 1: Analysis active Function block parameter: ¹⁾ |
| 17 | Analysis of BI17 | 0 | All | CO8 -> F17 - 1: Analysis active Function block parameter: ¹⁾ |
| ¹⁾ Error message when BI = 0, BI = 1, none (1) | | | | |

F Function block number, WE Default setting, Anl System code number

CO11: RK11 · Heating circuit 11

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----------|--------------------|-----------|------------|---|
| 01 | Room sensor | 0 | All | CO11 -> F01 - 1: Room sensor RF11; temperature reading active |
| 02 | Outdoor sensor | 0 | All | CO11 -> F02 - 1: Use of measured value AF1; outdoor-temperature-compensated control active |
| 03 | Return flow sensor | 1 | All | CO11 -> F03 - 1: Rücklaufsensoren RUF11; Begrenzungsfunktion aktiv Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0) |
| 05 | Underfloor heating | 0 | All | CO11 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---------------------------|----|-----|--|
| 07 | Optimization | 0 | All | CO11 -> F07 - 1: Optimization of heating times (only when CO11 > F01 - 1 and CO11 -> F02 - 1) |
| 08 | Adaptation | 0 | All | CO11 -> F08 - 1: Heating characteristic adaptation (only when CO11 -> F01 - 1, CO11 -> F02 - 1 and CO11 -> F11 - 0) |
| 09 | Flash adaptation | 0 | All | CO11 -> F09 - 1: Flash adaptation of flow temperature (only when CO11 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0) |
| 11 | Four-point characteristic | 0 | All | CO11 -> F11 - 1: Four-point characteristic (only when CO11 -> F08 - 0) CO11 -> F11 - 0: Gradient characteristic |
| 12 | Three-step control mode | 1 | All | CO11 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25, ..., 240 s (35 s) CO11 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min) |
| 13 | Damping | 0 | All | CO11 -> F13 - 1: OPEN signal damping (only when CO11 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) |
| 28 | Variable night set-back | 0 | All | CO11 -> F28 - 1: variable night set-back (only when CO11 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to 20.0 °C (5.0 °C) OTL day 0 %: -50.0 to 5.0 °C (-15.0 °C) |

F Function block number, WE Default setting, Anl System code number

Annex A (configuration instructions)

CO12: RK12 · Heating circuit 12

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---------------------------|----|-----|---|
| 01 | Room sensor | 0 | All | CO12 -> F01 - 1: Room sensor RF12; temperature reading active |
| 02 | Outdoor sensor | 0 | All | CO12 -> F02 - 1: Use of measured value AF1; outdoor-temperature-compensated control active |
| 03 | Return flow sensor | 1 | All | CO12 -> F03 - 1: return flow sensor RfF12; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0) |
| 05 | Underfloor heating | 0 | All | CO12 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction |
| 07 | Optimization | 0 | All | CO12 -> F07 - 1: Optimization of heating times (only when CO12 > F01 - 1 and CO12 -> F02 - 1) |
| 08 | Adaptation | 0 | All | CO12 -> F08 - 1: Heating characteristic adaptation (only when CO12 -> F01 - 1, CO12 -> F02 - 1 and CO12 -> F11 - 0) |
| 09 | Flash adaptation | 0 | All | CO12 -> F09 - 1: Flash adaptation of flow temperature (only when CO12 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0) |
| 11 | Four-point characteristic | 0 | All | CO12 -> F11 - 1: Four-point characteristic (only when CO11 -> F08 - 0) CO12 -> F11 - 0: Gradient characteristic |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|-------------------------|----|-----|--|
| 12 | Three-step control mode | 1 | All | CO12 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25, ..., 240 s (35 s) CO12 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min) |
| 13 | Damping | 0 | All | CO12 -> F13 - 1: OPEN signal damping (only when CO11 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) |
| 28 | Variable night set-back | 0 | All | CO12 -> F28 - 1: variable night set-back (only when CO12 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to 20.0 °C (5.0 °C) OTL day 0 %: -50.0 to 5.0 °C (-15.0 °C) |

F Function block number, WE Default setting, Anl System code number

CO13: RK13 · Heating circuit 13

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|--------------------|----|-----|---|
| 01 | Room sensor | 0 | All | CO13 -> F01 - 1: Room sensor RF13; temperature reading active |
| 02 | Outdoor sensor | 0 | All | CO13 -> F02 - 1: Use of measured value AF1; outdoor-temperature-compensated control active |
| 03 | Return flow sensor | 1 | All | CO13 -> F03 - 1: Return flow sensor RÜF13; limitation function active Function block parameters: KP (limiting factor): 0.1 to 10.0 (1.0) |
| | | | | |

Annex A (configuration instructions)



| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|---------------------------|----|-----|---|
| 05 | Underfloor heating | 0 | All | CO13 -> F05 - 1: Underfloor heating/drying of jointless floors Function block parameters: Boost: 0.0 to 50.0 °C (0.0 °C) Start temperature: 20 to 60 °C (25 °C) Hold (days): 0 to 10 days (0 days) Temp. rise/day: 0.0 to 20.0 °C (5.0 °C) Maximum temperature: 25.0 to 60.0 °C (45.0 °C) Hold (days): 0 to 30 days (4 days) Temp. reduction/day: 0.0 to 20.0 °C (0.0 °C) Start condition: Stop, Start, Hold, Reduction |
| 07 | Optimization | 0 | All | CO13 -> F07 - 1: Optimization of heating times (only when CO13 > F01 - 1 and CO13 -> F02 - 1) |
| 08 | Adaptation | 0 | All | CO13 -> F08 - 1: Heating characteristic adaptation (only when CO13 -> F01 - 1, CO13 -> F02 - 1 and CO13 -> F11 - 0) |
| 09 | Flash adaptation | 0 | All | CO13 -> F09 - 1: Flash adaptation of flow temperature (only when CO13 -> F01 - 1) Function block parameters: Cycle time: 0 or 1 to 100 min (20 min) KP (gain): 0.0 to 25.0 (0.0) |
| 11 | Four-point characteristic | 0 | All | CO13 -> F11 - 1: Four-point characteristic (only when CO13 -> F08 - 0) CO13 -> F11 - 0: Gradient characteristic |
| 12 | Three-step control mode | 1 | All | CO13 -> F12 - 1: Three-step control Function block parameters: KP (gain): 0.1 to 50.0 (2.0) Tn (reset time): 1 to 999 s (120 s) TV (derivative-action time): 0 to 999 s (0 s) TY (valve transit time): 15, 20, 25, ..., 240 s (35 s) CO13 -> F12 - 0: On/off control Function block parameters: Hysteresis: 1.0 to 30.0 °C (5.0 °C) Min. ON time: 0 to 10 min (2 min) Min. OFF time: 0 to 10 min (2 min) |
| 13 | Damping | 0 | All | CO13 -> F13 - 1: OPEN signal damping (only when CO11 -> F12 - 1) Function block parameters: Max. system deviation: 3.0 to 10.0 °C (3.0 °C) |
| | | | | |

| F | Function | WE | Anl | Comments Function block parameters: value range (default setting) |
|----|-------------------------|----|-----|---|
| 28 | Variable night set-back | 0 | All | CO13 -> F28 - 1: variable night set-back (only when CO13 -> F11 - 0) Function block parameters: OTL night 100 %: -50.0 to 20.0 °C (5.0 °C) OTL day 0 %: -50.0 to 5.0 °C (-15.0 °C) |





F Function block number, WE Default setting, Anl System code number











16.7 Parameter lists

PA1: Heating circuit HC1

| P | Reading | Parameter: Value range (default setting) |
|----|---|--|
| 01 | P01  1.2 | Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO1 -> F05 - 1 |
| 02 | P02  0.0°C | Level (parallel shift): -30.0 to 30.0 °C (0.0 °C) |
| 03 | P03 50.0°C | Flow set point (day) (only when CO1 -> F02 - 0 and CO1 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C) |
| 04 | P04 30.0°C | Flow set point (night) (only when CO1 -> F02 - 0 and CO1 -> F09 - 1): -5.0 to 150.0 °C (30.0 °C) |





Annex A (configuration instructions)

| P | Reading | Parameter: Value range (default setting) | | | | | | | | | | | | | | | | | | | | |
|----|--|---|------|-----|----|-----|---|------|------|-----|-----|---|------|------|------|-----|--|-----|-----|-----|-----|---|
| 05 |  <table border="1" data-bbox="106 295 397 446"> <tr> <td>↑</td> <td>-15°</td> <td>-5°</td> <td>5°</td> <td>15°</td> </tr> <tr> <td>▢</td> <td>70°</td> <td>55°</td> <td>40°</td> <td>25°</td> </tr> <tr> <td>▢</td> <td>60°</td> <td>40°</td> <td>20°</td> <td>20°</td> </tr> <tr> <td>↻</td> <td>65°</td> <td>65°</td> <td>65°</td> <td>65°</td> </tr> </table> | ↑ | -15° | -5° | 5° | 15° | ▢ | 70° | 55° | 40° | 25° | ▢ | 60° | 40° | 20° | 20° | ↻ | 65° | 65° | 65° | 65° | <p>Four-point characteristic</p> <p>Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) -50.0 to 50.0 °C (5.0 °C, 15.0 °C, 25.0 °C, 35.0 °C) ¹⁾</p> <p>Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) -5.0 to 150.0 °C (20.0 °C, 15.0 °C, 10.0 °C, 5.0 °C) ¹⁾</p> <p>Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) -5.0 to 150.0 °C (30.0 °C, 25.0 °C, 20.0 °C, 15.0 °C) ¹⁾</p> <p>Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C)</p> |
| ↑ | -15° | -5° | 5° | 15° | | | | | | | | | | | | | | | | | | |
| ▢ | 70° | 55° | 40° | 25° | | | | | | | | | | | | | | | | | | |
| ▢ | 60° | 40° | 20° | 20° | | | | | | | | | | | | | | | | | | |
| ↻ | 65° | 65° | 65° | 65° | | | | | | | | | | | | | | | | | | |
| | <table border="1" data-bbox="106 638 397 766"> <tr> <td>↑</td> <td>-15°</td> <td>-5°</td> <td>5°</td> <td>15°</td> </tr> <tr> <td>▢</td> <td>0.00</td> <td>0.00</td> <td></td> <td></td> </tr> <tr> <td>↻</td> <td>0.00</td> <td>0.00</td> <td>m³/h</td> <td></td> </tr> </table> | ↑ | -15° | -5° | 5° | 15° | ▢ | 0.00 | 0.00 | | | ↻ | 0.00 | 0.00 | m³/h | | <p>Flow rate: 0.01 to 650 m³/h (0.00 m³/h, 0.00 m³/h, 0.00 m³/h, 0.00 m³/h)</p> | | | | | |
| ↑ | -15° | -5° | 5° | 15° | | | | | | | | | | | | | | | | | | |
| ▢ | 0.00 | 0.00 | | | | | | | | | | | | | | | | | | | | |
| ↻ | 0.00 | 0.00 | m³/h | | | | | | | | | | | | | | | | | | | |
| | <table border="1" data-bbox="106 790 397 925"> <tr> <td>↑</td> <td>-15°</td> <td>-5°</td> <td>5°</td> <td>15°</td> </tr> <tr> <td>▢</td> <td>0.0</td> <td>0.0</td> <td></td> <td></td> </tr> <tr> <td>P</td> <td>0.0</td> <td>0.0</td> <td>kw</td> <td></td> </tr> </table> | ↑ | -15° | -5° | 5° | 15° | ▢ | 0.0 | 0.0 | | | P | 0.0 | 0.0 | kw | | <p>Capacity: 0.1 to 6500 kW (with CO6 -> F12 - 1) or 1 to 800 pulse/h (with CO5 -> F10 - 1) (0.0 kW, 0.0 kW, 0.0 kW, 0.0 kW) or (0.0 pulse/h, 0.0 pulse/h, 0.0 pulse/h, 0.0 pulse/h)</p> | | | | | |
| ↑ | -15° | -5° | 5° | 15° | | | | | | | | | | | | | | | | | | |
| ▢ | 0.0 | 0.0 | | | | | | | | | | | | | | | | | | | | |
| P | 0.0 | 0.0 | kw | | | | | | | | | | | | | | | | | | | |
| 06 |  20.0°C | <p>Min. flow temperature: -5.0 to 150.0 °C (20.0 °C)</p> | | | | | | | | | | | | | | | | | | | | |
| 07 |  70.0°C | <p>Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO1 -> F05 - 1</p> | | | | | | | | | | | | | | | | | | | | |
| 09 |  -15.0°C | <p>Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C)</p> | | | | | | | | | | | | | | | | | | | | |

| P | Reading | Parameter: Value range (default setting) |
|----|---|--|
| 10 |  40.0°C | Minimum flow temperature set point HC for binary demand processing: 5.0 to 150.0 °C (40.0 °C) |
| 11 |  1.2 | Return flow gradient (only when CO1 -> F03 - 1): 0.2 to 3.2 (1.2) |
| 12 |  0.0°C | Return flow level (only when CO1 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C) |
| 13 |  65.0°C | Base point for return flow temperature (only when CO1 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C) |
| 14 |  65.0°C | Max. return flow temperature (only when CO1 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C) |
| 15 |  5.0°C | Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C) |
| 16 |  AUTO | Minimum set point to charge buffer tank: AUTO to 90.0 °C (AUTO) |
| 17 |  AUTO | Stop charging of the buffer tank: AUTO to 90.0 °C (AUTO) |
| 18 |  6.0°C | Charging temperature boost: 0.0 to 50.0 °C (6.0 °C) |
| 19 |  1.0 | Lag time of charging pump 0.0 to 10.0 (1.0) |

1) With cooling control with or without outdoor sensor

PA2: Heating circuit HC2























| P | Reading | Parameter: Value range (default setting) |
|----|---|---|
| 01 |  1.2 | Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO2 -> F05 - 1 |
| 02 |  0.0°C | Level (parallel shift): -30.0 to 30.0 °C (0.0 °C) |
| 03 |  50.0°C | Flow set point (day) (only when CO2 -> F02 - 0 and CO2 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C) |
| 04 |  30.0°C | Flow set point (night) (only with CO2 -> F02 - 0 and CO2 > F09 - 1): -5.0 to 150.0 °C (30.0 °C) |

Annex A (configuration instructions)


| P | Reading | Parameter: Value range (default setting) | | | | | | | | | | | | | | | | | | | | |
|----|---|---|------|-----|----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|--|
| 05 | <table border="1"> <tr> <td>↓</td> <td>-15°</td> <td>-5°</td> <td>5°</td> <td>15°</td> </tr> <tr> <td>▨</td> <td>70°</td> <td>55°</td> <td>40°</td> <td>25°</td> </tr> <tr> <td>▨</td> <td>60°</td> <td>40°</td> <td>20°</td> <td>20°</td> </tr> <tr> <td>↕</td> <td>65°</td> <td>65°</td> <td>65°</td> <td>65°</td> </tr> </table> | ↓ | -15° | -5° | 5° | 15° | ▨ | 70° | 55° | 40° | 25° | ▨ | 60° | 40° | 20° | 20° | ↕ | 65° | 65° | 65° | 65° | Four-point characteristic Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) -50.0 to 50.0 °C (5.0 °C, 15.0 °C, 25.0 °C, 35.0 °C) ¹⁾ Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) -5.0 to 150.0 °C (20.0 °C, 15.0 °C, 10.0 °C, 5.0 °C) ¹⁾ Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) -5.0 to 150.0 °C (30.0 °C, 25.0 °C, 20.0 °C, 15.0 °C) ¹⁾ Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C) |
| ↓ | -15° | -5° | 5° | 15° | | | | | | | | | | | | | | | | | | |
| ▨ | 70° | 55° | 40° | 25° | | | | | | | | | | | | | | | | | | |
| ▨ | 60° | 40° | 20° | 20° | | | | | | | | | | | | | | | | | | |
| ↕ | 65° | 65° | 65° | 65° | | | | | | | | | | | | | | | | | | |
| 06 | 20.0°C | Min. flow temperature: -5.0 to 150.0 °C (20.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 07 | 70.0°C | Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO2 -> F05 - 1 | | | | | | | | | | | | | | | | | | | | |
| 09 | -15.0°C | Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C) | | | | | | | | | | | | | | | | | | | | |
| 11 | 1.2 | Return flow gradient (only when CO2 -> F03 - 1): 0.2 to 3.2 (1.2) | | | | | | | | | | | | | | | | | | | | |
| 12 | 0.0°C | Return flow level (only when CO2 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 13 | 65.0°C | Base point for return flow temperature (only when CO2 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 14 | 65.0°C | Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 15 | 5.0°C | Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C) | | | | | | | | | | | | | | | | | | | | |

¹⁾ With cooling control with or without outdoor sensor

PA3: Heating circuit HC3











| P | Reading | Parameter: Value range (default setting) | | | | | | | | | | | | | | | | | | | | |
|---|--|---|------|-----|----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|---|
| 01 | P01  1.2 | Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO3 -> F05 - 1 | | | | | | | | | | | | | | | | | | | | |
| 02 | P02  0.0°C | Level (parallel shift): -30.0 to 30.0 °C (0.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 03 | P03 50.0°C | Flow set point (day) (only when CO3 -> F02 - 0 and CO3 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 04 | P04 30.0°C | Flow set point (night) (only with CO3 -> F02 - 0 and CO3 > F09 - 1): -5.0 to 150.0 °C (30.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 05 | P05  <table border="1" data-bbox="165 593 456 737"> <tr> <td></td> <td>-15°</td> <td>-5°</td> <td>5°</td> <td>15°</td> </tr> <tr> <td></td> <td>70°</td> <td>55°</td> <td>40°</td> <td>25°</td> </tr> <tr> <td></td> <td>60°</td> <td>40°</td> <td>20°</td> <td>20°</td> </tr> <tr> <td></td> <td>65°</td> <td>65°</td> <td>65°</td> <td>65°</td> </tr> </table> |  | -15° | -5° | 5° | 15° |  | 70° | 55° | 40° | 25° |  | 60° | 40° | 20° | 20° |  | 65° | 65° | 65° | 65° | Four-point characteristic Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) -50.0 to 50.0 °C (5.0 °C, 15.0 °C, 25.0 °C, 35.0 °C) ¹⁾ Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) -5.0 to 150.0 °C (20.0 °C, 15.0 °C, 10.0 °C, 5.0 °C) ¹⁾ Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) -5.0 to 150.0 °C (30.0 °C, 25.0 °C, 20.0 °C, 15.0 °C) ¹⁾ Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C) |
|  | -15° | -5° | 5° | 15° | | | | | | | | | | | | | | | | | | |
|  | 70° | 55° | 40° | 25° | | | | | | | | | | | | | | | | | | |
|  | 60° | 40° | 20° | 20° | | | | | | | | | | | | | | | | | | |
|  | 65° | 65° | 65° | 65° | | | | | | | | | | | | | | | | | | |
| 06 | P06  20.0°C | Min. flow temperature: -5.0 to 150.0 °C (20.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 07 | P07  70.0°C | Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO3 -> F05 - 1 | | | | | | | | | | | | | | | | | | | | |
| 09 | P09  -15.0°C | Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C) | | | | | | | | | | | | | | | | | | | | |
| 11 | P11  1.2 | Return flow gradient (only when CO3 -> F03 - 1): 0.2 to 3.2 (1.2) | | | | | | | | | | | | | | | | | | | | |
| 12 | P12  0.0°C | Return flow level (only when CO3 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 13 | P13  65.0°C | Base point for return flow temperature (only when CO3 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 14 | P14  65.0°C | Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C) | | | | | | | | | | | | | | | | | | | | |

Annex A (configuration instructions)



| P | Reading | Parameter: Value range (default setting) |
|----|---|---|
| 15 | P15  5.0°C | Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C) |

1) Cooling control with outdoor sensor



PA4: Domestic hot water heating (DHW)

| P | Reading | Parameter: Value range (default setting) |
|----|--|--|
| 01 | P01  40.0°C | Min. adjustable DHW set point: 5.0 to 90.0 °C (40.0 °C) |
| 02 | P02  60.0°C | Max. adjustable DHW set point: 5.0 to 90.0 °C (90.0 °C) |
| 03 | P03  5.0°C | Hysteresis: 1.0 to 30.0 °C (5.0 °C) |
| 04 | P04  10.0°C | Charging temperature boost: 0.0 to 50.0 °C (10.0 °C) |
| 05 | P05 80.0°C | Max. charging temperature (only when CO4 -> F05 - 1): 20.0 to 150.0 °C (80.0 °C) |
| 07 | P07 65.0°C | Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C) |
| 10 | P10  10.0°C | Solar circuit pump ON: 1.0 to 30.0 °C (10.0 °C) |
| 11 | P11  3.0°C | Solar circuit pump OFF: 0.0 to 30.0 °C (3.0 °C) |
| 12 | P12 80.0°C | Max. storage tank temperature: 20.0 to 90.0 °C (80.0 °C) |
| 13 | P13  80.0°C | Maximum buffer tank temperature: 20.0 to 90.0 °C (80.0 °C) |
| 14 | P14  100% | Control signal DHW for storage tank charging: 5 to 100 % (100 %) |
| 19 | P19  1.0 | Lag time for storage tank charging pump (= Valve transit time x P19): 0.0 to 10.0 (1.0) |
| 21 | P21  25.0°C | Return flow temperature limit, layering at top: 5.0 to 90.0 °C (25.0 °C) |
















PA5: System-wide parameters

| P | Reading | Parameter: Value range (default setting) |
|----|--|--|
| 01 | P01  60.0°C | Start temperature for boiler pump (only systems Anl 14.1, 14.2, 15.1, 15.2, 16.2, 16.4, 16.5, 16.7): 20.0 to 90.0 °C (60.0 °C) |
| 02 | P02  5.0°C | Boiler pump hysteresis (only system Anl 14.1, 14.2, 15.1, 15.2, 16.2, 16.4, 16.5, 16.7): 0.0 to 30.0 °C (5.0 °C) |












PA6: Modbus

| P | Reading | Parameter: Value range (default setting) |
|----|---|---|
| 01 | P01  1 | Modbus station address (8 bit): 1 to 246 (255) 1 to 3200 (255) with CO6 > F02 - 1 |
| 02 | P02  19200 | Modbus Baud rate: 9600, 19200 (19200) (only when CO6 -> F01 - 1 and CO7 -> F01 - 0) |



PA11: Heating circuit HC11











| P | Reading | Parameter: Value range (default setting) | | | | | | | | | | | | | | | | | | | | |
|---|---|---|------|-----|----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|--|
| 01 | P01  1.2 | Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO11 -> F05 - 1 | | | | | | | | | | | | | | | | | | | | |
| 02 | P02  0.0°C | Level (parallel shift): -30.0 to 30.0 °C (0.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 03 | P03 50.0°C | Flow set point (day) (only when CO11 -> F02 - 0 and CO11 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 04 | P04 30.0°C | Flow set point (night) (only with CO11 -> F02 - 0 and CO11 > F09 - 1): -5.0 to 150.0 °C (30.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 05 | P05  | Four-point characteristic | | | | | | | | | | | | | | | | | | | | |
| | <table border="1"> <tr> <td></td> <td>-15°</td> <td>-5°</td> <td>5°</td> <td>15°</td> </tr> <tr> <td></td> <td>70°</td> <td>55°</td> <td>40°</td> <td>25°</td> </tr> <tr> <td></td> <td>60°</td> <td>40°</td> <td>20°</td> <td>20°</td> </tr> <tr> <td></td> <td>65°</td> <td>65°</td> <td>65°</td> <td>65°</td> </tr> </table> |  | -15° | -5° | 5° | 15° |  | 70° | 55° | 40° | 25° |  | 60° | 40° | 20° | 20° |  | 65° | 65° | 65° | 65° | Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C) |
|  | -15° | -5° | 5° | 15° | | | | | | | | | | | | | | | | | | |
|  | 70° | 55° | 40° | 25° | | | | | | | | | | | | | | | | | | |
|  | 60° | 40° | 20° | 20° | | | | | | | | | | | | | | | | | | |
|  | 65° | 65° | 65° | 65° | | | | | | | | | | | | | | | | | | |

Annex A (configuration instructions)



| P | Reading | Parameter: Value range (default setting) |
|----|---|--|
| 06 | P06   20.0°C | Min. flow temperature: -5.0 to 150.0 °C (20.0 °C) |
| 07 | P07   90.0°C | Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO11 -> F05 - 1 |
| 09 | P09   -15.0°C | Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C) |
| 11 | P11  1.2 | Return flow gradient (only when CO11 -> F03 - 1): 0.2 to 3.2 (1.2) |
| 12 | P12  0.0°C | Return flow level (only when CO11 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C) |
| 13 | P13  65.0°C | Base point for return flow temperature (only when CO11 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C) |
| 14 | P14  65.0°C | Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C) |
| 15 | P15  5.0°C | Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C) |

PA12: Heating circuit HC12






















| P | Reading | Parameter: Value range (default setting) |
|----|---|---|
| 01 | P01  1.2 | Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO12 -> F05 - 1 |
| 02 | P02  0.0°C | Level (parallel shift): -30.0 to 30.0 °C (0.0 °C) |
| 03 | P03 50.0°C | Flow set point (day) (only when CO12 -> F02 - 0 and CO12 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C) |
| 04 | P04 30.0°C | Flow set point (night) (only with CO12 -> F02 - 0 and CO12 > F09 - 1): -5.0 to 150.0 °C (30.0 °C) |

| P | Reading | Parameter: Value range (default setting) |
|----|--|---|
| 05 |   | Four-point characteristic Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C) |
| 06 |  20.0°C | Min. flow temperature: -5.0 to 150.0 °C (20.0 °C) |
| 07 |  90.0°C | Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO12 -> F05 - 1 |
| 09 |  -15.0°C | Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C) |
| 11 |  1.2 | Return flow gradient (only when CO12 -> F03 - 1): 0.2 to 3.2 (1.2) |
| 12 |  0.0°C | Return flow level (only when CO12 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C) |
| 13 |  65.0°C | Base point for return flow temperature (only when CO12 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C) |
| 14 |  65.0°C | Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C) |
| 15 |  5.0°C | Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C) |

PA13: Heating circuit HC13

| P | Reading | Parameter: Value range (default setting) |
|----|--|---|
| 01 |  1.2 | Flow gradient: 0.2 to 3.2 (1.2) 0.2 to 1.0 (0.5) with CO13 -> F05 - 1 |
| 02 |  0.0°C | Level (parallel shift): -30.0 to 30.0 °C (0.0 °C) |

Annex A (configuration instructions)

| P | Reading | Parameter: Value range (default setting) | | | | | | | | | | | | | | | | | | | | |
|---|---|--|------|-----|----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|---|-----|-----|-----|-----|--|
| 03 | P03 50.0°C | Flow set point (day) (only when CO13 -> F02 - 0 and CO13 -> F09 - 1): -5.0 to 150.0 °C (50.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 04 | P04 30.0°C | Flow set point (night) (only with CO13 -> F02 - 0 and CO13 > F09 - 1): -5.0 to 150.0 °C (30.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 05 | P05  | Four-point characteristic | | | | | | | | | | | | | | | | | | | | |
| | <table border="1"> <tr> <td></td> <td>-15°</td> <td>-5°</td> <td>5°</td> <td>15°</td> </tr> <tr> <td></td> <td>70°</td> <td>55°</td> <td>40°</td> <td>25°</td> </tr> <tr> <td></td> <td>60°</td> <td>40°</td> <td>20°</td> <td>20°</td> </tr> <tr> <td></td> <td>65°</td> <td>65°</td> <td>65°</td> <td>65°</td> </tr> </table> |  | -15° | -5° | 5° | 15° |  | 70° | 55° | 40° | 25° |  | 60° | 40° | 20° | 20° |  | 65° | 65° | 65° | 65° | Outdoor temperature: -50.0 to 50.0 °C (-15.0 °C, -5.0 °C, 5.0 °C, 15.0 °C) Flow temperature: -5.0 to 150.0 °C (70.0 °C, 55.0 °C, 40.0 °C, 25.0 °C) Reduced flow temperature: -5.0 to 150.0 °C (60.0 °C, 40.0 °C, 20.0 °C, 20.0 °C) Return flow temperature: 5.0 to 90.0 °C (65.0 °C, 65.0 °C, 65.0 °C, 65.0 °C) |
|  | -15° | -5° | 5° | 15° | | | | | | | | | | | | | | | | | | |
|  | 70° | 55° | 40° | 25° | | | | | | | | | | | | | | | | | | |
|  | 60° | 40° | 20° | 20° | | | | | | | | | | | | | | | | | | |
|  | 65° | 65° | 65° | 65° | | | | | | | | | | | | | | | | | | |
| 06 | P06  20.0°C | Min. flow temperature: -5.0 to 150.0 °C (20.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 07 | P07  90.0°C | Max. flow temperature: 5.0 to 150.0 °C (70.0 °C) 5.0 to 50.0 °C (50.0 °C) when CO13 -> F05 - 1 | | | | | | | | | | | | | | | | | | | | |
| 09 | P09  -15.0°C | Outdoor temperature for continuous day mode: -50.0 to 5.0 °C (-15 °C) | | | | | | | | | | | | | | | | | | | | |
| 11 | P11  1.2 | Return flow gradient (only when CO13 -> F03 - 1): 0.2 to 3.2 (1.2) | | | | | | | | | | | | | | | | | | | | |
| 12 | P12  0.0°C | Return flow level (only when CO13 -> F03 - 1): -30.0 to 30.0 °C (0.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 13 | P13  65.0°C | Base point for return flow temperature (only when CO13 -> F03 - 1): 5.0 to 90.0 °C (65.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 14 | P14  65.0°C | Max. return flow temperature: 5.0 to 90.0 °C (65.0 °C) | | | | | | | | | | | | | | | | | | | | |
| 15 | P15  5.0°C | Set point boost (pre-control circuit): 0.0 to 50.0 °C (5.0 °C) | | | | | | | | | | | | | | | | | | | | |

16.8 Customer-specific data

| | |
|--------------------|--|
| Station | |
| Operator | |
| SAMSON office | |
| System code number | |

Function block settings in configuration levels

| | CO1 | CO2 | CO3 | CO4 | CO5 | CO6 | CO7 | CO8 | CO11 | CO12 | CO13 |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|------|
| F01 | | | | | | | | | | | |
| F02 | | | | | | | | | | | |
| F03 | | | | | | | | | | | |
| F04 | | | | | | | | | | | |
| F05 | | | | | | | | | | | |
| F06 | | | | | | | | | | | |
| F07 | | | | | | | | | | | |
| F08 | | | | | | | | | | | |
| F09 | | | | | | | | | | | |
| F10 | | | | | | | | | | | |
| F11 | | | | | | | | | | | |
| F12 | | | | | | | | | | | |
| F13 | | | | | | | | | | | |
| F14 | | | | | | | | | | | |
| F15 | | | | | | | | | | | |
| F16 | | | | | | | | | | | |
| F17 | | | | | | | | | | | |
| F18 | | | | | | | | | | | |
| F19 | | | | | | | | | | | |
| F20 | | | | | | | | | | | |
| F21 | | | | | | | | | | | |
| F22 | | | | | | | | | | | |
| F23 | | | | | | | | | | | |
| F24 | | | | | | | | | | | |
| F25 | | | | | | | | | | | |
| F26 | | | | | | | | | | | |
| F27 | | | | | | | | | | | |

| | CO1 | CO2 | CO3 | CO4 | CO5 | CO6 | CO7 | CO8 | CO11 | CO12 | CO13 |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|------|
| F28 | | | | | | | | | | | |
| F31 | | | | | | | | | | | |
| F32 | | | | | | | | | | | |
| F33 | | | | | | | | | | | |
| F34 | | | | | | | | | | | |
| F35 | | | | | | | | | | | |
| F36 | | | | | | | | | | | |
| F37 | | | | | | | | | | | |

Settings at the rotary switch · Set points

| Parameters | Switch position ↓☀ | Value range |
|----------------------------|--------------------|---------------------------------|
| HC1 room temperature | | 0.0 to 40.0 °C |
| HC2 room temperature | | |
| HC3 room temperature | | |
| HC11 room temperature | | |
| HC12 room temperature | | |
| HC13 room temperature | | |
| DHW temperature | | Min. to max. DHW temperature |
| HC1 OT deactivation value | | -50.0 to +50.0 °C |
| HC2 OT deactivation value | | |
| HC3 OT deactivation value | | |
| HC11 OT deactivation value | | |
| HC12 OT deactivation value | | |
| HC13 OT deactivation value | | |

| Parameters | Switch position ↓☾ | Value range |
|-----------------------|--------------------|----------------|
| HC1 room temperature | | 0.0 to 40.0 °C |
| HC2 room temperature | | |
| HC3 room temperature | | |
| HC11 room temperature | | |
| HC12 room temperature | | |
| HC13 room temperature | | |

Annex A (configuration instructions)

| Parameters | Switch position ↓ ⌋ | Value range |
|----------------------------|---------------------|---------------------------------|
| DHW temperature | | Min. to max. DHW temperature |
| HC1 OT deactivation value | | -50.0 to +50.0 °C |
| HC2 OT deactivation value | | |
| HC3 OT deactivation value | | |
| HC11 OT deactivation value | | |
| HC12 OT deactivation value | | |
| HC13 OT deactivation value | | |

Settings at the rotary switch · Times-of-use · Switch position

| Times-of-use HC1 | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
|--------------------------|-----|-----|-----|-----|-----|-----|-----|------------------|
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |

| Times-of-use HC2 | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
|--------------------------|-----|-----|-----|-----|-----|-----|-----|------------------|
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |

| Times-of-use HC3 | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
|--------------------------|-----|-----|-----|-----|-----|-----|-----|------------------|
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |

| | | | | | | | | |
|--------------------------|------------|------------|------------|------------|------------|------------|------------|--------------------|
| Times-of-use HC11 | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |
| Times-of-use HC12 | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |
| Times-of-use HC13 | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |
| Times-of-use DHW | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |

Annex A (configuration instructions)

| Times-of-use ZP | Mon | Tue | Wed | Thu | Fri | Sat | Sun | Value range |
|--------------------------|-----|-----|-----|-----|-----|-----|-----|------------------|
| Start first time-of-use | | | | | | | | 00:00 to 24:00 h |
| Stop first time-of-use | | | | | | | | |
| Start second time-of-use | | | | | | | | |
| Stop second time-of-use | | | | | | | | |
| Start third time-of-use | | | | | | | | |
| Stop third time-of-use | | | | | | | | |

PA1 parameters (heating circuit HC1), PA2 parameters (heating circuit HC2) and PA3 parameters (heating circuit HC3)

| P | Parameters | PA1 (HC1) | PA2 (HC2) | PA3 (HC3) | Value range |
|----|-----------------------------------|-----------|-----------|-----------|-------------------------------|
| 01 | Flow gradient | | | | 0.2 to 3.2 |
| 02 | Level (parallel shift) | | | | -30.0 to +30.0 °C |
| 03 | Flow set point (day) | | | | -5.0 to +150.0 °C |
| 04 | Flow set point (night) | | | | -5.0 to +150.0 °C |
| 05 | Four-point characteristic | | | | |
| | Outdoor temperature, point 1 | | | | -50.0 to +50.0 °C |
| | Outdoor temperature, point 2 | | | | -50.0 to +50.0 °C |
| | Outdoor temperature, point 3 | | | | -50.0 to +50.0 °C |
| | Outdoor temperature, point 4 | | | | -50.0 to +50.0 °C |
| | Flow temperature, point 1 | | | | -5.0 to +150.0 °C |
| | Flow temperature, point 2 | | | | -5.0 to +150.0 °C |
| | Flow temperature, point 3 | | | | -5.0 to +150.0 °C |
| | Flow temperature, point 4 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 1 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 2 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 3 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 4 | | | | -5.0 to +150.0 °C |
| | Return flow temperature, point 1 | | | | 5.0 to 90.0 °C |
| | Return flow temperature, point 2 | | | | 5.0 to 90.0 °C |
| | Return flow temperature, point 3 | | | | 5.0 to 90.0 °C |
| | Return flow temperature, point 4 | | | | 5.0 to 90.0 °C |
| | Flow rate, point 1 | | - | - | 0.01 to 650 m ³ /h |
| | Flow rate, point 2 | | - | - | 0.01 to 650 m ³ /h |
| | Flow rate, point 3 | | - | - | 0.01 to 650 m ³ /h |
| | Flow rate, point 4 | | - | - | 0.01 to 650 m ³ /h |

| P | Parameters | PA1 (HC1) | PA2 (HC2) | PA3 (HC3) | Value range |
|----|--|--------------|--------------|--------------|---|
| 05 | Capacity, point 1 | | – | – | 0.1 to 6500 kW or 1 to 800 pulses/h |
| | Capacity, point 2 | | – | – | |
| | Capacity, point 3 | | – | – | |
| | Capacity, point 4 | | – | – | |
| 06 | Min. flow temperature | | | | –5.0 to +150.0 °C |
| 07 | Max. flow temperature | | | | –5.0 to +150.0 °C |
| 09 | Outdoor temperature for continuous day mode | | | | –50.0 to +5.0 °C |
| 10 | Minimum flow temperature set point HC for binary demand processing | | | | 5.0 to 150.0 °C |
| 11 | Return flow gradient | | | | 0.2 to 3.2 |
| 12 | Return flow level | | | | –30.0 to +30.0 °C |
| 13 | Base point for return flow temperature: | | | | 5.0 to 90.0 °C |
| 14 | Max. return flow temperature | | | | 5.0 to 90.0 °C |
| 15 | Set point boost (pre-control circuit) | | | | 0.0 to 50.0 °C |
| 16 | Minimum set point to charge buffer tank | | – | – | AUTO to 90.0 °C |
| 17 | Stop charging of the buffer tank | | – | – | AUTO to 90.0 °C |
| 18 | Charging temperature boost | | – | – | 0.0 to 50.0 °C |
| 19 | Lag time of charging pump | | – | – | 0.0 to 10.0 |

PA11 parameters (heating circuit HC11), PA12 parameters (heating circuit HC12) and PA13 parameters (heating circuit HC13)

| P | Parameters | PA11 (HC11) | PA12 (HC12) | PA13 (HC13) | Value range |
|----|------------------------|----------------|----------------|----------------|-------------------|
| 01 | Flow gradient | | | | 0.2 to 3.2 |
| 02 | Level (parallel shift) | | | | –30.0 to +30.0 °C |
| 03 | Flow set point (day) | | | | –5.0 to +150.0 °C |
| 04 | Flow set point (night) | | | | –5.0 to +150.0 °C |

Annex A (configuration instructions)

| P | Parameters | PA11 (HC11) | PA12 (HC12) | PA13 (HC13) | Value range |
|----|---|----------------|----------------|----------------|-------------------|
| 05 | Four-point characteristic | | | | |
| | Outdoor temperature, point 1 | | | | -50.0 to +50.0 °C |
| | Outdoor temperature, point 2 | | | | -50.0 to +50.0 °C |
| | Outdoor temperature, point 3 | | | | -50.0 to +50.0 °C |
| | Outdoor temperature, point 4 | | | | -50.0 to +50.0 °C |
| | Flow temperature, point 1 | | | | -5.0 to +150.0 °C |
| | Flow temperature, point 2 | | | | -5.0 to +150.0 °C |
| | Flow temperature, point 3 | | | | -5.0 to +150.0 °C |
| | Flow temperature, point 4 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 1 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 2 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 3 | | | | -5.0 to +150.0 °C |
| | Reduced flow temperature, point 4 | | | | -5.0 to +150.0 °C |
| | Return flow temperature, point 1 | | | | 5.0 to 90.0 °C |
| | Return flow temperature, point 2 | | | | 5.0 to 90.0 °C |
| | Return flow temperature, point 3 | | | | 5.0 to 90.0 °C |
| | Return flow temperature, point 4 | | | | 5.0 to 90.0 °C |
| 06 | Min. flow temperature | | | | -5.0 to +150.0 °C |
| 07 | Max. flow temperature | | | | -5.0 to +150.0 °C |
| 09 | Outdoor temperature for continuous day mode | | | | -50.0 to +5.0 °C |
| 11 | Return flow gradient | | | | 0.2 to 3.2 |
| 12 | Return flow level | | | | -30.0 to +30.0 °C |
| 13 | Base point for return flow temperature: | | | | 5.0 to 90.0 °C |
| 14 | Max. return flow temperature | | | | 5.0 to 90.0 °C |
| 15 | Set point boost (pre-control circuit) | | | | 0 to 50.0 °C |

CO1 function block parameters (heating circuit HC1), CO2 function block parameters (heating circuit HC2) and CO3 function block parameters (heating circuit HC3)

| F | Function block parameters | CO1 (HC1) | CO2 (HC2) | CO3 (HC3) | Value range |
|----|-----------------------------|-----------|-----------|-----------|-------------------------------|
| 03 | KP (limiting factor) | | | | 0.1 to 10.0 |
| 05 | Boost | | | | 0.0 to 50.0 °C |
| | Start temperature | | | | 20.0 to 60.0 °C |
| | Hold (days) | | | | 0 to 10 days |
| | Temp. rise/day | | | | 0.0 to 10.0 °C |
| | Maximum temperature | | | | 25.0 to 60.0 °C |
| | Hold (days) | | | | 0 to 30 days |
| | Temp. reduction/day | | | | 0.0 to 10.0 °C |
| | Start condition | | | | Stop, Start, Hold, Reduction |
| 09 | Cycle time | | | | 0 to 100 min |
| | KP (gain) | | | | 0.0 to 25.0 |
| 12 | KP (gain) | | | | 0.1 to 50.0 |
| | Tn (reset time) | | | | 1 to 999 s |
| | TV (derivative-action time) | | | | 0 to 999 s |
| | TY (valve transit time) | | | | 15 to 240 s |
| | Hysteresis | | | | 1.0 to 30.0 °C |
| | Min. ON time | | | | 0 to 10 min |
| | Min. OFF time | | | | 0 to 10 min |
| 13 | Max. system deviation | | | | 3.0 to 10.0 °C |
| 14 | Active when BI = | | | | ON, OFF |
| 16 | Analog input | | | | 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 |
| 17 | Active when BI = | | - | - | ON, OFF |
| 18 | Lower transmission range | | - | - | 0.0 to 150.0 °C |
| | Upper transmission range | | - | - | 0.0 to 150.0 °C |
| | Boost | | - | - | 0.0 to 30.0 °C |
| 21 | Start speed reduction | | - | - | 5.0 to 90.0 °C |
| | Stop speed reduction | | - | - | 5.0 to 90.0 °C |
| | Minimum speed | | - | - | 0 to 50 % to 50 % |

Annex A (configuration instructions)

| F | Function block parameters | CO1 (HC1) | CO2 (HC2) | CO3 (HC3) | Value range |
|----|---|--------------|--------------|--------------|-------------------|
| 23 | Set point of differential temperature control | | – | – | 0.0 to 50.0 °C |
| | KP (influence factor) | | – | – | 0.1 to 10.0 |
| | Minimum speed | | – | – | 0 to 100 % |
| 28 | OTL night 100 % | | | | –50.0 to +20.0 °C |
| | OTL day 0 % | | | | –50.0 to +5.0 °C |

CO11 function block parameters (heating circuit HC11), CO12 function block parameters (heating circuit HC12) and CO13 function block parameters (heating circuit HC13)

| F | Function block parameters | CO11 (HC11) | CO12 (HC12) | CO13 (HC13) | Value range |
|----|-----------------------------|----------------|----------------|----------------|------------------------------|
| 03 | KP (limiting factor) | | | | 0.1 to 10.0 |
| 05 | Boost | | | | 0.0 to 50.0 °C |
| | Start temperature | | | | 20.0 to 60.0 °C |
| | Hold (days) | | | | 0 to 10 days |
| | Temp. rise/day | | | | 0.0 to 10.0 °C |
| | Maximum temperature | | | | 25.0 to 60.0 °C |
| | Hold (days) | | | | 0 to 30 days |
| | Temp. reduction/day | | | | 0.0 to 10.0 °C |
| | Start condition | | | | Stop, Start, Hold, Reduction |
| 09 | Cycle time | | | | 0 to 100 min |
| | KP (gain) | | | | 0.0 to 25.0 |
| 12 | KP (gain) | | | | 0.1 to 50.0 |
| | Tn (reset time) | | | | 1 to 999 s |
| | TV (derivative-action time) | | | | 0 to 999 s |
| | TY (valve transit time) | | | | 15 to 240 s |
| | Hysteresis | | | | 1.0 to 30.0 °C |
| | Min. ON time | | | | 0 to 10 min |
| | Min. OFF time | | | | 0 to 10 min |
| 13 | Max. system deviation | | | | 3.0 to 10.0 °C |
| 28 | OTL night 100 % | | | | –50.0 to +20.0 °C |
| | OTL day 0 % | | | | –50.0 to +5.0 °C |

PA4 parameters (domestic hot water heating)

| P | Parameters | PA4 (DHW) | Value range |
|----|---|-----------|----------------------------------|
| 01 | Min. adjustable DHW set point | | 5.0 to 90.0 °C |
| 02 | Max. adjustable DHW set point | | 5.0 to 90.0 °C |
| 03 | Hysteresis | | 1.0 to 30.0 °C |
| 04 | Charging temperature boost | | 0.0 to 50.0 °C |
| 05 | Max. charging temperature | | 20.0 to 150.0 °C |
| 06 | Lag time for storage tank charging pump | | 0.0 to 10.0 x valve transit time |
| 07 | Max. return flow temperature | | 5.0 to 90.0 °C |
| 10 | Solar circuit pump ON | | 1.0 to 30.0 °C |
| 11 | Solar circuit pump OFF | | 0.0 to 90.0 °C |
| 12 | Max. storage tank temperature | | 20.0 to 90.0 °C |
| 19 | Lag time for storage tank charging pump | | 0.0 to 10 |

CO4 function block parameters (domestic hot water heating)

| F | Function block parameters | CO4 (DHW) | Value range |
|----|-----------------------------|-----------|---------------------------------|
| 03 | KP (limiting factor) | | 0.1 to 10.0 |
| 04 | Select | | Analog, binary |
| 06 | Cancel | | 0 to 10 min |
| | Temperature limit | | 20.0 to 90.0 °C |
| 08 | Start | | 0 to 10 min |
| | KP (influence factor) | | 0.1 to 10.0 |
| | Control circuit | | HC1, HC2, HC3, HC1+HC2, HC1+HC3 |
| 09 | Start | | 0 to 10 min |
| | Control circuit | | HC1, HC2, HC3, HC1+HC2, HC1+HC3 |
| 12 | Minimum speed | | 5 to 50 % |
| | KP (gain) | | 0.1 to 50.0 |
| | Tn (reset time) | | 1 to 999 s |
| | TV (derivative-action time) | | 0 to 999 s |
| | TY (valve transit time) | | 15 to 240 s |
| | Hysteresis | | 1.0 to 30.0 °C |
| | Min. ON time | | 0 to 10 min |
| | Min. OFF time | | 0 to 10 min |

Annex A (configuration instructions)

| F | Function block parameters | CO4 (DHW) | Value range |
|----|--|-----------|-------------------------|
| 13 | Max. system deviation | | 3.0 to 10.0 °C |
| 14 | Day of the week | | Monday to Sunday, daily |
| | Time | | Adjustable as required |
| | Disinfection temperature | | 60.0 to 90.0 °C |
| | Set point boost | | 0.0 to 50.0 °C |
| | Duration | | 0 to 255 min |
| | Active when BI = | | ON, OFF |
| 21 | Start speed reduction | | 5.0 to 90.0 °C |
| | Stop speed reduction | | 5.0 to 90.0 °C |
| | Minimum speed | | 0 to 50 % to 50 % |
| 22 | Valve position when cold charging protection is active | | 1 to 100 % |
| 25 | Return flow set point | | 5.0 to 90.0 °C |
| | KP (gain) | | 0.1 to 50.0 °C |
| | Tn (reset time) | | 30 to 2000 s |
| | Minimum speed | | 5 to 50 % |
| 26 | Sensor | | AF1 to SF3 |

PA5 parameters (system-wide parameters)

| P | Parameters | PA5 | Value range |
|----|-----------------------------------|-----|-----------------|
| 01 | Start temperature for boiler pump | | 20.0 to 90.0 °C |
| 02 | Boiler pump hysteresis | | 0.0 to 30.0 °C |

CO5 function block parameters (system-wide functions)

| F | Function block parameters | CO5 | Value range |
|----|-----------------------------|-----|------------------------|
| 04 | Date | | Adjustable as required |
| | No. days until activation | | 1 to 3 |
| | No. days until deactivation | | 1 to 3 |
| | Limit | | 0.0 to 30.0 °C |
| 05 | Delay/h | | 0.2 to 6.0 °C |
| 06 | Delay/h | | 0.2 to 6.0 °C |
| 07 | Relay contact | | NC contact, NO contact |
| 09 | Limit | | -15.0 to +3.0 °C |

| F | Function block parameters | CO5 | Value range |
|----|--|-----|--|
| 10 | Max. limit | | OT to 800 pulses/h |
| | Max. limit (heating) | | OT to 800 pulses/h |
| | Max. limit (DHW) | | 1 to 800 pulses/h |
| | Limiting factor | | 0.1 to 10.0 |
| 12 | Switching mode | | Binary, analog |
| | Active when BI = | | ON, OFF |
| 13 | Maximum buffer tank temperature | | 20.0 to 90.0 °C |
| 15 | Active when BI = | | ON, OFF |
| 21 | Return flow temperature limit, layering at top | | 5.0 to 90.0 °C |
| 23 | Direction | | Input, Output |
| | Lower transmission range | | -50.0 to +100.0 °C |
| | Upper transmission range | | -50.0 to +100.0 °C |
| 24 | Analog input | | 1, 2, 1+2, 3, 1+3, 2+3, 1+2+3 |
| 25 | Zero point | | 0 to 50 % to 50 % |
| 26 | Zero point | | 0 to 50 % to 50 % |
| 27 | Zero point | | 0 to 50 % to 50 % |
| 28 | Zero point | | 0 to 50 % to 50 % |
| 31 | Zero point | | 5 to 20 % |
| | Lower transmission range | | 0 to 150 °C |
| | Upper transmission range | | 0 to 150 °C |
| 32 | Zero point | | 5 to 20 % |
| | Lower transmission range | | 0 to 150 °C |
| | Upper transmission range | | 0 to 150 °C |
| 33 | Zero point | | 5 to 20 % |
| | Lower transmission range | | 0 to 150 °C |
| | Upper transmission range | | 0 to 150 °C |
| 34 | Output AA1 | | Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature |

Annex A (configuration instructions)

| F | Function block parameters | CO5 | Value range |
|----|---------------------------|-----|--|
| 35 | Output AA2 | | Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature |
| 36 | Output AA3 | | Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature |
| 37 | Output AA4 | | Y1, Y2, Y3, Y4, 10 V supply, 3 V supply, differential temperature control, SLP speed, ZP speed, external demand, outdoor temperature |

PA6 parameters (Modbus)

| P | Parameters | PA6 | Value range |
|----|--------------------------------|-----|-------------|
| 01 | Modbus station address (8 bit) | | 1 to 246 |
| 02 | Modbus Baud rate | | 9600, 19200 |

CO6 function block parameters (Modbus)

| F | Function block parameters | CO6 | Value range |
|----|---------------------------|-----|-------------------------------|
| 10 | Heat meter 1 address | | 0 to 255 |
| | HM 1 model | | 1434, CAL3, APAtO, SLS |
| | Heat meter 1 mode | | 24 h, Continuous, Coil |
| | Heat meter 2 address | | 0 to 255 |
| | HM 2 model | | 1434, CAL3, APAtO, SLS |
| | Heat meter 3 mode | | 24 h, Continuous, Coil |
| | Heat meter 3 address | | 0 to 255 |
| | HM 3 model | | 1434, CAL3, APAtO, SLS |
| 11 | Heat meter 3 mode | | 24 h, Continuous, Coil |
| | Max. limit | | OT to 650 m ³ /h |
| | Max. limit (heating) | | OT to 650 m ³ /h |
| | Max. limit (DHW) | | 0.01 to 650 m ³ /h |
| | Limiting factor | | 0.1 to 10 |

| F | Function block parameters | CO6 | Value range |
|----|------------------------------|-----|------------------------------------|
| 12 | Max. limit | | OT to 6500 kW |
| | Max. limit (heating) | | OT to 6500 kW |
| | Max. limit (DHW) | | 0.1 to 6500 kW |
| | Limiting factor | | 0.1 to 10 |
| 13 | Max. limit | | 0.01 to 650 m ³ /h |
| | Limiting factor | | 0.1 to 10 |
| 14 | Max. limit | | 0.1 to 6500 kW |
| | Limiting factor | | 0.1 to 10 |
| 15 | Max. limit | | 0.01 to 650 m ³ /h |
| | Limiting factor | | 0.1 to 10 |
| 16 | Max. limit | | 0.1 to 6500 kW |
| | Limiting factor | | 0.1 to 10 |
| 17 | Max. limit | | 0.1 to 6500 kW |
| | Max. return flow temperature | | 5.0 to 90 °C |
| 25 | IP address | | 0 to 255 (in blocks) |
| | Subnet | | 0 to 255 (in blocks) |
| | Gateway | | 0 to 255 (in blocks) |
| | DNS server | | 0 to 255 (in blocks) |
| 27 | Port | | Adjustable as required |
| 28 | Encryption | | Configurable max. 49 characters |
| 31 | Refreshing rate | | AUTO, up to 30 s |

CO7 function block parameters (device bus)

| F | Function block parameters | CO7 | Value range |
|----|---------------------------|-----|---------------|
| 1 | Device bus address | | Auto, 1 to 32 |
| 3 | Device bus address | | Auto, 1 to 32 |
| 4 | Device bus address | | Auto, 1 to 32 |
| 5 | Device bus address | | Auto, 1 to 32 |
| 6 | Register number | | 1 to 4 |
| 7 | Register number | | 1 to 4 |
| 8 | Register number | | 1 to 4 |
| 9 | Register number | | 1 to 4 |
| 10 | Register number | | 5 to 65 |
| 11 | Register number | | 5 to 65 |

Annex A (configuration instructions)

| F | Function block parameters | CO7 | Value range |
|----|---------------------------|-----|-------------|
| 12 | Register number | | 5 to 65 |
| 13 | Register number | | 5 to 65 |
| 15 | Register number | | 5 to 65 |
| 17 | Register number | | 5 to 65 |
| 18 | Register number | | 5 to 65 |
| 19 | Register number | | 5 to 65 |
| 20 | Register number | | 5 to 65 |
| 21 | Register number | | 5 to 65 |
| 22 | Register number | | 5 to 65 |
| 23 | Register number | | 5 to 65 |
| 31 | Device bus address | | 11 to 19 |
| 32 | Device bus address | | 11 to 19 |
| 33 | Device bus address | | 11 to 19 |

CO8 function block parameters (initialization of free inputs)

| F | Function block parameters | CO8 | Value range |
|----|---------------------------|-----|--------------------------|
| 1 | Error message when | | BI = 0, BI = 1, none (1) |
| 2 | Error message when | | BI = 0, BI = 1, none (1) |
| 3 | Error message when | | BI = 0, BI = 1, none (1) |
| 4 | Error message when | | BI = 0, BI = 1, none (1) |
| 5 | Error message when | | BI = 0, BI = 1, none (1) |
| 6 | Error message when | | BI = 0, BI = 1, none (1) |
| 9 | Error message when | | BI = 0, BI = 1, none (1) |
| 10 | Error message when | | BI = 0, BI = 1, none (1) |
| 11 | Error message when | | BI = 0, BI = 1, none (1) |
| 12 | Error message when | | BI = 0, BI = 1, none (1) |
| 13 | Error message when | | BI = 0, BI = 1, none (1) |
| 15 | Error message when | | BI = 0, BI = 1, none (1) |
| 16 | Error message when | | BI = 0, BI = 1, none (1) |
| 17 | Error message when | | BI = 0, BI = 1, none (1) |

17 Annex B

17.1 Accessories

| | |
|--|--|
| Surge arrester SA 5000 | Order no. 1400-9868 |
| TROVIS I/O (expansion module) | Order no. 100062999 |
| SAM MOBILE Gateway | Type 5655 |
| TROVIS-VIEW software (free of charge) | ▶ www.samsongroup.com > SERVICE & SUPPORT > Downloads > TROVIS-VIEW |
| Water flow sensor with extension cable | Order no. 1400-9246 |

17.2 After-sales service

After-sales service

Contact our after-sales service for support concerning service or repair work or when malfunctions or defects arise.

You can reach our after-sales service at aftersalesservice@samsongroup.com.

Addresses of SAMSON AG and its subsidiaries

The addresses of SAMSON AG, its subsidiaries, representatives and service facilities worldwide can be found on our website (www.samsongroup.com) or in all SAMSON product catalogs.

Required specifications

Please submit the following details:

- Model number
- Firmware version
- Serial number

Key number

1732

EB 5578-E EN



SAMSON AKTIENGESELLSCHAFT
Weismüllerstraße 3 · 60314 Frankfurt am Main, Germany
Phone: +49 69 4009-0 · Fax: +49 69 4009-1507
samson@samsongroup.com · www.samsongroup.com